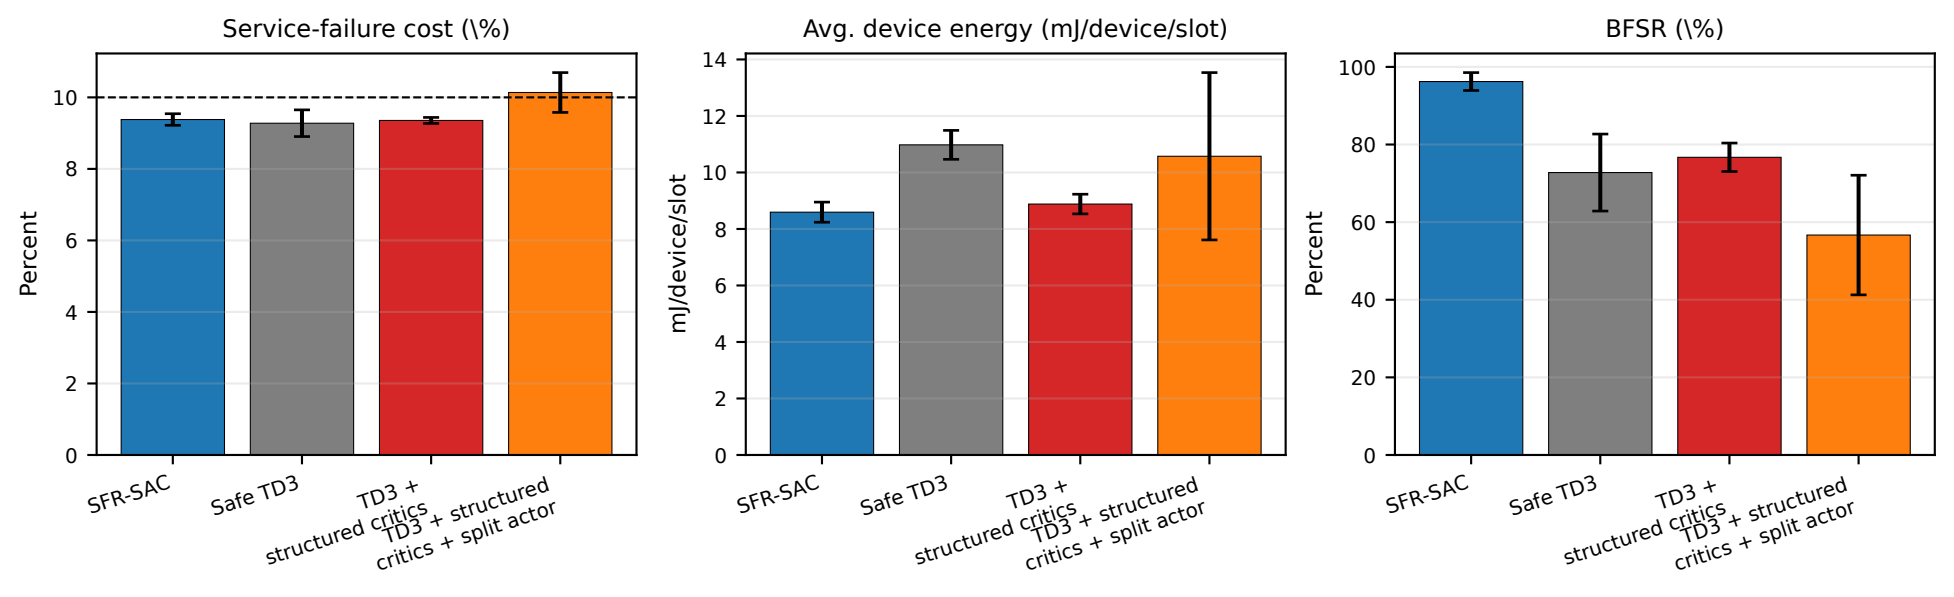
Service-failure cost (\%)
Percent
0
2
4
6
8
10
SFR-SAC
Safe TD3
TD3 + structured critics
TD3 + structured critics + split actor
Avg. device energy (mJ/device/slot)
mJ/device/slot
0
2
4
6
8
10
12
14
SFR-SAC
Safe TD3
TD3 + structured critics
TD3 + structured critics + split actor
BFSR (\%)
Percent
0
20
40
60
80
100
SFR-SAC
Safe TD3
TD3 + structured critics
TD3 + structured critics + split actor