


NOMOGRAMA NORMATIVO DE CAMPO

IDAAN 2006 • MOP 2021 • CEPIS/OPS • Manning • Tirante d/D = 0.80

Sistema: **Sanitario** Material: **PVC/HDPE** Manning n: **0.009** V mín: **0.6 m/s** V máx: **3.35 m/s** Tirante: **d/D = 0.8**

Alcantarillado Sanitario — PVC/HDPE (n=0.009)

d/D=0.8 | Vmin=0.6 m/s | Vmax=3.35 m/s | IDAAN 2006 + MOP 2021 + CEPIS/OPS

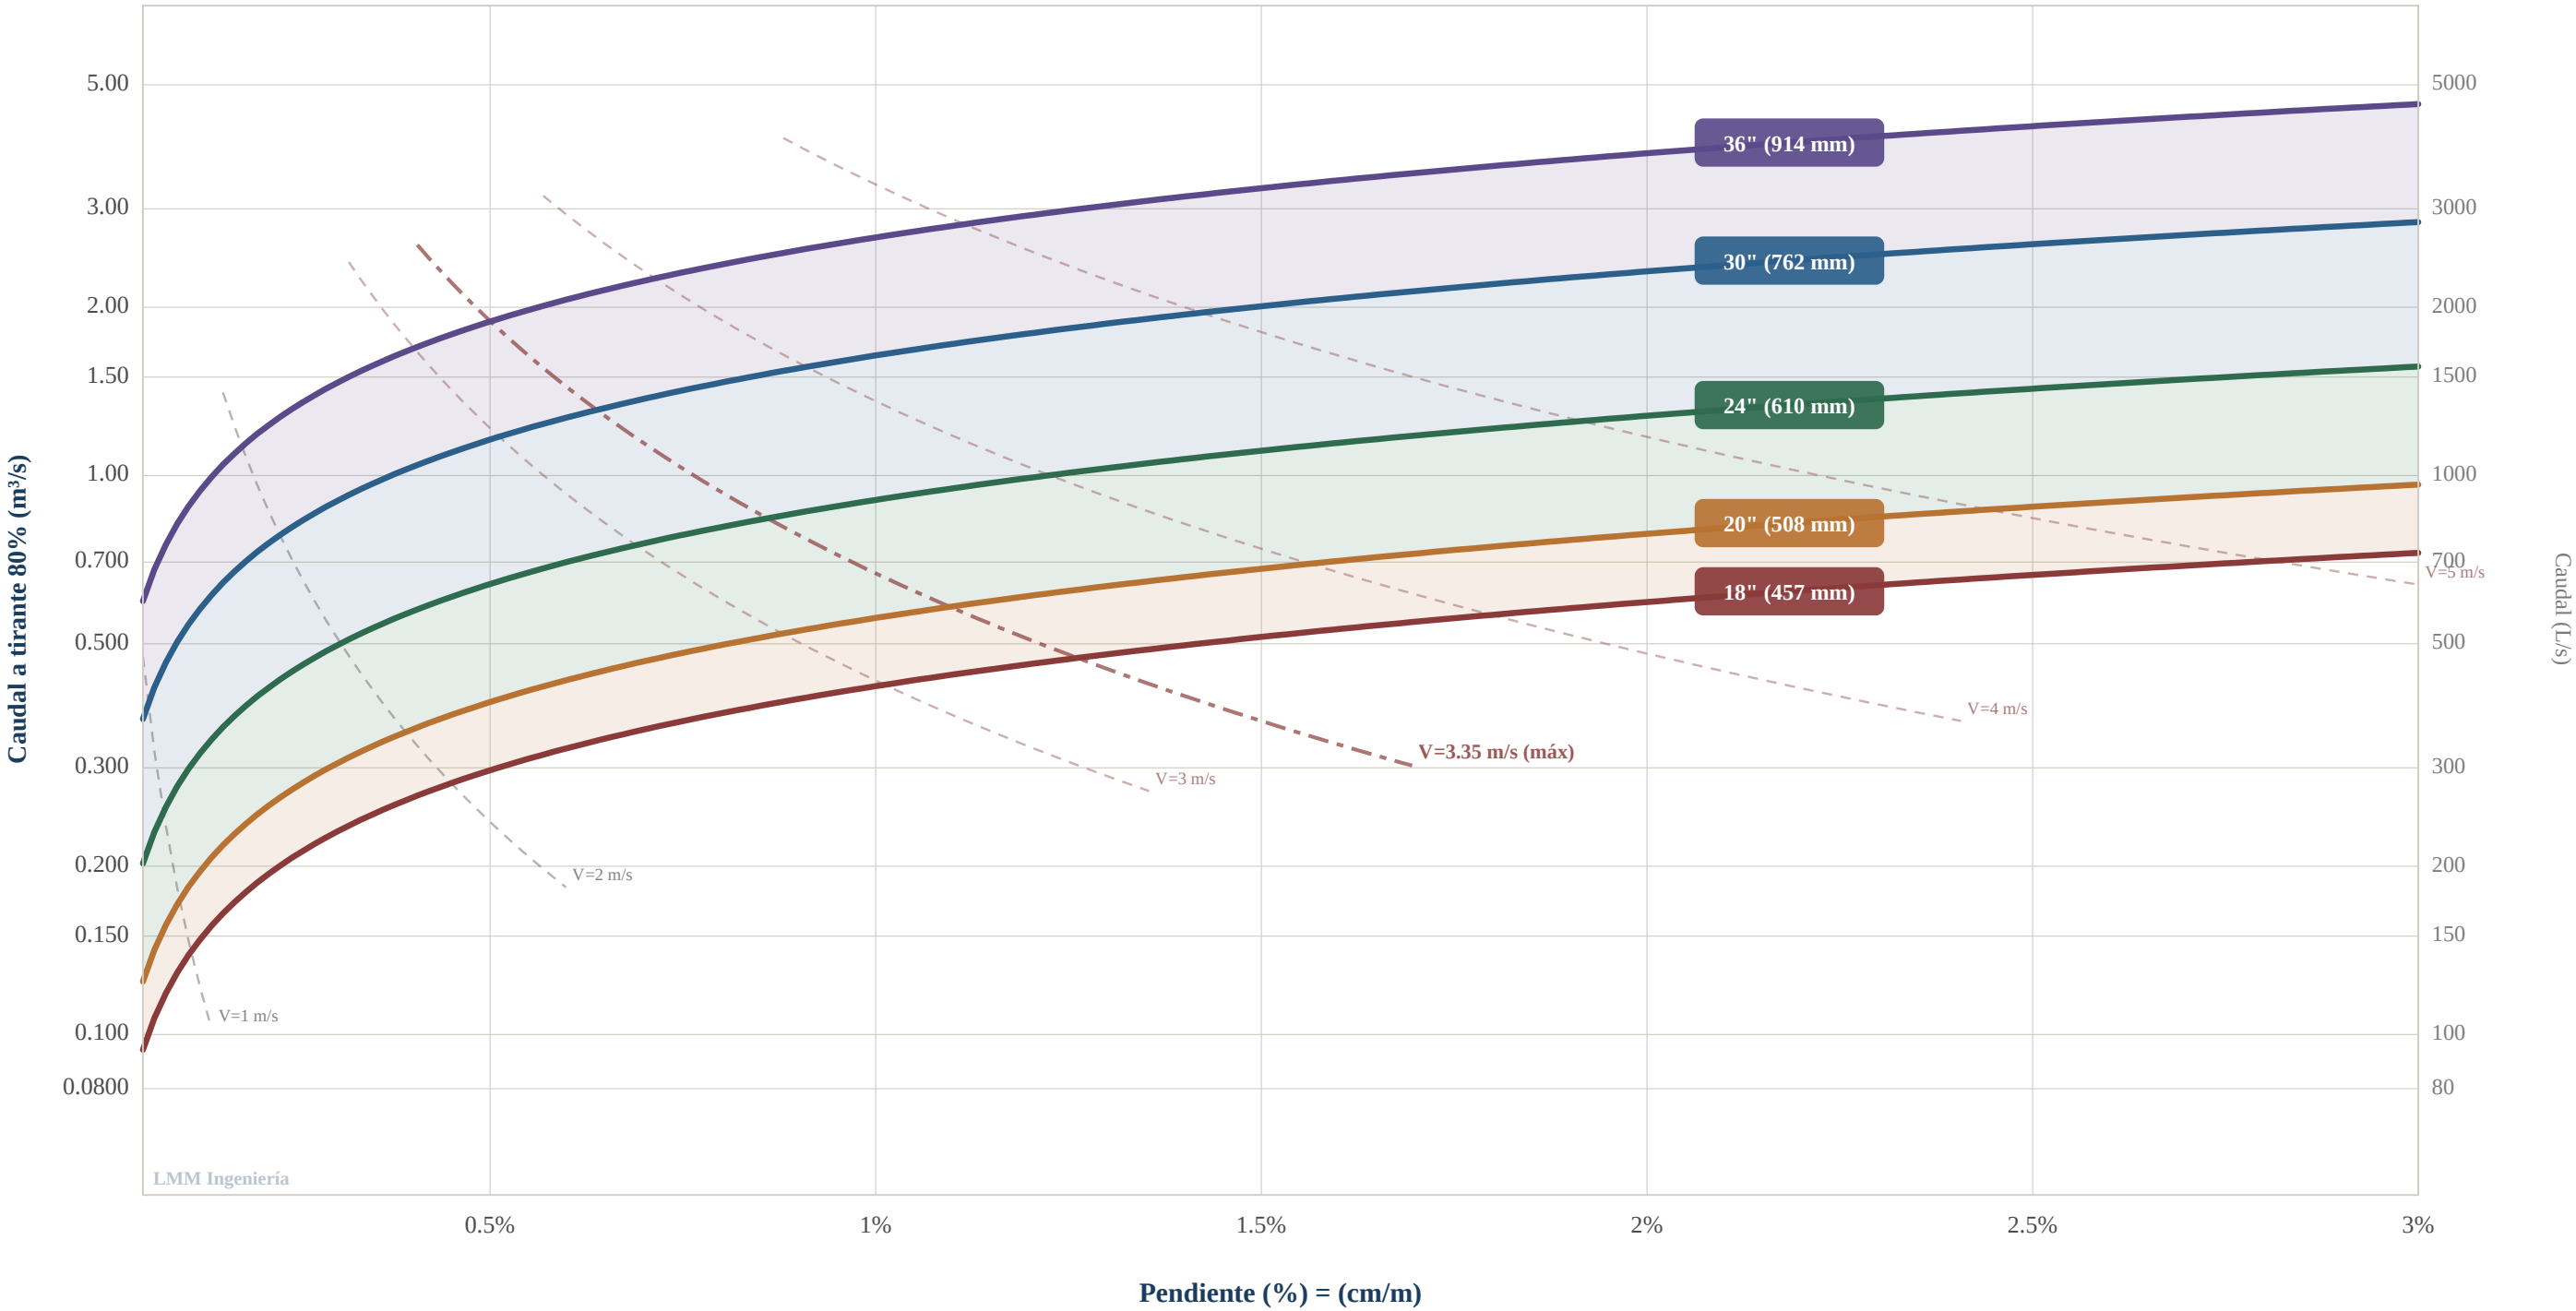


NOMOGRAMA NORMATIVO DE CAMPO

IDAAN 2006 • MOP 2021 • CEPIS/OPS • Manning • Tirante d/D = 0.80

Sistema: **Sanitario** Material: **Concreto** Manning n: **0.013** V mín: **0.6 m/s** V máx: **3 m/s** Tirante: **d/D = 0.8**

Alcantarillado Sanitario — Concreto (n=0.013)

d/D=0.8 | Vmin=0.6 m/s | Vmax=3 m/s | IDAAN 2006 + MOP 2021 + CEPIS/OPS

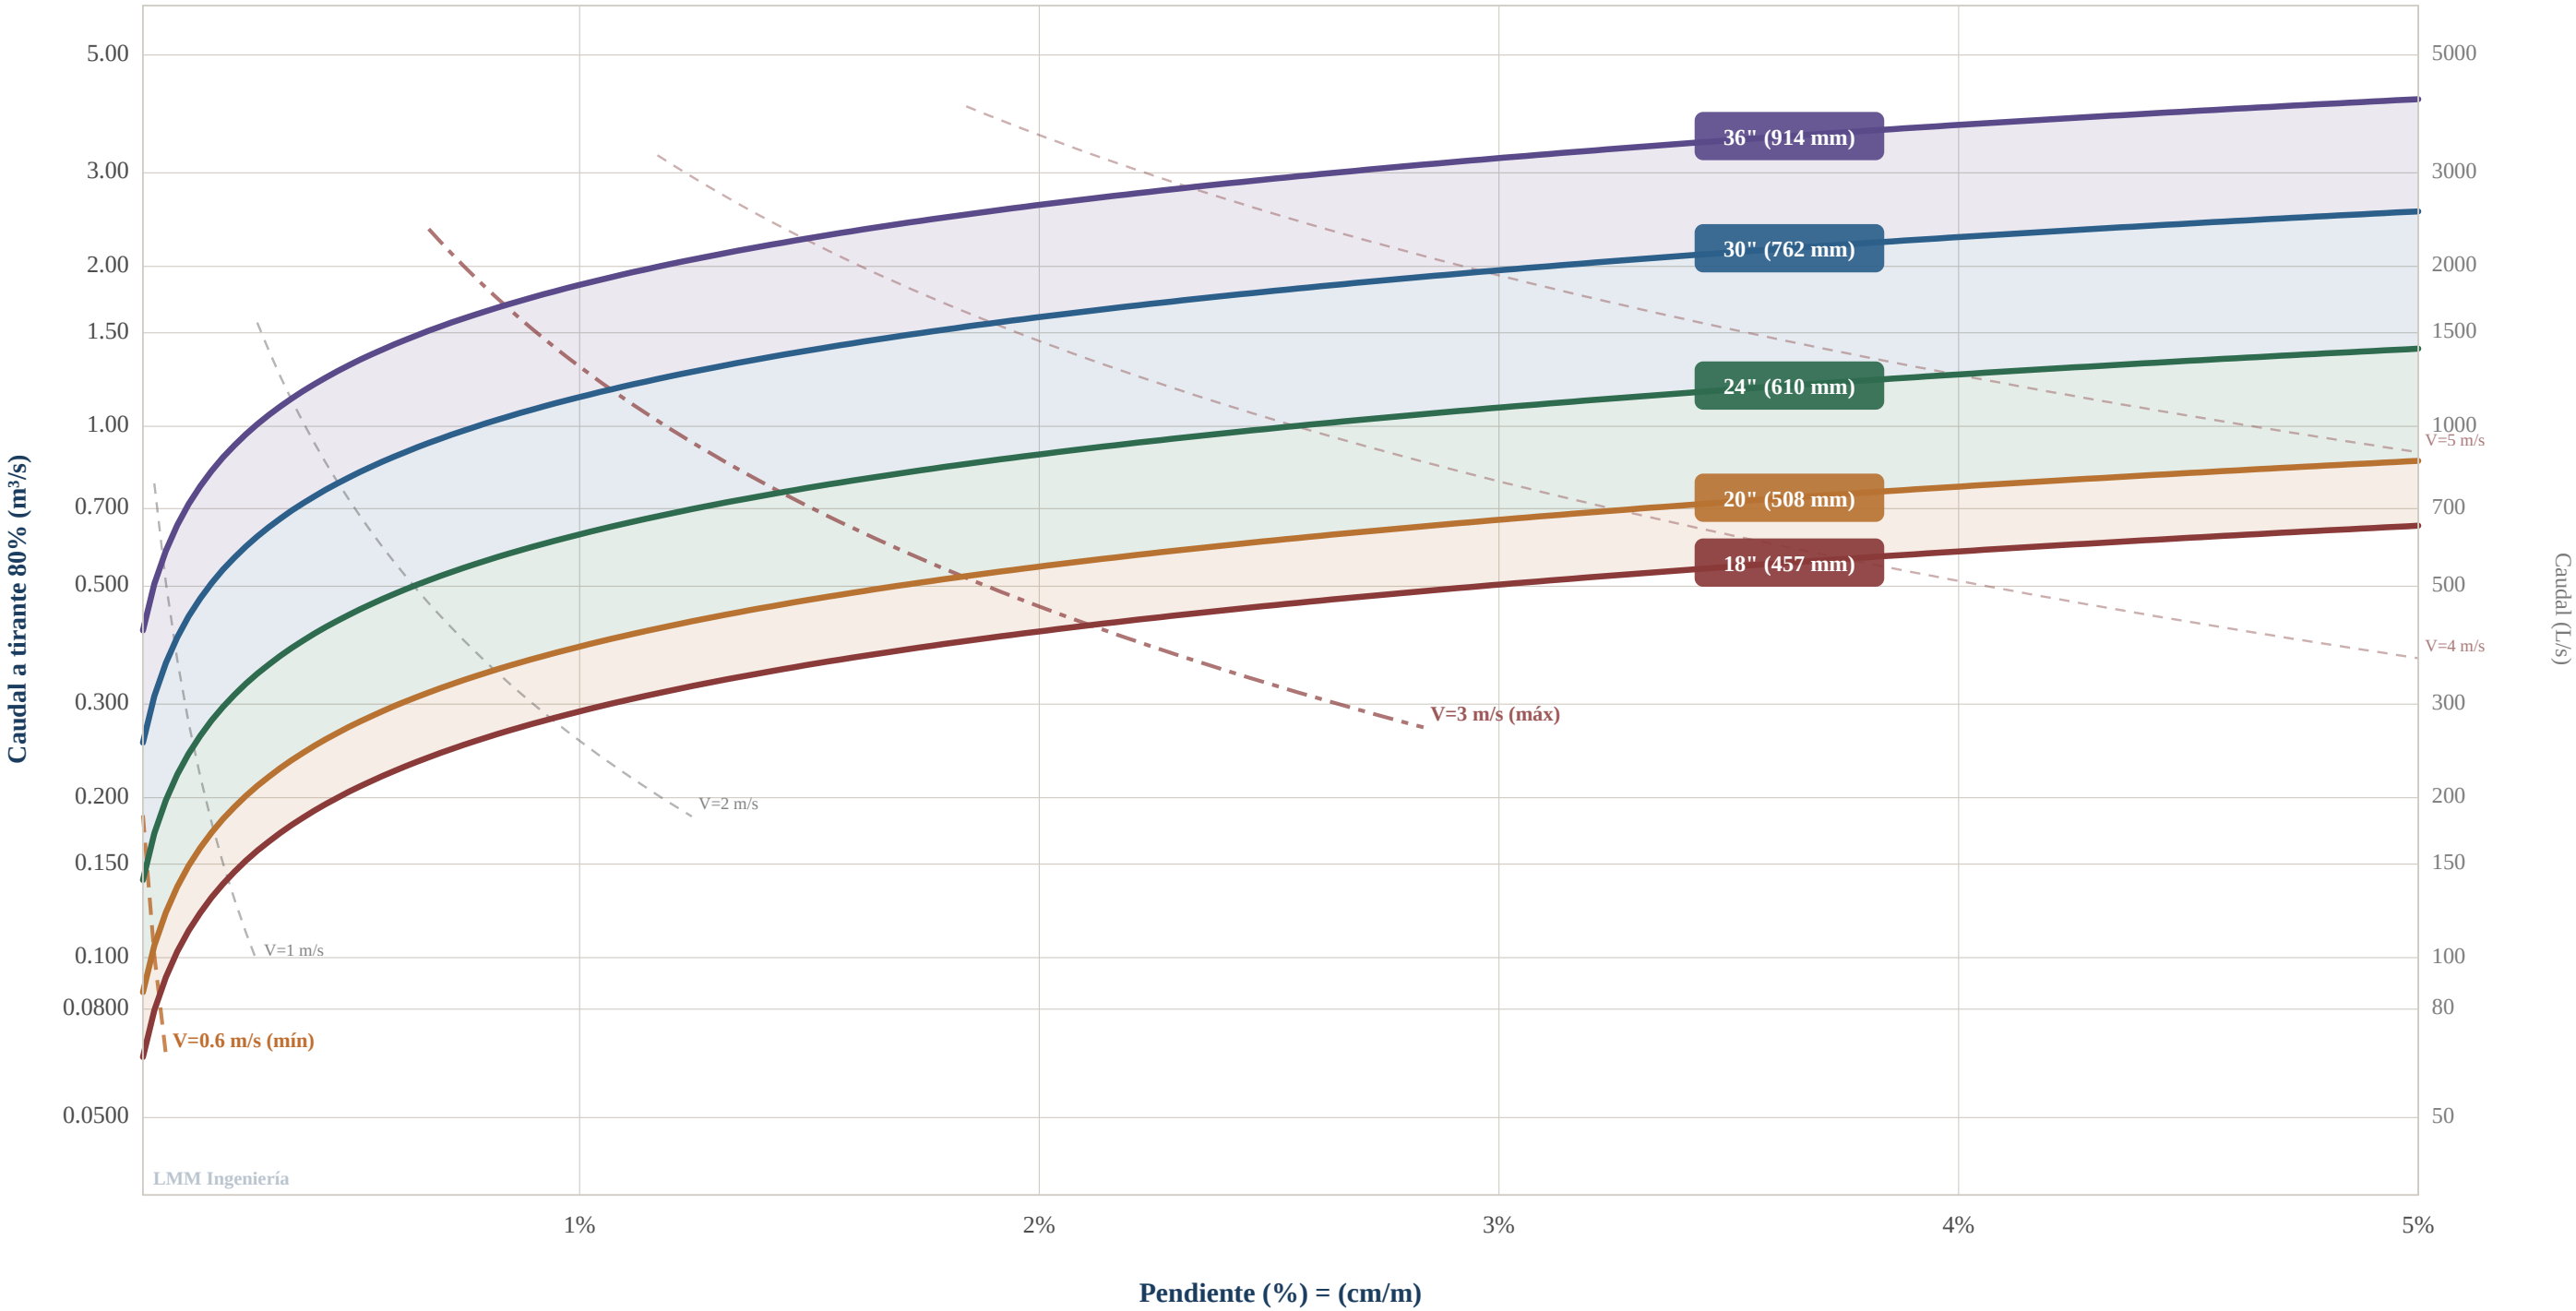


NOMOGRAMA NORMATIVO DE CAMPO

IDAAN 2006 • MOP 2021 • CEPIS/OPS • Manning • Tirante d/D = 0.80

Sistema: **Pluvial** Material: **PVC/HDPE** Manning n: **0.009** V mín: **0.6 m/s** V máx: **5 m/s** Tirante: **d/D = 0.8**

Alcantarillado Pluvial — PVC/HDPE (n=0.009)

d/D=0.8 | Vmin=0.6 m/s | Vmax=5 m/s | IDAAN 2006 + MOP 2021 + CEPIS/OPS

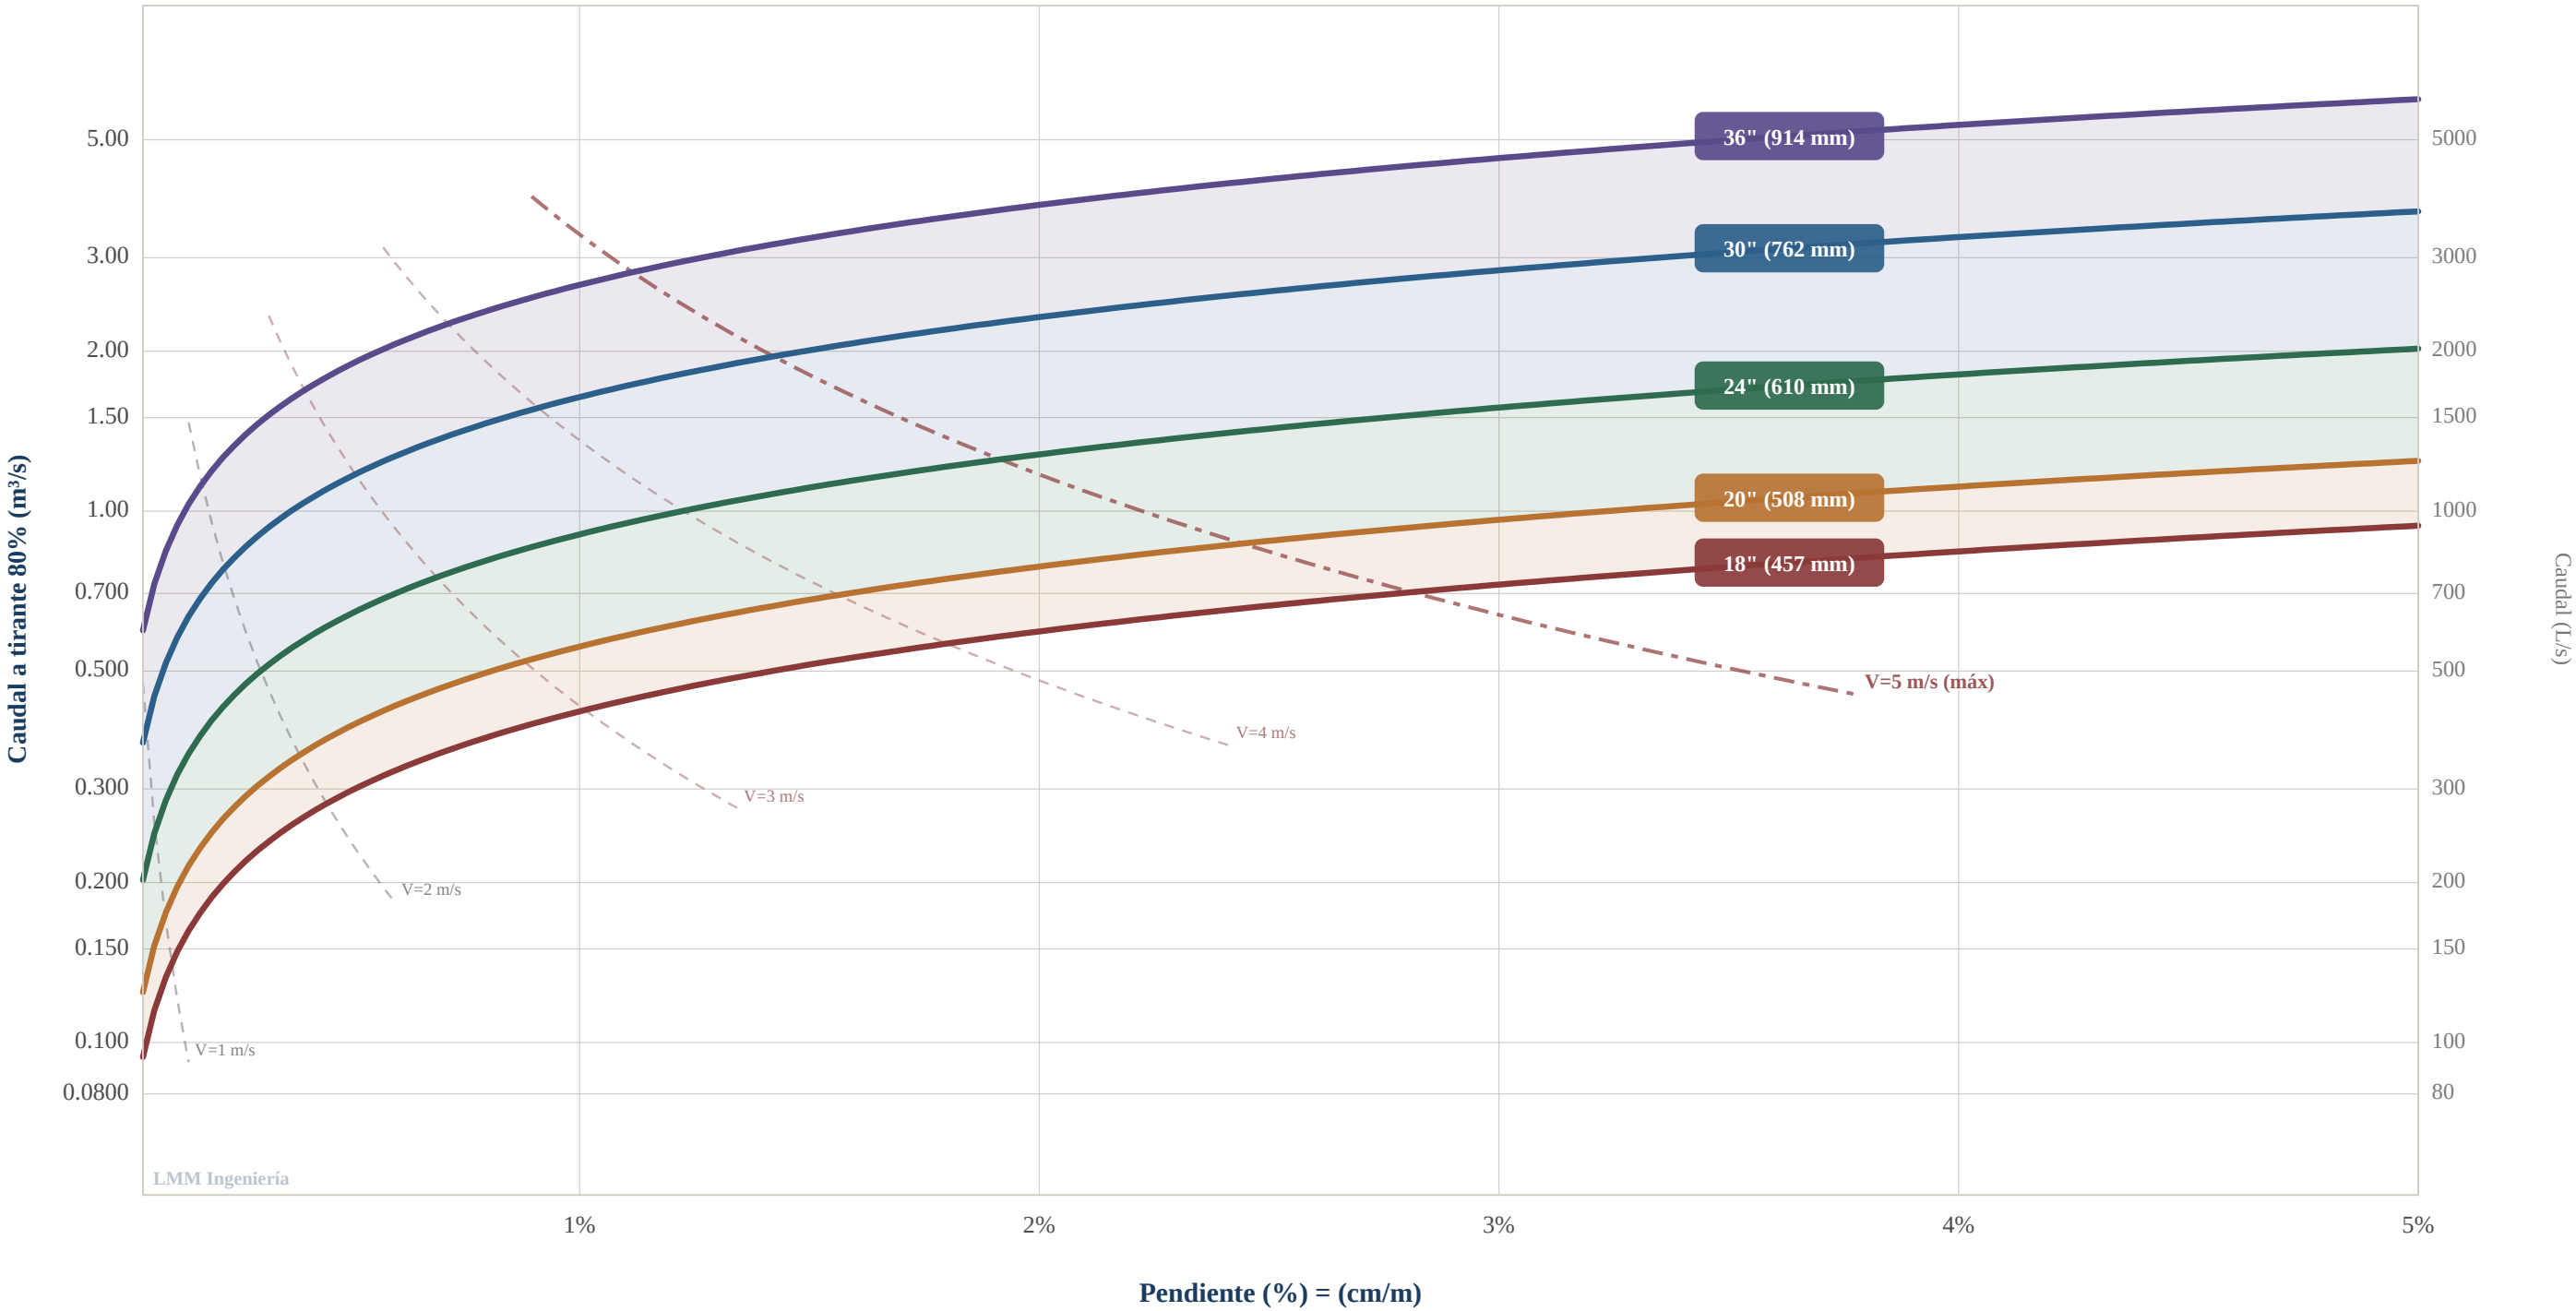

NOMOGRAMA NORMATIVO DE CAMPO

IDAAN 2006 • MOP 2021 • CEPIS/OPS • Manning • Tirante d/D = 0.80

Sistema: **Pluvial** Material: **Concreto** Manning n: **0.013** V mín: **0.6 m/s** V máx: **4.73 m/s** Tirante: **d/D = 0.8**

Alcantarillado Pluvial — Concreto (n=0.013)

d/D=0.8 | Vmin=0.6 m/s | Vmax=4.73 m/s | IDAAN 2006 + MOP 2021 + CEPIS/OPS

