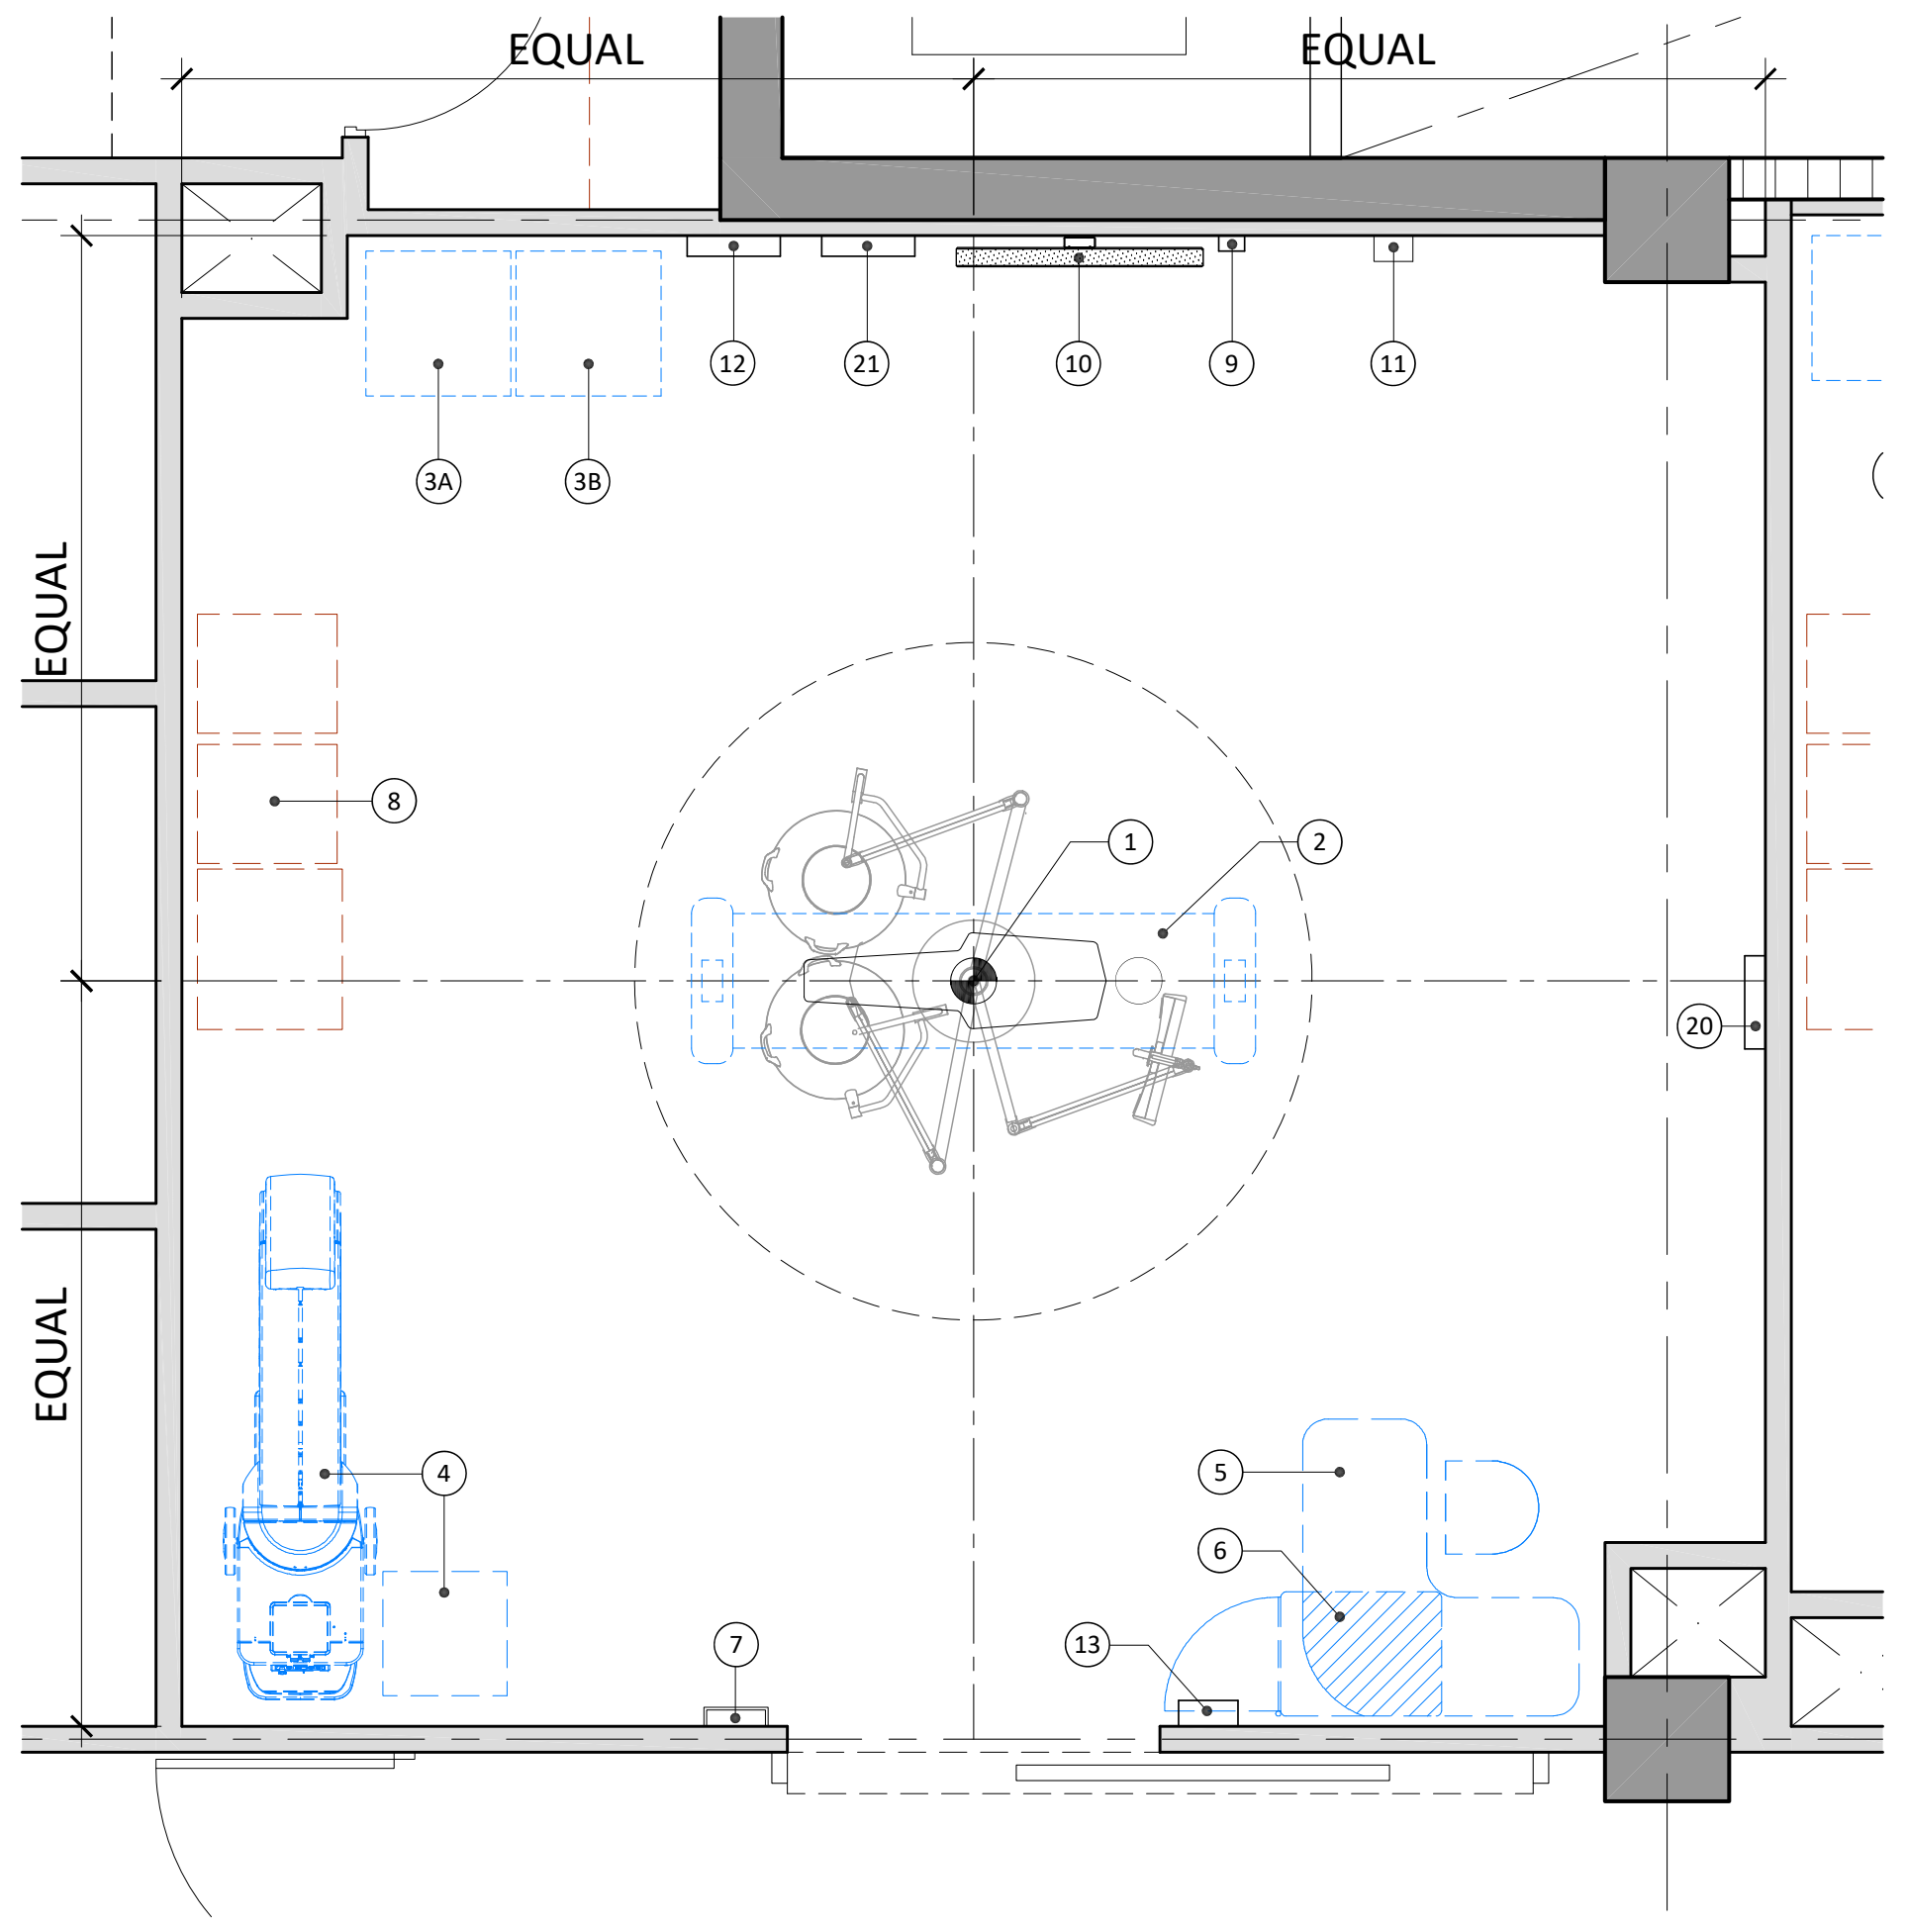

TYP. OPERATING ROOMS LAYOUT PLAN BLOW-UP
(SPACES 1-024, 1-027, 1-028, 1-029)

SCALE: 1/4"= 1'-0"

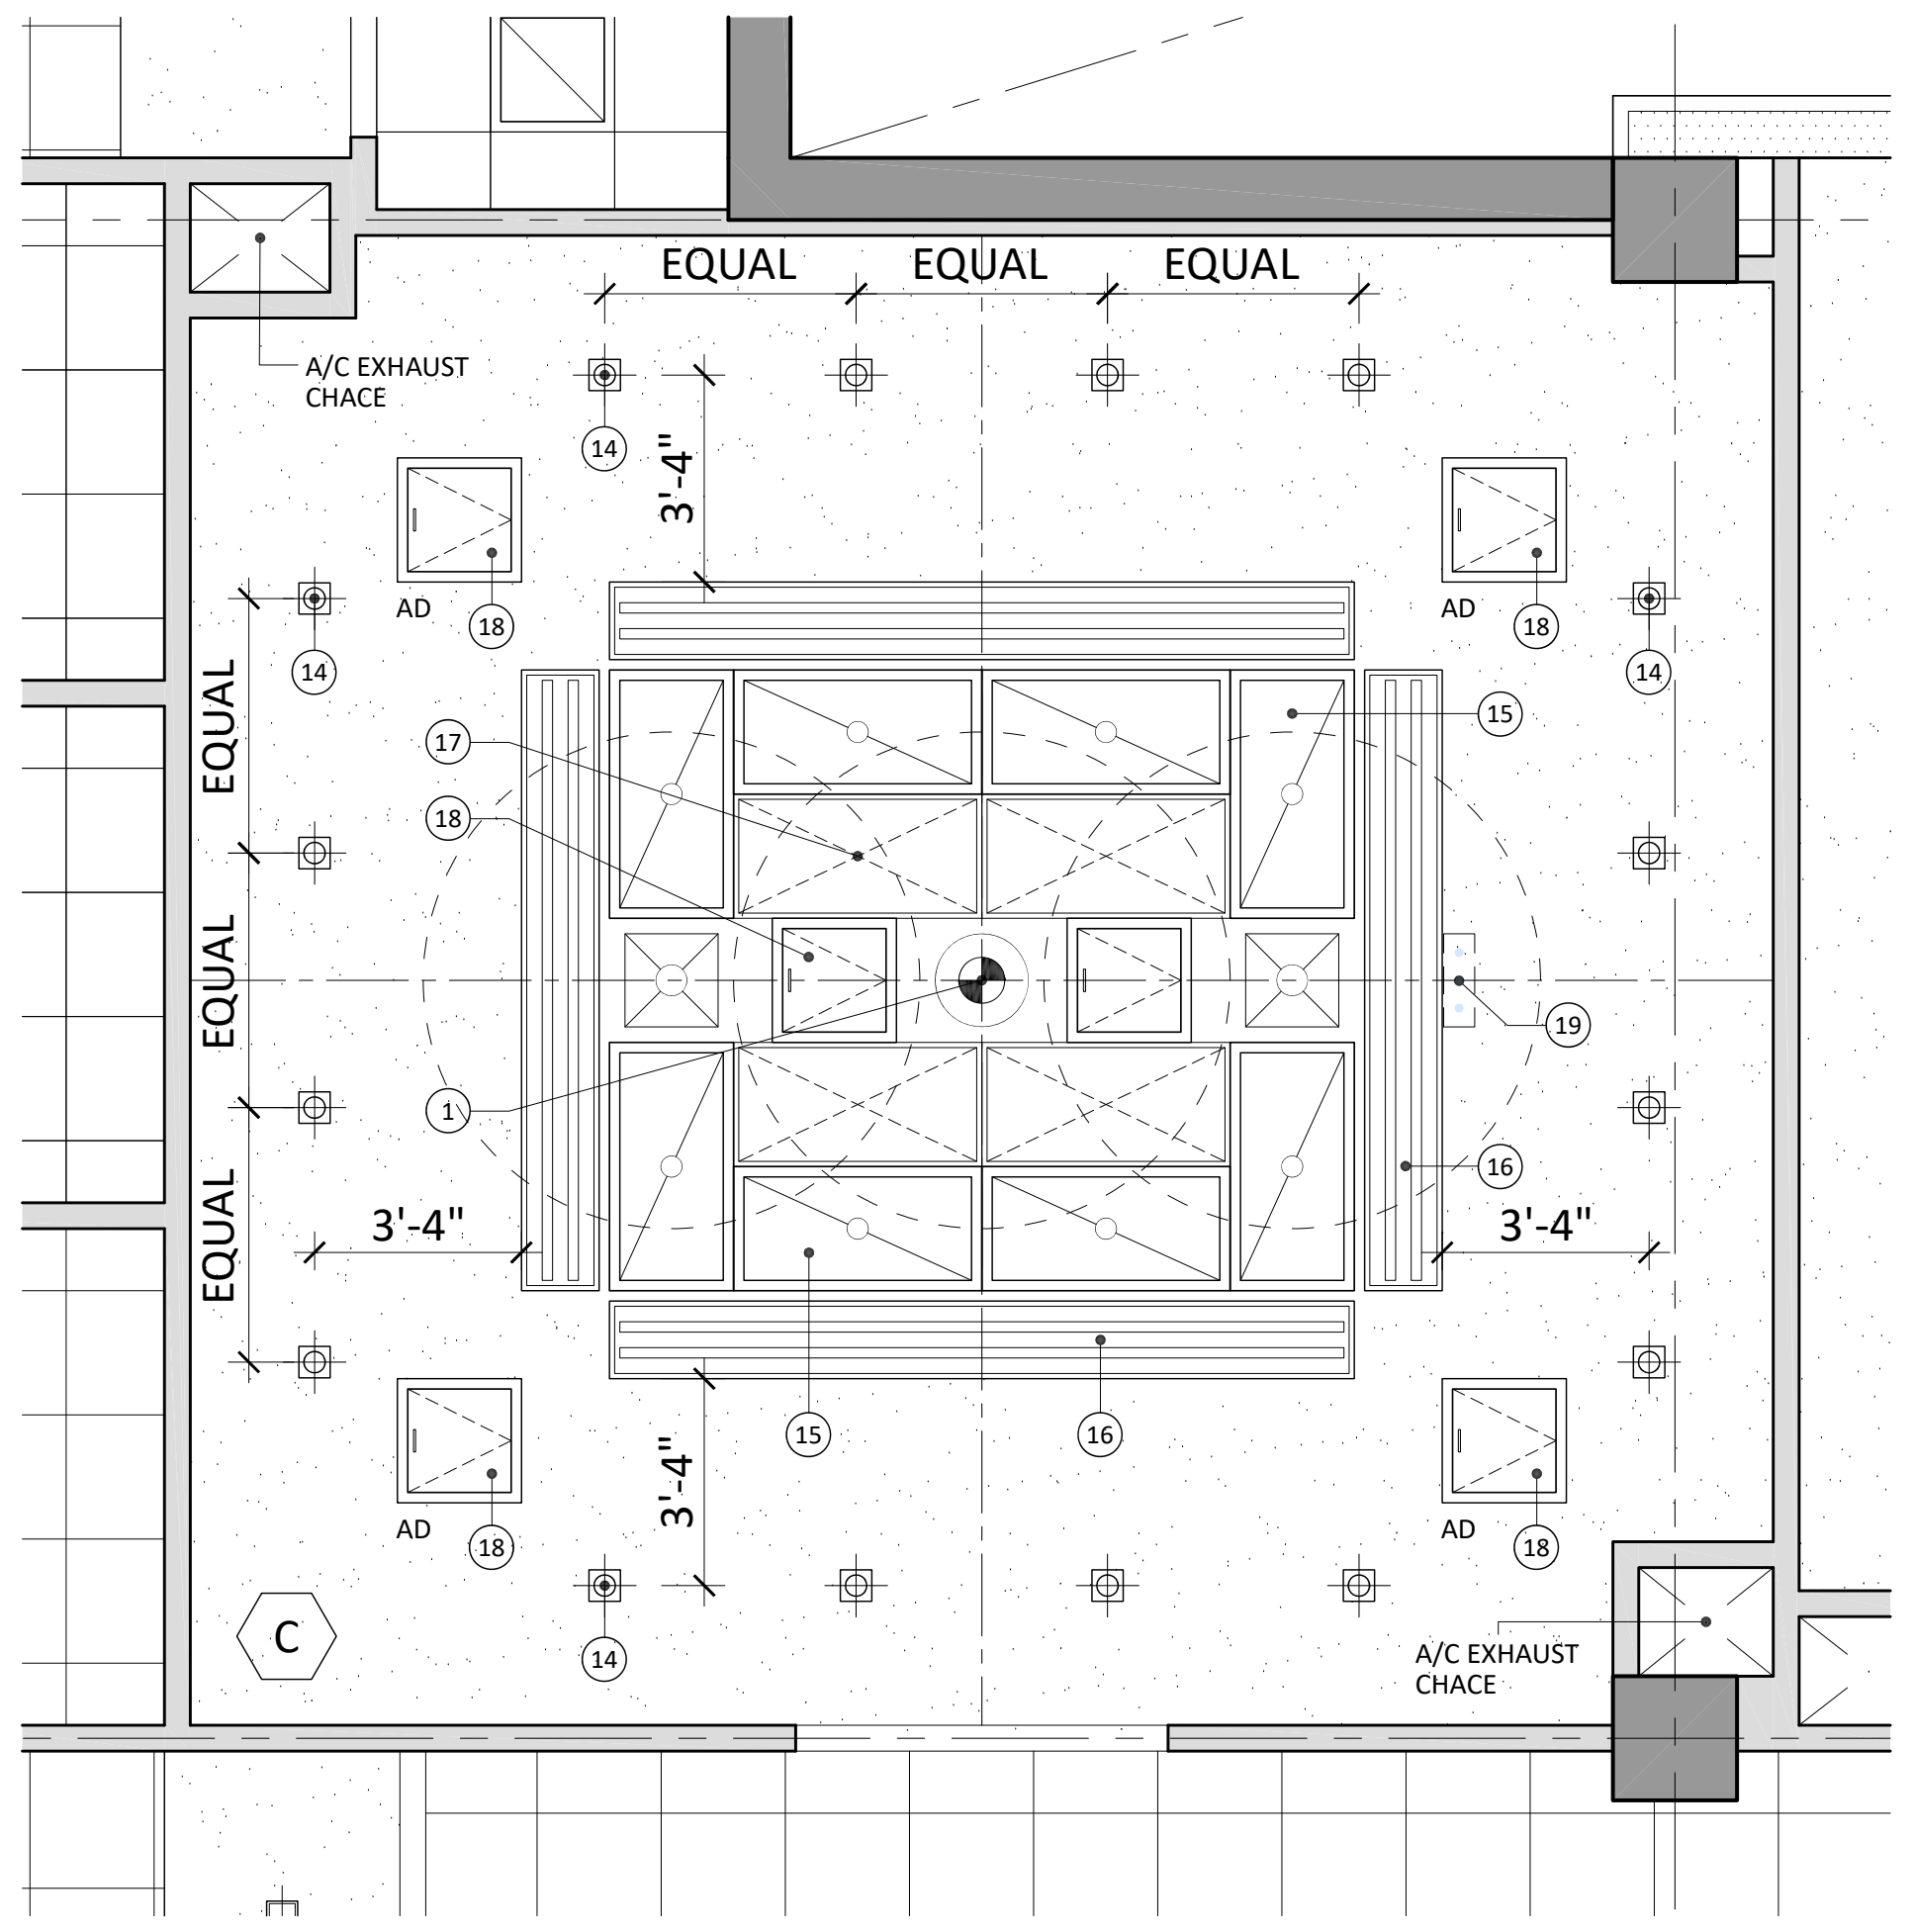

TYP. OPERATING CEILING PLAN BLOW-UP
(SPACES 1-024, 1-027, 1-028, 1-029)

SCALE: 1/4"= 1'-0"

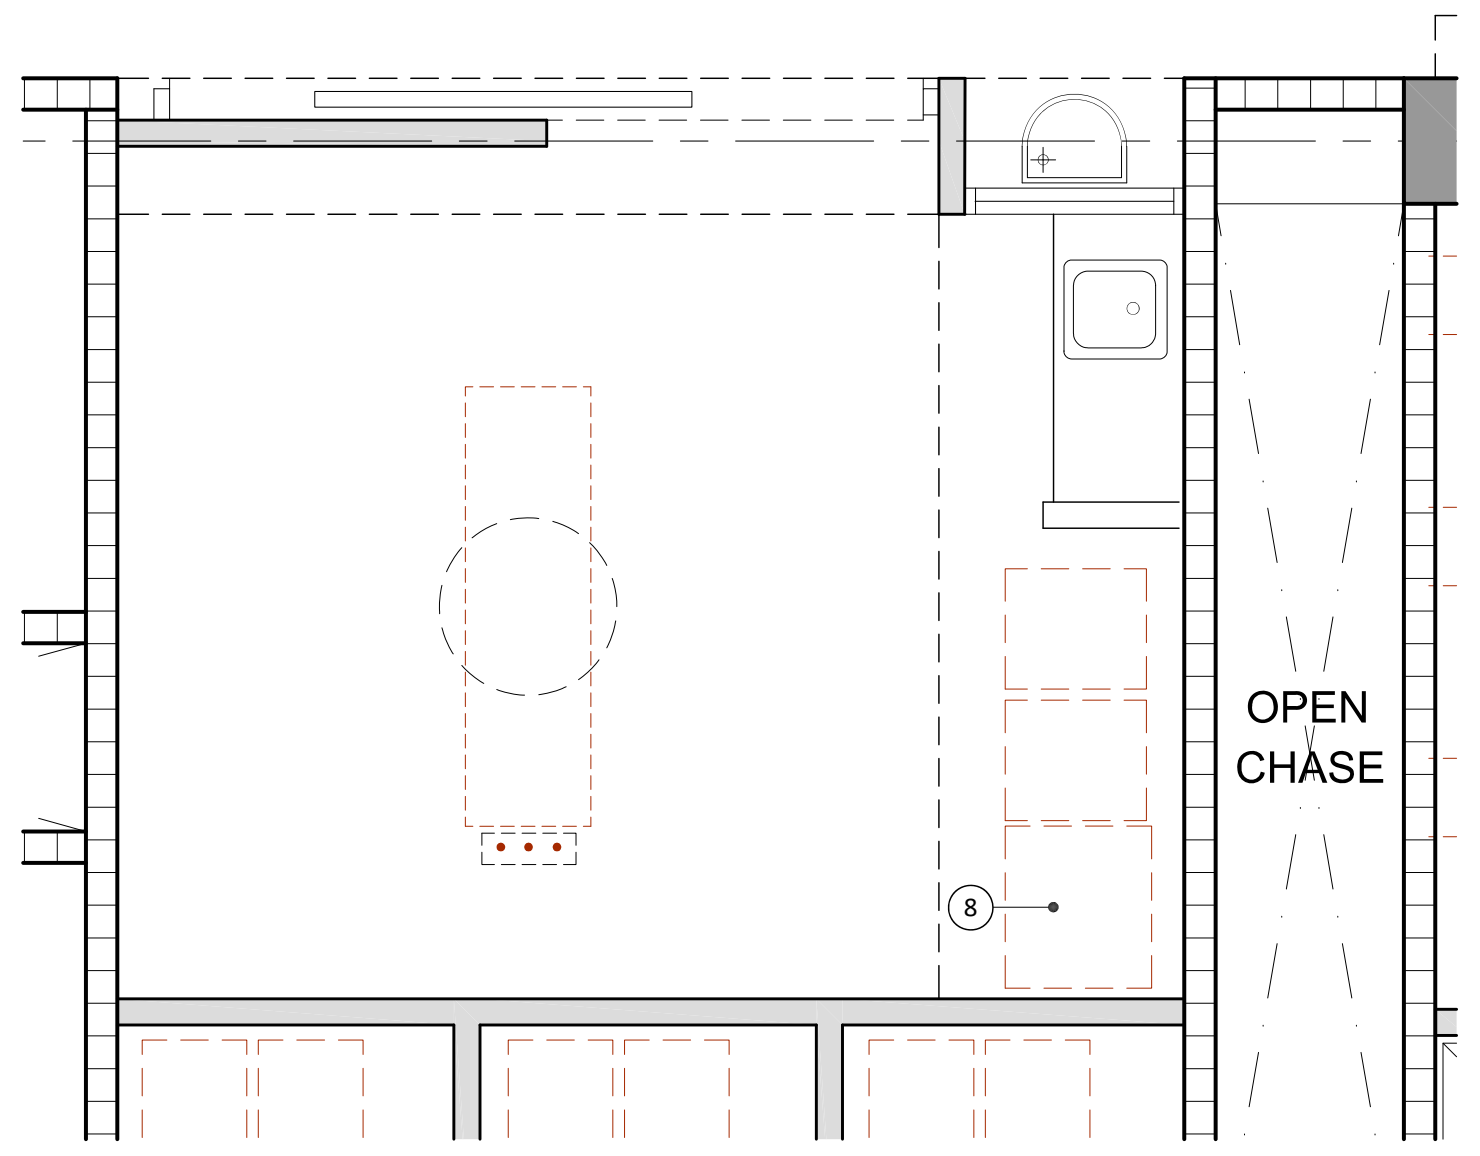

MINOR PROCEDURE LAYOUT PLAN BLOW-UP
(SPACES 1-161, 2-068, 4-046, 5-046, 6-046, 7-050)

SCALE: 1/4"= 1'-0"

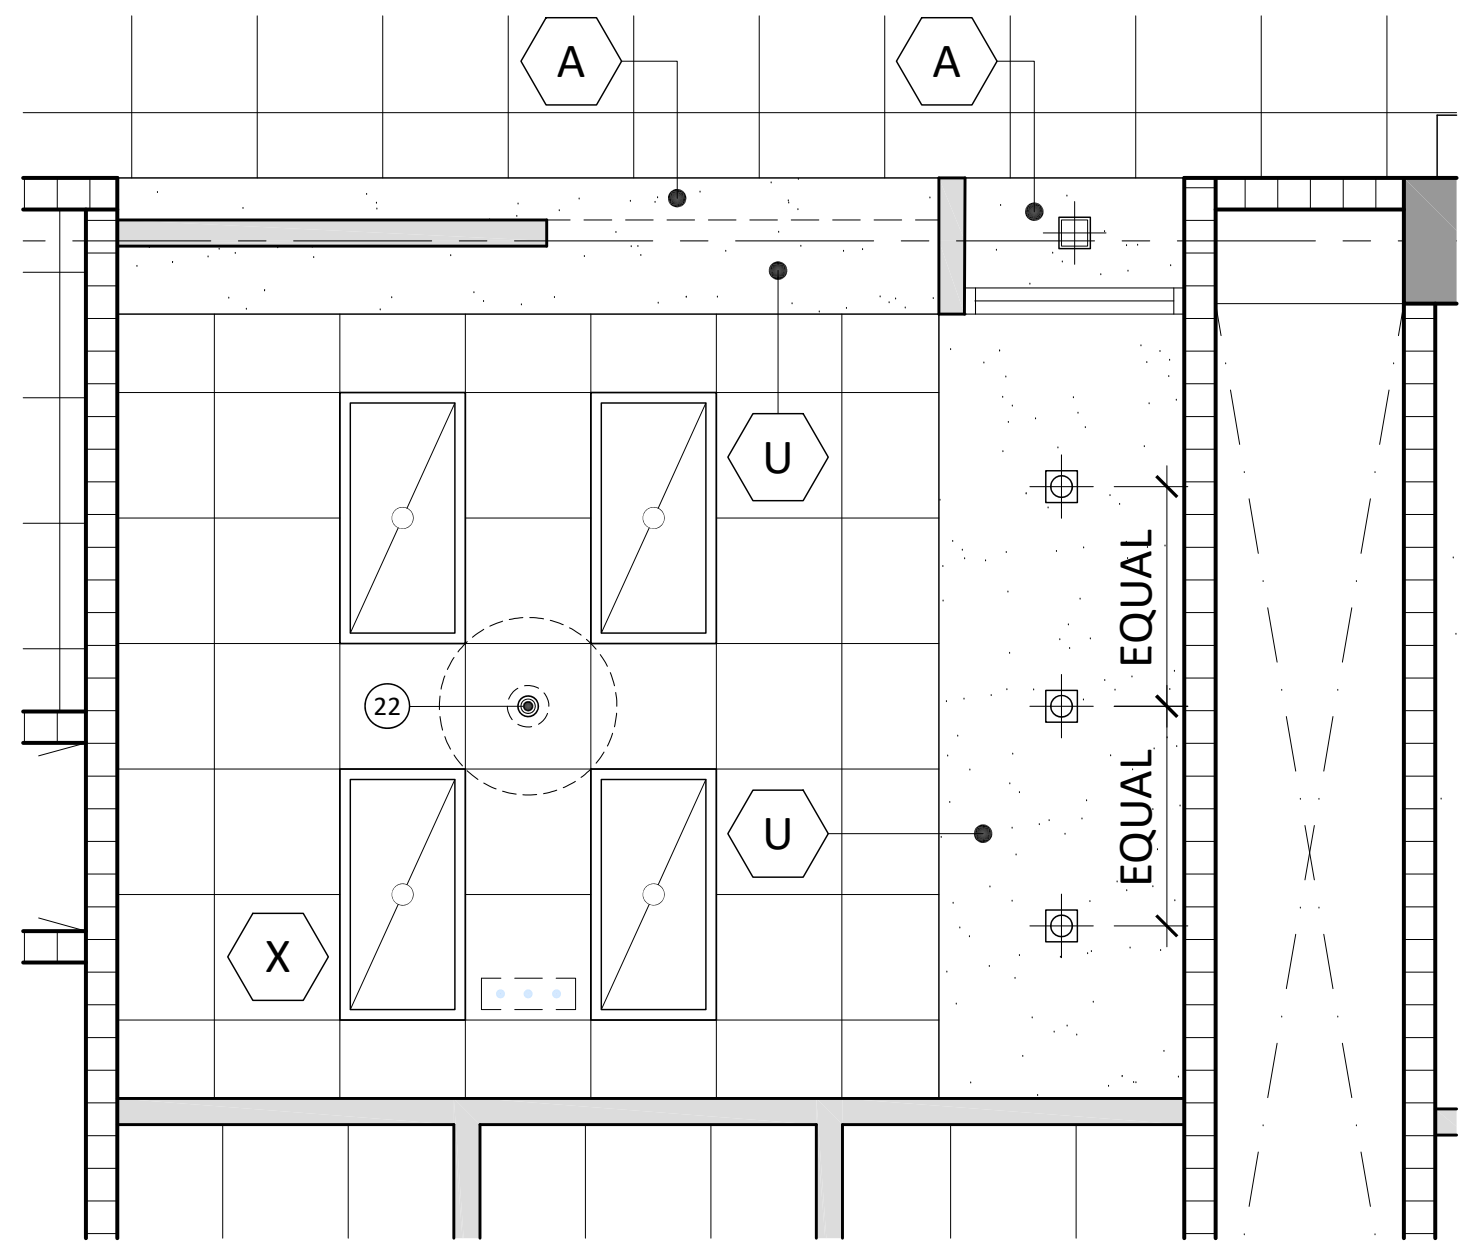

MINOR PROCEDURE LAYOUT PLAN BLOW-UP
(SPACES 1-161, 2-068, 4-046, 5-046, 6-046, 7-050)

SCALE: 1/4"= 1'-0"

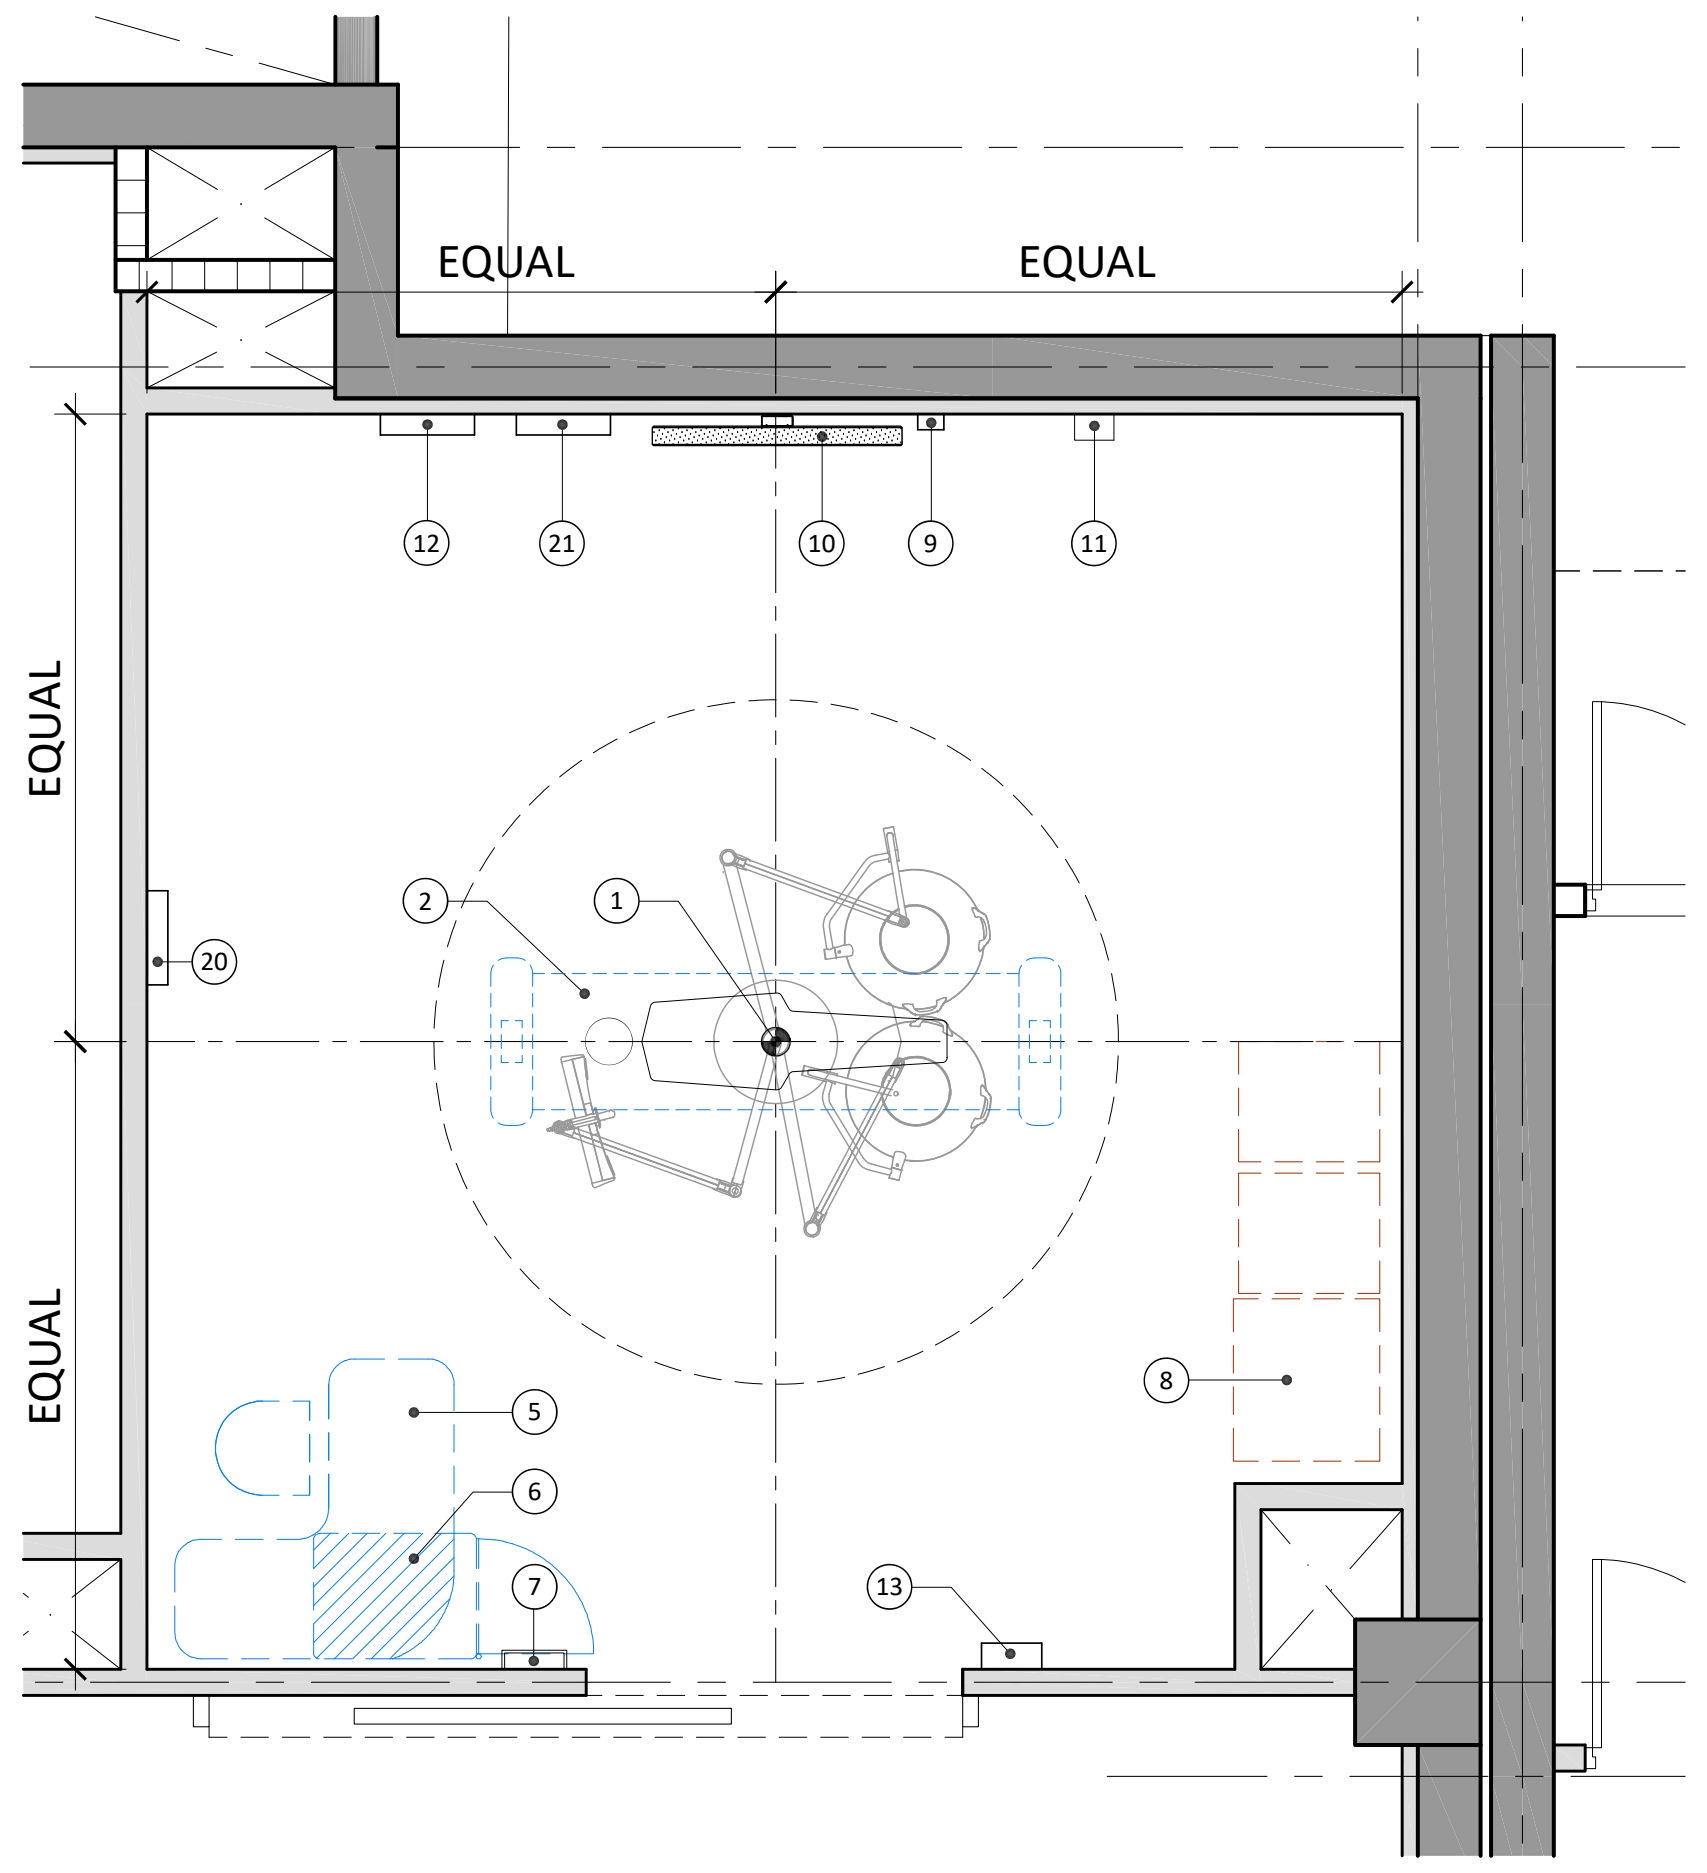

OPERATING ROOM LAYOUT PLAN BLOW-UP
(SPACE 1-031)

SCALE: 1/4"= 1'-0"

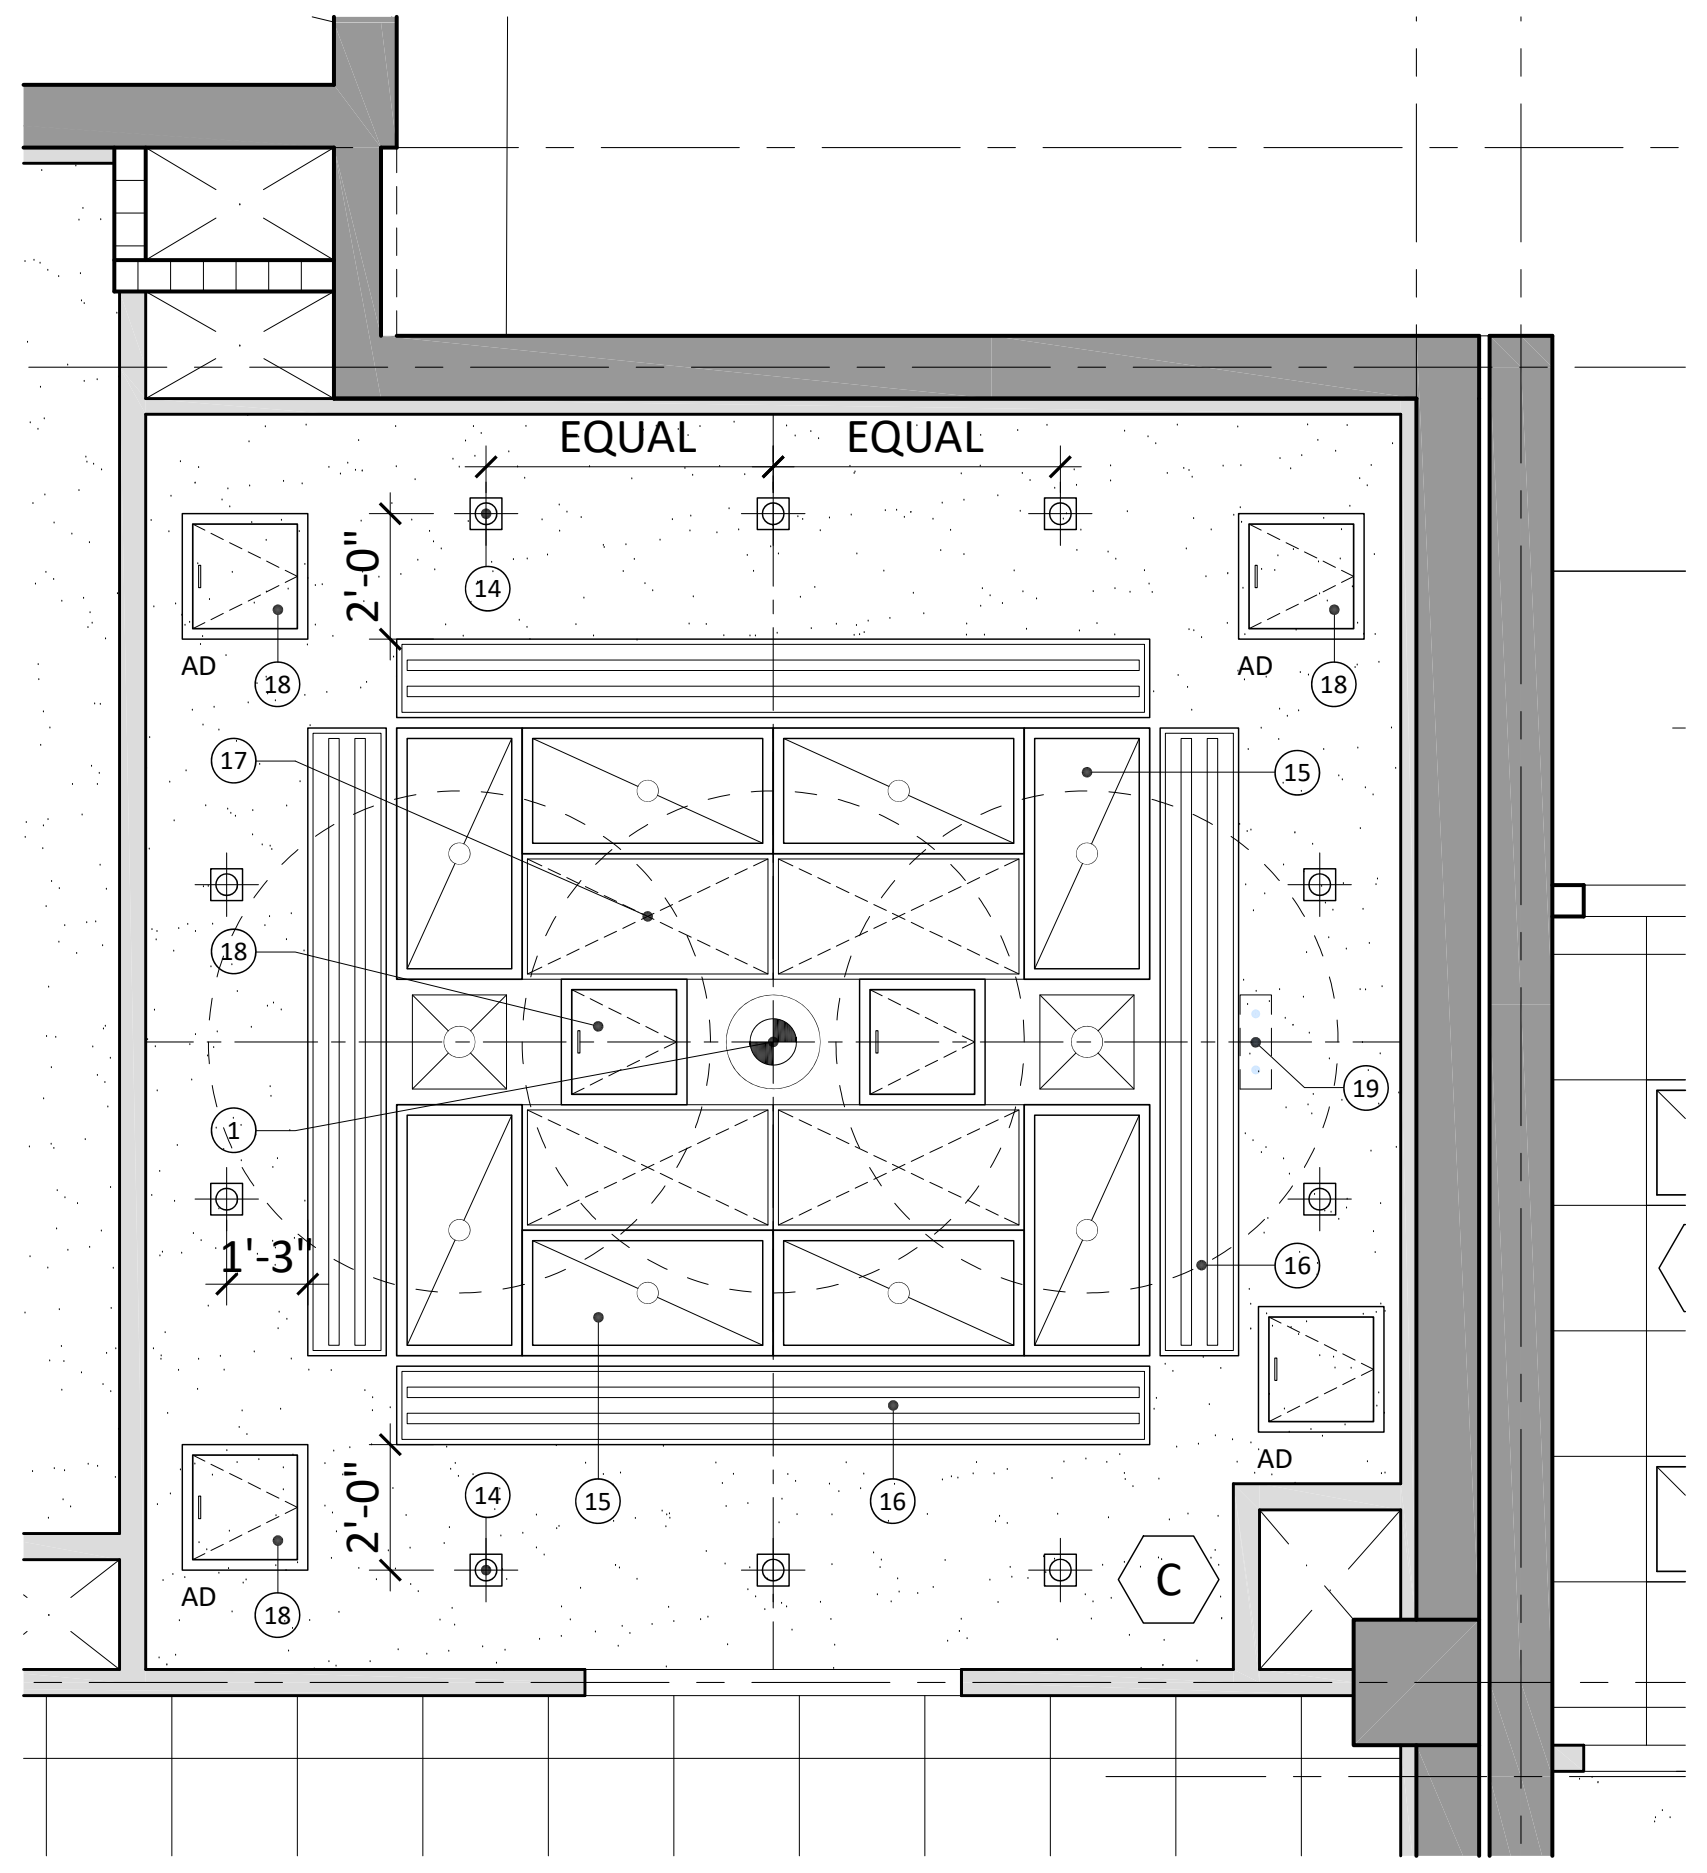

OPERATING CEILING PLAN BLOW-UP
(SPACE 1-031)

SCALE: 1/4"= 1'-0"

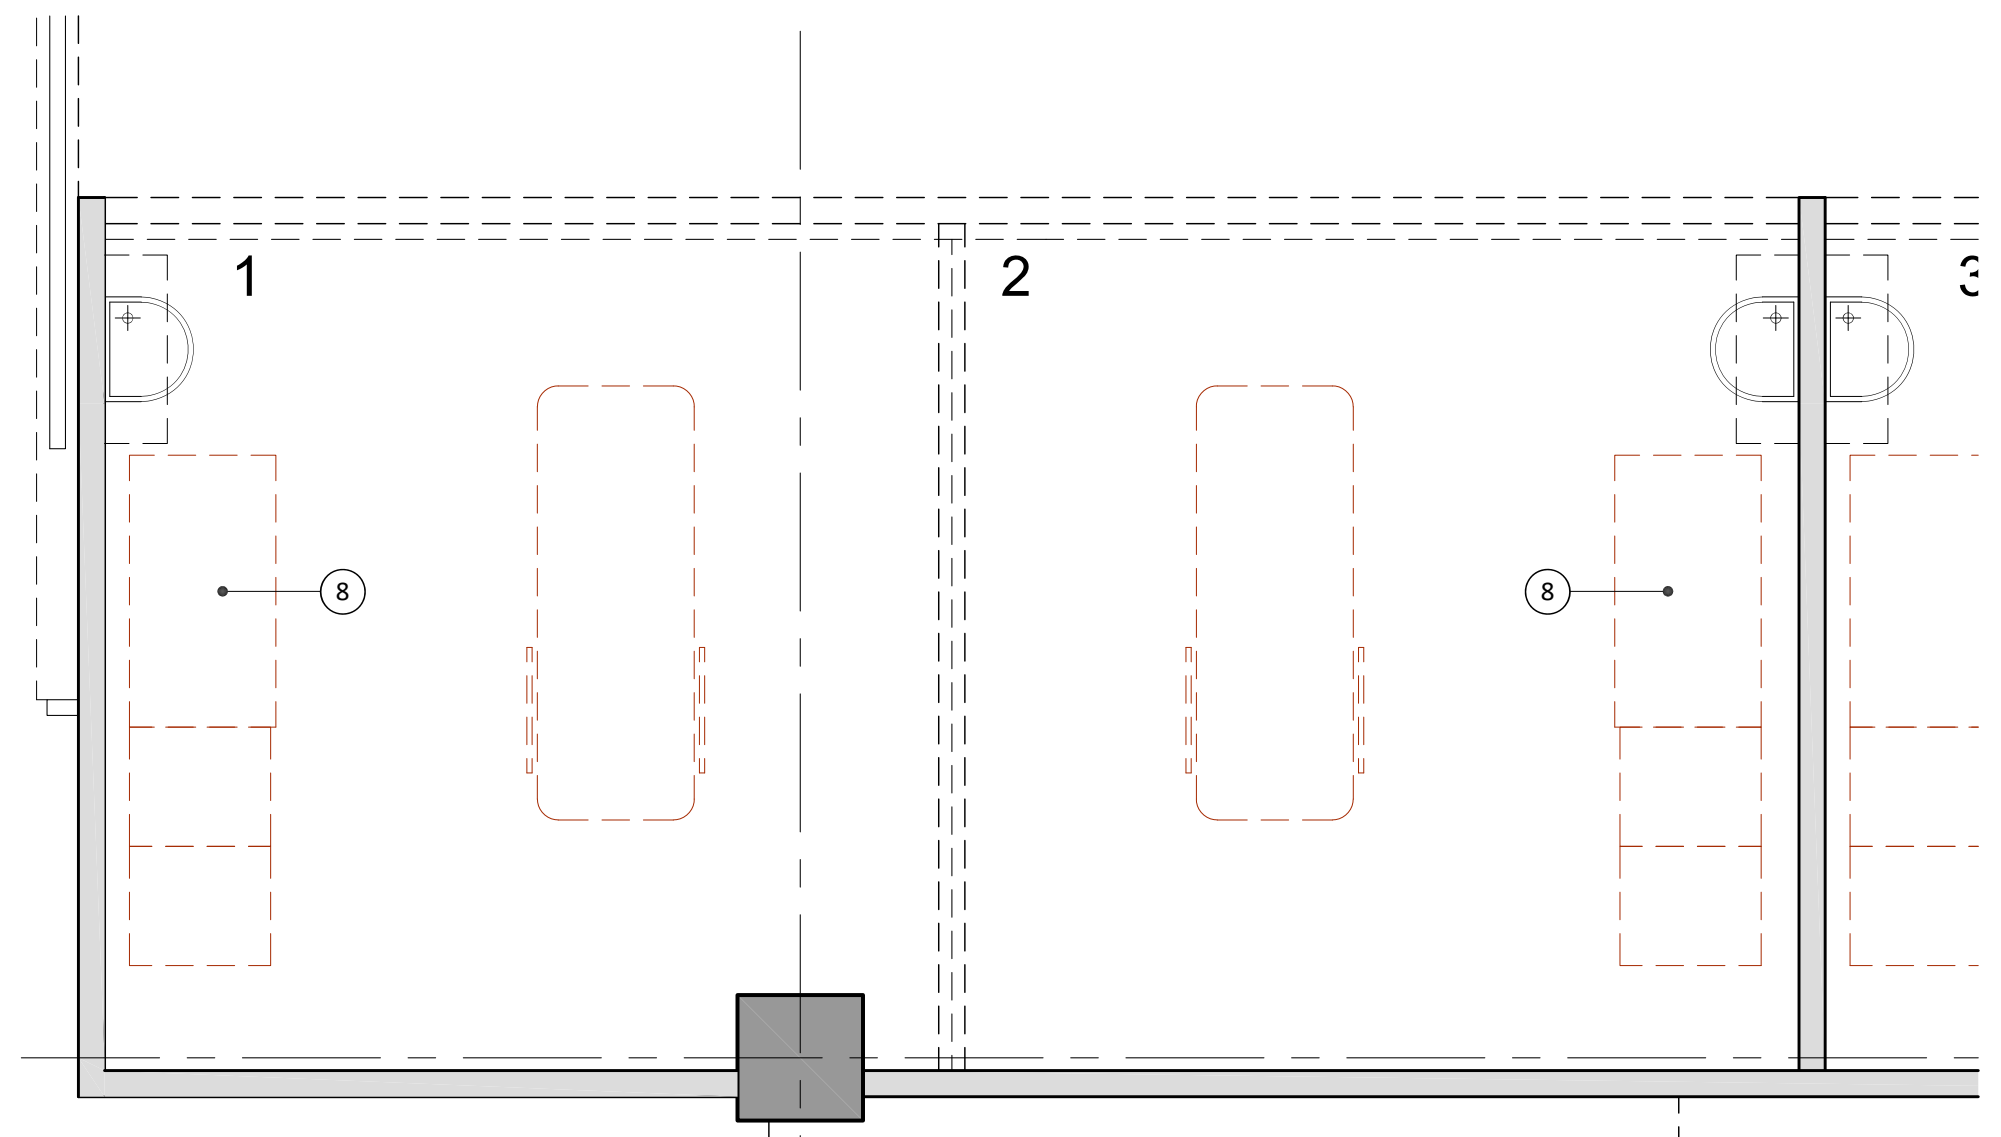

TYP. STABILIZATION CUBICLE LAYOUT BLOWUP
(SPACES 1-081, 1-086, 1-089, 1-091)

SCALE: 1/4"= 1'-0"

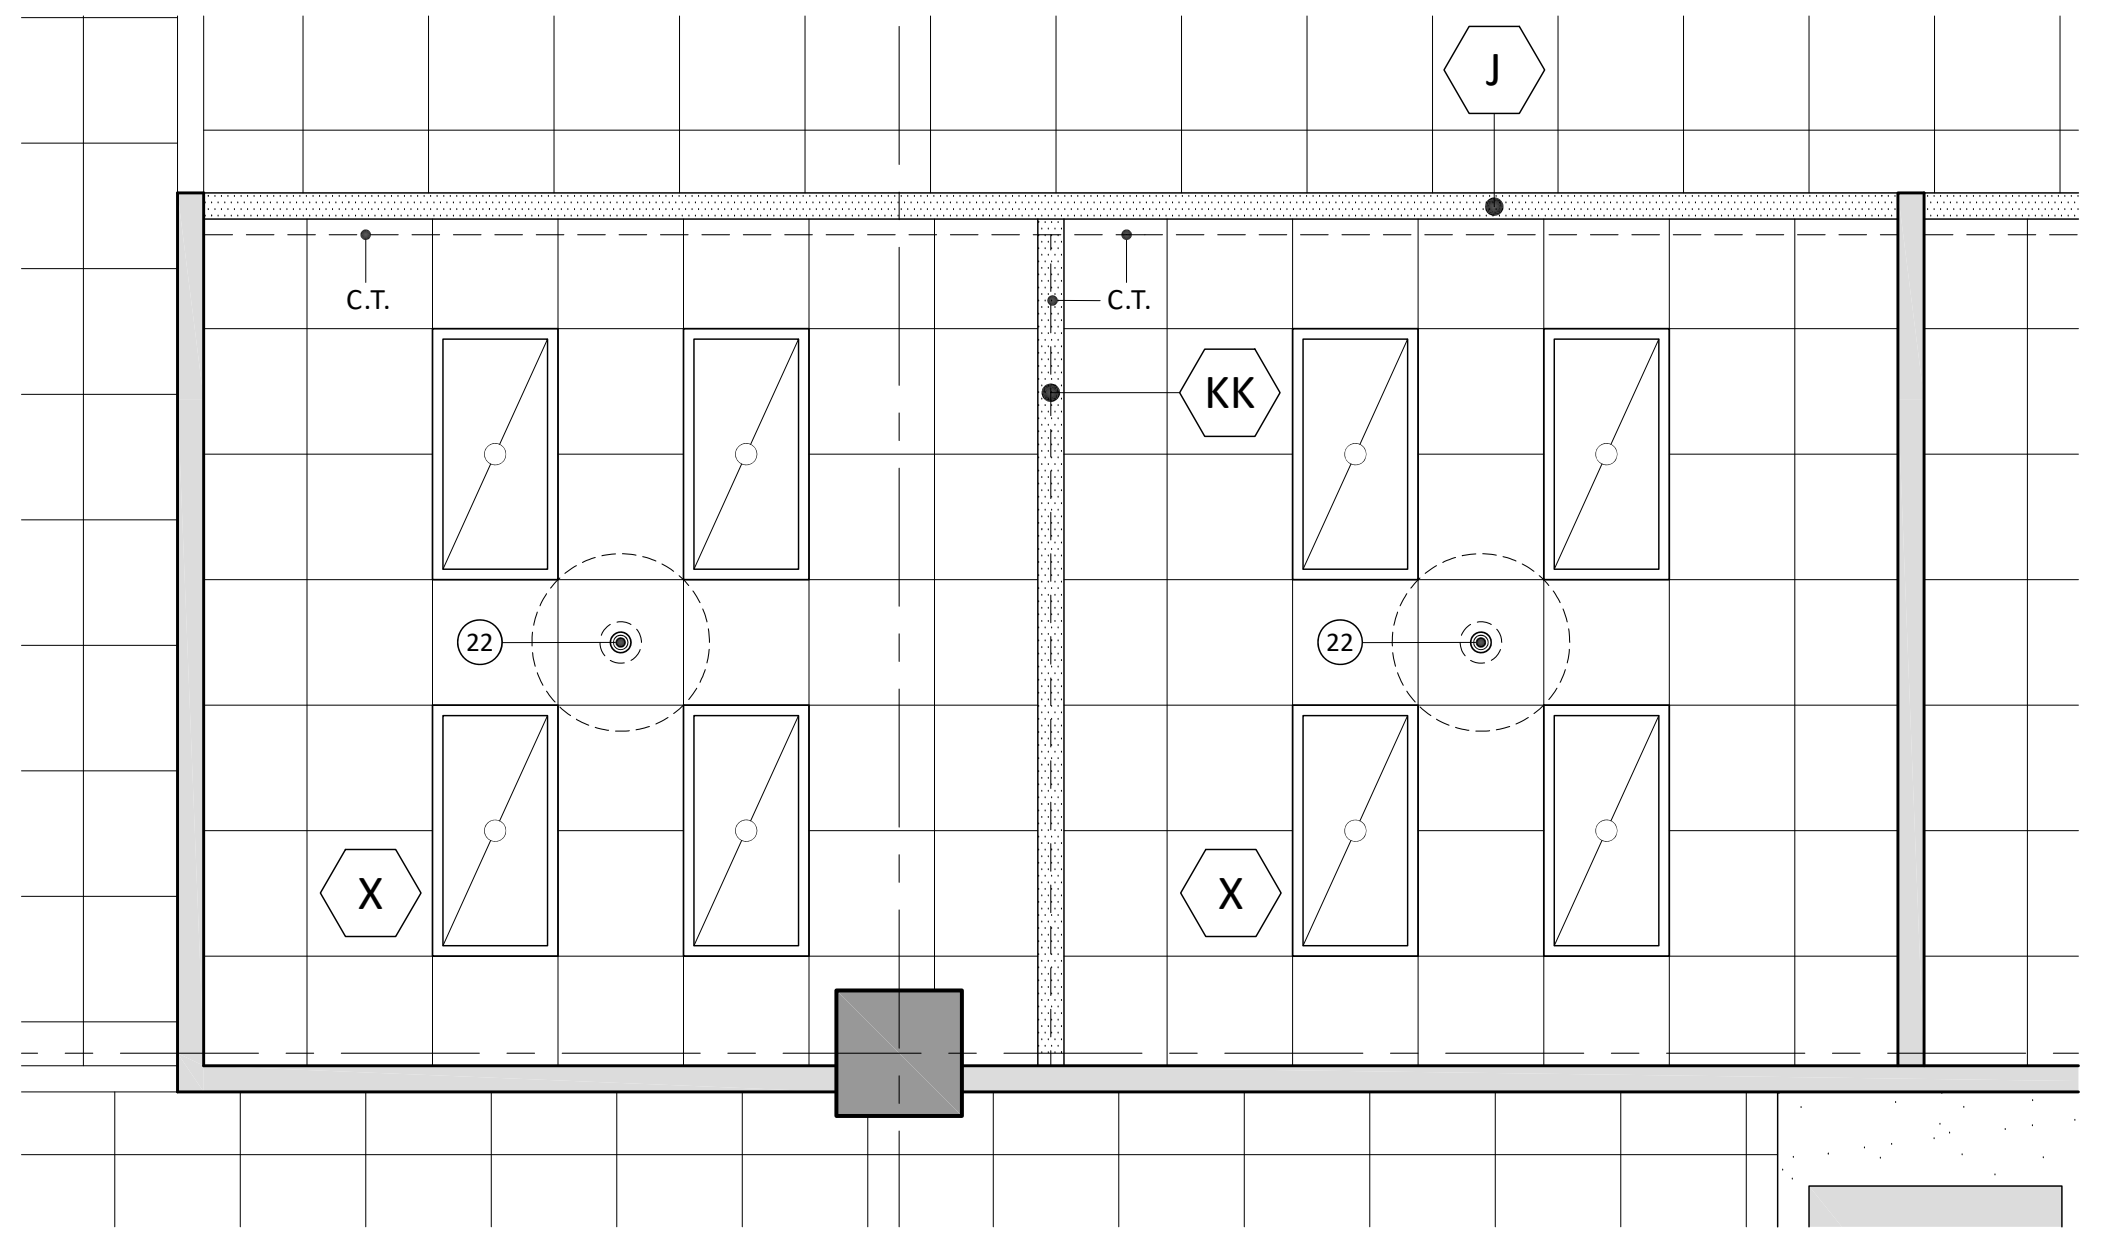

TYP. STABILIZATION CUBICLE CEILING PLAN BLOW-UP
(SPACES 1-081, 1-086, 1-089, 1-091)

SCALE: 1/4"= 1'-0"

## LEGEND:

| | |
|---|---|
| | SURGICAL LIGHTCENTROID LOCATION |
| | RECESSED CONE TYPE DOWN-LIGHT LED FIXTURE (OPERATING ROOM SEALED TYPE WHERE APPLICABLE ) |
| AD | 24" X 24" STAINLESS STEEL PLENUM ACCESS DOOR. SUSPENDED CLG. SHALL BE REINFORCED FOR REQUIRED FRAME. (SURGICAL ROOM GRADE) |
| | RECESSED 24" x 48" LED LIGHTING FIXTURE (OPERATING ROOM SEALED TYPE WHERE APPLICABLE ) |
| | OPERATING LAMP BASE PLATE & COLUMN |
| | 24" X 48" HEPA FILTER IN A/C ASSEMBLY |
| | LAMINAR FLOW LINEAR A/C DIFFUSER |
| | MEDICAL GASES SUPPLY CONNECTION BOX (PLENUM MOUNTED) TO BE FIELD LOCATED. SEE MECHANICAL DWGS. |
| | UTILITY SERVICE DOUBLE BOOM WITH STRUCTURAL SUPPORT HUNG BASE INSIDE PLENUM. |
| | RED DOTTED SYMBOLS DENOTE FURNITURE & EQUIPMENTS NOT IN CONTRACT |
| | BLUE SYMBOLS DENOTE MOVABLE MEDICAL PROCEDURE EQUIPMENTS NOT IN CONTRACT |
| | RECESSED 24" x 24" LED LIGHTING FIXTURE (OPERATING ROOM SEALED TYPE WHERE APPLICABLE ) |
| | PROCEDURE SURGICAL LAMP BASE PLATE & COLUMN |
| ----- | C.T. - CURTAIN TRACK |
| A | 5/8" SUSPENDED GYPSUM BOARD CEILING PAINTED @ 7'-6" A.F.F. |
| C | 5/8" MOISTURE RESISTANT OPERATING ROOM GYPSUM BOARD CEILING @ 9'-6" A.F.F. WITH WATER BASED EPOXY CLEAN ROOM PAINT FINISH. |
| J | 5/8" GYPSUM BOARD CEILING @ 8'-6" A.F.F. WITH WATER BASED EPOXY CLEAN ROOM PAINT FINISH. |
| U | 5/8" MOISTURE RESISTANT OPERATING ROOM GYPSUM BOARD CEILING @ 8'-6" A.F.F. WITH WATER BASED EPOXY CLEAN ROOM PAINT FINISH. |
| X | 24"X 24" SQUARE LAY-IN GASKETED CEILING TILES @ 9'-6" A.F.F. CLEAN ROOM TYPE MYLAR FINISH, INSTALLED ON REQUIRED CLEAN ROOM SUSPENSION SYSTEM ASSEMBLY. |
| KK | 5/8" GYPSUM BOARD CEILING SOFFIT @ 9'-6" A.F.F. WITH WATER BASED EPOXY CLEAN ROOM PAINT FINISH. |

## OPERATION ROOM EQUIPMENT DESCRIPTION LEGEND

| | |
|---|---|
| ① | SURGICAL O.R. THREE-LIGHT HEAD LAMP(CEILING MOUNTED) |
| ② | SURGICAL TABLE SYSTEM TO BE SUPPLIED BY OWNER & INSTALLED BY CONTRACTOR |
| (3A) | SURGICAL NAVIGATION SYS. TO BE SUPPLIED BY OWNER & INSTALLED BY CONTRACTOR |
| (3B) | SURGICAL NAVIGATION SYS. TO BE SUPPLIED BY OWNER & INSTALLED BY CONTRACTOR |
| ④ | O-ARM SURGICAL IMAGING SYSTEM TO BE SUPPLIED & INSTALLED BY OWNER |
| ⑤ | WORK STATION |
| ⑥ | COMPUTER WORK STATION |
| ⑦ | OPERATING ROOM LIGHTING CONTROL DIMMERS |
| ⑧ | AUTOMATED MEDICATION DISPENSING SYSTEM |
| ⑨ | RECORDING THERMOSTAT @ 6'-0" A.F.F. SEE MECHANICAL DRAWINGS. |
| ⑩ | WALL MOUNTED 46" LCD MONITOR |
| ⑪ | CLOCK AND ELAPSED TIME RECORDER @ 6'-6" A.F.F. |
| ⑫ | FILM VIEWER-N.I.C. |
| ⑬ | SURGICAL LIGHTING VARIABLE INTENSITY CONTROL @ 5'-0" A.F.F-N.I.C. |
| ⑭ | RECESSED OPERATING ROOM GRADE LED CONE LIGHTING FIXTURE |
| ⑮ | RECESSED 24" X 48" OPERATING ROOM GRADE LED LIGHTING FIXTURE |
| ⑯ | LAMINAR FLOW A/C DIFFUSER |
| ⑰ | HEPA FILTER ASSEMBLY 24" X 48" |
| ⑱ | 24" X 24" OPERATING ROOM GRADE STAINLESS STEEL PLENUM ACCESS HATCH |
| ⑲ | MEDICAL GASES FLOW METER BOX COLUMN (CEILING MOUNTED / STAINLESS STEEL ) WITH THE FOLLOWING CAPACITIES:<br>2 OXYGEN HOOKUP OUTLETS<br>2 VACUUM HOOKUP OUTLETS<br>1 NITROGEN HOOKUP OUTLET<br>1 NITROUS OXIDE HOOKUP OUTLET |
| ⑳ | MEDICAL GASES FLOW METER BOX (WALL MOUNTED / STAINLESS STEEL ) WITH THE FOLLOWING CAPACITIES:<br>1 OXYGEN HOOKUP OUTLETS<br>1 VACUUM HOOKUP OUTLETS<br>1 NITROUS OXIDE HOOKUP OUTLET<br>1 MEDICAL AIR HOOKUP OUTLET |
| ㉑ | MEDICAL GAS FLOW METER BOX (WALL MOUNTED / STAINLESS STEEL ) WITH THE FOLLOWING CAPACITY:<br>1 NITROGEN HOOKUP OUTLET |
| ㉒ | PROCEDURE LAMP TO BE SUPPLIED BY OWNER & INSTALLED BY CONTRACTOR |

## CEILING MOUNTED OPERATING ROOMS EQUIPMENT NOTES

(TYPICAL OPERATING CEILING EQUIPMENT MOUNTING ASSEMBLY REQUIREMENTS DETAILS)

APPLICABLE FOR ALL CEILING-MOUNTED SURGICAL LIGHTING FIXTURES & EQUIPMENT COLUMNS. STRUCTURAL SUPPORT AND MOUNTING ASSEMBLY SHALL BE FOR A RATED LOAD OF UP TO 450 LBS. INSTALLATION SHALL BE IN ACCORDANCE WITH THE FOLLOWING REQUIREMENTS:

1. APPLICABLE TO ALL CEILING MOUNTED EQUIPMENT LOCATIONS SHOWN IN THE DRAWINGS HEREIN WITH NUMBERS. ① ⑯ ⑰ ⑱ ⑲
2. PROVIDE A MINIMUM ⅝" THICK A36 STEEL MOUNTING PLATE (MINIMUM DIMENSIONS: 14" X 14") MECHANICALLY ANCHORED TO STRUCTURAL SLAB OR BEAM WITH FOUR (4) MINIMUM ⅝" DIAMETER HILTI KWIK BOLT TZ2 (OR APPROVED EQUAL) WITH MINIMUM 5" EMBEDMENT. TORQUE PER MANUFACTURER'S RECOMMENDATIONS.
3. SUSPEND FIXTURE SUPPORT USING FOUR (4) Ø1" ASTM A193 B7 FULLY THREADED RODS WITH HEAVY HEX NUTS AND LOCK WASHERS AT TOP AND BOTTOM. DOUBLE-NUT ALL CONNECTIONS AND TORQUE TO 90–100 FT-LBS.
4. INSTALL TWO (2) LATERAL BRACES MINIMUM, AT 45° ANGLE FROM SUSPENSION TO STRUCTURE, USING 2" X 2" X ¼" ANGLE IRON OR UNISTRUT WITH SEISMIC-RATED GUSSET PLATES. BRACES TO BE ATTACHED TO INDEPENDENT STRUCTURAL MEMBERS TO PREVENT.
5. ATTACH SURGICAL LIGHT MANUFACTURER'S INTERFACE PLATE TO ROD ASSEMBLY. LEVEL FIXTURE MOUNTING PLATE TO WITHIN ⅛". ENSURE BOLT PATTERNS ALIGN EXACTLY WITH FIXTURE BASE.
6. PROVIDE ESCUTCHEON OR SEALED RING AT CEILING PENETRATION FOR INFECTION CONTROL AND FIRE RATING. DO NOT ALLOW ANY FIXTURE LOAD TO BE TRANSFERRED TO CEILING GRID.
7. ELECTRICAL CONDUIT AND JUNCTION BOX SHALL BE MOUNTED ABOVE CEILING, ACCESSIBLE, AND SHALL ALLOW FOR FINAL FIXTURE ADJUSTMENT. COORDINATE ALL POWER AND CONTROL REQUIREMENTS WITH ELECTRICAL DRAWINGS AND FIXTURE MANUFACTURER.
8. CONTRACTOR SHALL SUBMIT INSTALLATION DRAWINGS AND OBTAIN APPROVAL FROM STRUCTURAL ENGINEER PRIOR TO FABRICATION OR INSTALLATION. FIELD-VERIFY CONDITIONS AND PROVIDE AS-BUILT DRAWINGS. PROVIDE INSTALLATION CERTIFICATION BY LICENSED STRUCTURAL ENGINEER STATING THE SYSTEM IS INSTALLED TO SAFELY SUPPORT A 450 LB SURGICAL LIGHT FIXTURE WITH MINIMUM 2.0 SAFETY FACTOR.
9. STRUCTURE ABOVE SHALL BE VERIFIED TO SUPPORT A MINIMUM LOAD OF 2,250 LBS (5X SAFETY FACTOR). COORDINATE WITH STRUCTURAL ENGINEER AND PROVIDE SUPPLEMENTAL FRAMING AS REQUIRED.

## SUPLEMENTARY EQUIPMENT NOTES:

(APPLICABLE TO ALL MEDICAL EQUIPMENT SUPPLIED BY THE OWNER)

1. PRIOR TO THE INSTALLATION OF ALL THE EQUIPMENT (SOC, SIN & SCC) SPECIFIED HEREIN, THE CONTRACTOR SHALL REQUEST FROM THE OWNER THE FINAL CONFIRMATION LIST OF THE EQUIPMENT WITH ALL THE ELECTRICAL & PLUMBING REQUIREMENTS.
2. ALL FURNITURE AND EQUIPMENT IDENTIFIED TO BE SUPPLIED BY THE OWNER AND INSTALLED BY THE CONTRACTOR (SOC) SHALL BE INSTALLED ACCORDINGLY BY THE CONTRACTOR IN COMPLIANCE WITH ALL THE UTILITIES (DRAIN, ELECTRICAL, WATER, EXHAUST, ETC.) INSTALLATION SPECIFICATION REQUIREMENTS OF THE MANUFACTURER.
3. ALL EQUIPMENT DEFINED AS SOC (SUPPLIED BY OWNER & INSTALLED BY CONTRACTOR) SHALL BE INSTALLED IN ACCORDANCE WITH ALL MANUFACTURER'S SPECIFICATIONS, REQUIREMENTS AND INSTALLATION PARAMETERS RELATED, BUT NOT LIMITED TO:
    1. BIOMEDICAL SUPPORT
    2. CALIBRATION
    3. INSTALLATION REQUIREMENTS
    4. START-UP
    5. UTILITIES HOOK-UPS
    6. TECHNICAL SUPPORT & GUIDANCE
    7. ASSEMBLY
    8. VALIDATION
4. CONTRACTOR SHALL EXECUTE THE WORK IN COORDINATION & BY SUB-CONTRACTING ALL REQUIRED OWNERS MEDICAL EQUIPMENT SPECIALISTS, SUPPLIERS & VENDOR'S.
5. WHERE APPLICABLE, WATER SUPPLY AND DRAIN REQUIREMENTS SHALL BE PROVIDED FOR ALL NEW AND EXISTING EQUIPMENTS, AND FOR FUTURE EQUIPMENT SHOWN HEREIN AS REQUIRED FOR PROPER EQUIPMENT OPERATION.
6. CONTRACTOR SHALL VERIFY THE DIMENSIONS OF ALL NEW AND EXISTING EQUIPMENTS PRIOR TO THE CONSTRUCTION OF INSTALLATION OPENINGS & UTILITIES SUPPLIES.
7. WHERE APPLICABLE, CONTRACTOR SHALL PROVIDE ALL WATER AND DRAIN UTILITIES REQUIREMTNS FOR NEW AND EXISTING REPROCESSING SINK BAYS.
8. WHERE APPLICABLE, ALL EQUIPMENT SPECIFIED IN THE LEGEND HEREIN THAT REQUIRE WATER AND DRAIN UTILITIES ,SHALL BE INSTALLED AS INSTRUCTED IN THE PLUMBING DRAWINGS AND/OR AS REQUIRED, WITH ALL THE FIXTURES AND FITTINGS, TO THE PROPOSED WATER AND DRAIN UTILITY LINES. INSTALLATION SHALL BE EXECUTED AND CERTIFIED, FOR PROPER OPERATION, BY A LICENCED MASTER PLUMBER.

## OPERATING ROOMS EQUIPMENT NOTES:

1. CONTRACTOR SHALL SUPPLY & INSTALL ALL SURGICAL LAMPS & UTILITY SERVICE BOOMS STRUCTURAL SUPPORT INSIDE THE PLENUM AS REQUIRED BY THE EQUIPMENT MANUFACTURER'S INSTALLATION GUIDELINES. THE STRUCTURAL SUPPORT SHALL BE IN ACCORDANCE WITH BUILDING CODE REQUIREMENTS (INCLUDING SEISMIC REQUIREMENTS) & CERTIFIED BY A CONTRACTOR RETAINED STRUCTURAL ENGINEER.
2. LED SURGICAL LAMP WILL BE SUPPLIED BY OWNER & INSTALLED BY CONTRACTOR.
3. ALL STRUCTURAL SUPPORT FOR SURGICAL LED LAMPS & UTILITY SERVICE EQUIPMENT BOOM SHALL HAVE THE REQUIRED APPLIED LOAD CAPACITY SPECIFIED BY THE MANUFACTURER.

## WORK BY OWNER:

1. ALL CABLING, HARDWARE AND SOFTWARE RELATED TO THE VOICE COMMUNICATION SYSTEM, INFORMATION TECHNOLOGY SYSTEM, CLOSED CIRCUIT TV SYSTEM AND ELECTRONIC ACCESS CONTROL SYSTEM WILL BE SUPPLIED AND INSTALLED BY EACH OF THE SYSTEMS OWNER'S SUBCONTRACTORS.

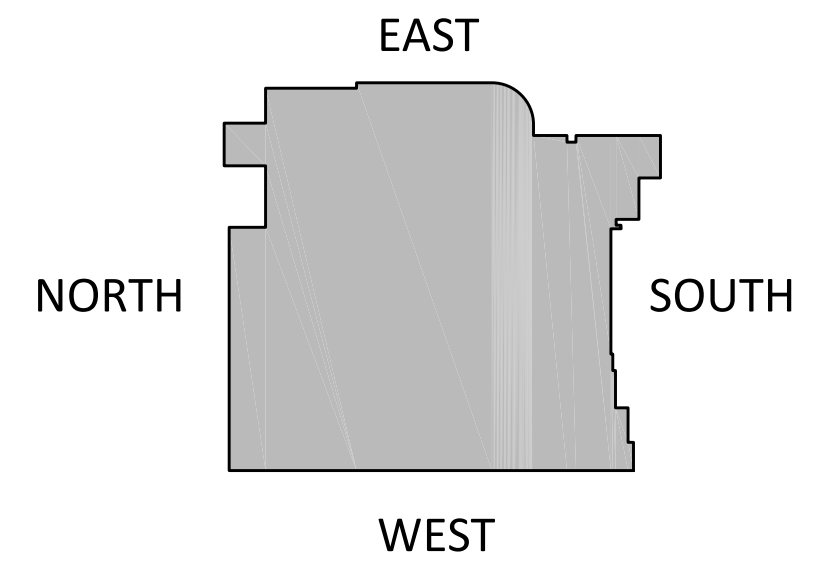

PROJECT REFERENCE ORIENTATION KEY PLAN

NOT TO SCALE

NOTES:

- DESIGN-BUILD BRIDGING DOCUMENTS.
  NOT FOR CONSTRUCTION.

DATE: JULY 2026
DRAWN BY:
APROVED BY:
SCALE: AS SHOWN

BID SET
SEP. 02,2026
F&R
Construction
Group,Inc

THESE DOCUMENTS HAVE BEEN PREPARED SOLELY FOR THE PURPOSE OF ESTABLISHING THE OWNER'S PROGRAMMATIC REQUIREMENTS, FUNCTIONAL OBJECTIVES, DESIGN INTENT, PERFORMANCE CRITERIA, AND TECHNICAL BASIS OF DESIGN FOR USE IN THE DESIGN-BUILD PROCUREMENT PROCESS. THESE DOCUMENTS ARE NOT CONSTRUCTION DOCUMENTS AND SHALL NOT BE USED FOR PERMITTING, BIDDING, FABRICATION, PROCUREMENT, CONSTRUCTION, OR ANY OTHER PURPOSE EXCEPT AS REFERENCE DESIGN GUIDANCE FOR THE DESIGN-BUILD ENTITY.THE SELECTED DESIGN-BUILD ENTITY, THROUGH ITS DULY LICENSED ARCHITECT AND ENGINEER(S) OF RECORD, SHALL BE SOLELY RESPONSIBLE FOR THE DEVELOPMENT, COORDINATION, COMPLETENESS, ACCURACY, CODE COMPLIANCE, PERMITTING, AND PREPARATION OF ALL FINAL DESIGN, ENGINEERING, PROCUREMENT, AND CONSTRUCTION DOCUMENTS REQUIRED FOR THE EXECUTION OF THE PROJECT. THE DESIGN-BUILD ENTITY SHALL INDEPENDENTLY VERIFY ALL EXISTING CONDITIONS, DIMENSIONS, QUANTITIES, DESIGN CRITERIA, AND TECHNICAL INFORMATION CONTAINED HEREIN AND SHALL NOT RELY UPON THESE DOCUMENTS AS FINAL DESIGN OR CONSTRUCTION DOCUMENTS. USE OF THESE DOCUMENTS FOR CONSTRUCTION PURPOSES IS STRICTLY PROHIBITED.

| NO. | DATE | DESCRIPTIONS |
|---|---|---|
| | | |
| | | |
| | | |

THESE DOCUMENTS ARE INSTRUMENTS OF SERVICE PREPARED BY DE LA TORRE-ESTÉVEZ ARCHITECTS AND ARE PROTECTED BY COPYRIGHT LAW. ALL RIGHTS ARE RESERVED. THESE DOCUMENTS ARE ISSUED SOLELY FOR USE IN CONNECTION WITH THIS PROJECT AND MAY BE USED ONLY BY PERSONS OR ENTITIES SPECIFICALLY AUTHORIZED BY DE LA TORRE-ESTÉVEZ ARCHITECTS. NO REPRODUCTION, DISTRIBUTION, DISCLOSURE, MODIFICATION, RELIANCE, OR REUSE OF THESE DOCUMENTS, IN WHOLE OR IN PART, IS PERMITTED WITHOUT PRIOR WRITTEN CONSENT OF DE LA TORRE-ESTÉVEZ ARCHITECTS. UNAUTHORIZED USE OF THESE DOCUMENTS SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO DE LA TORRE-ESTÉVEZ ARCHITECTS.

PROJECT:
PUERTO RICO TRAUMA HOSPITAL
PUERTO RICO MEDICAL CENTER
SAN JUAN, PUERTO RICO

SHEET TITLE:
OPERATING ROOM EQUIPMENT LIST

**DE LA TORRE - ESTEVEZ**
**ARCHITECTS PLANNERS**
URB. CARIBE 1590 AVE.PONCE DE LEON, STE 105 SAN JUAN PR 00926

DRAWING NUMBER
A-1.2A