



Predeclared missing-modality stress test

Accuracy

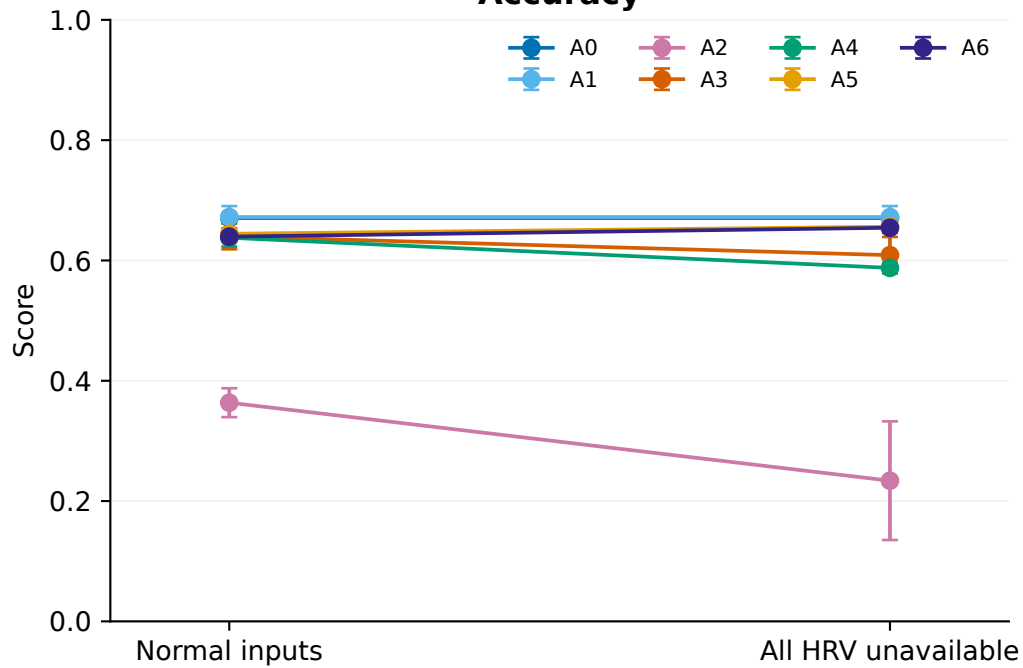

Macro-F1

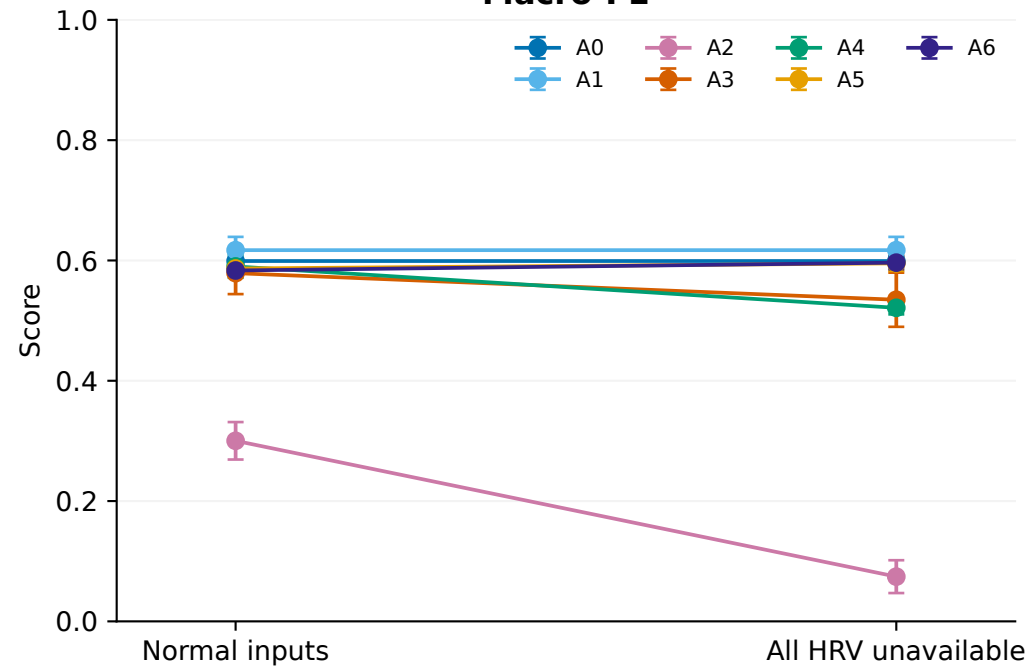

HRV values set to neutral; missing flags set to 1; all quality indicators set to 0. EEG inputs are unchanged.