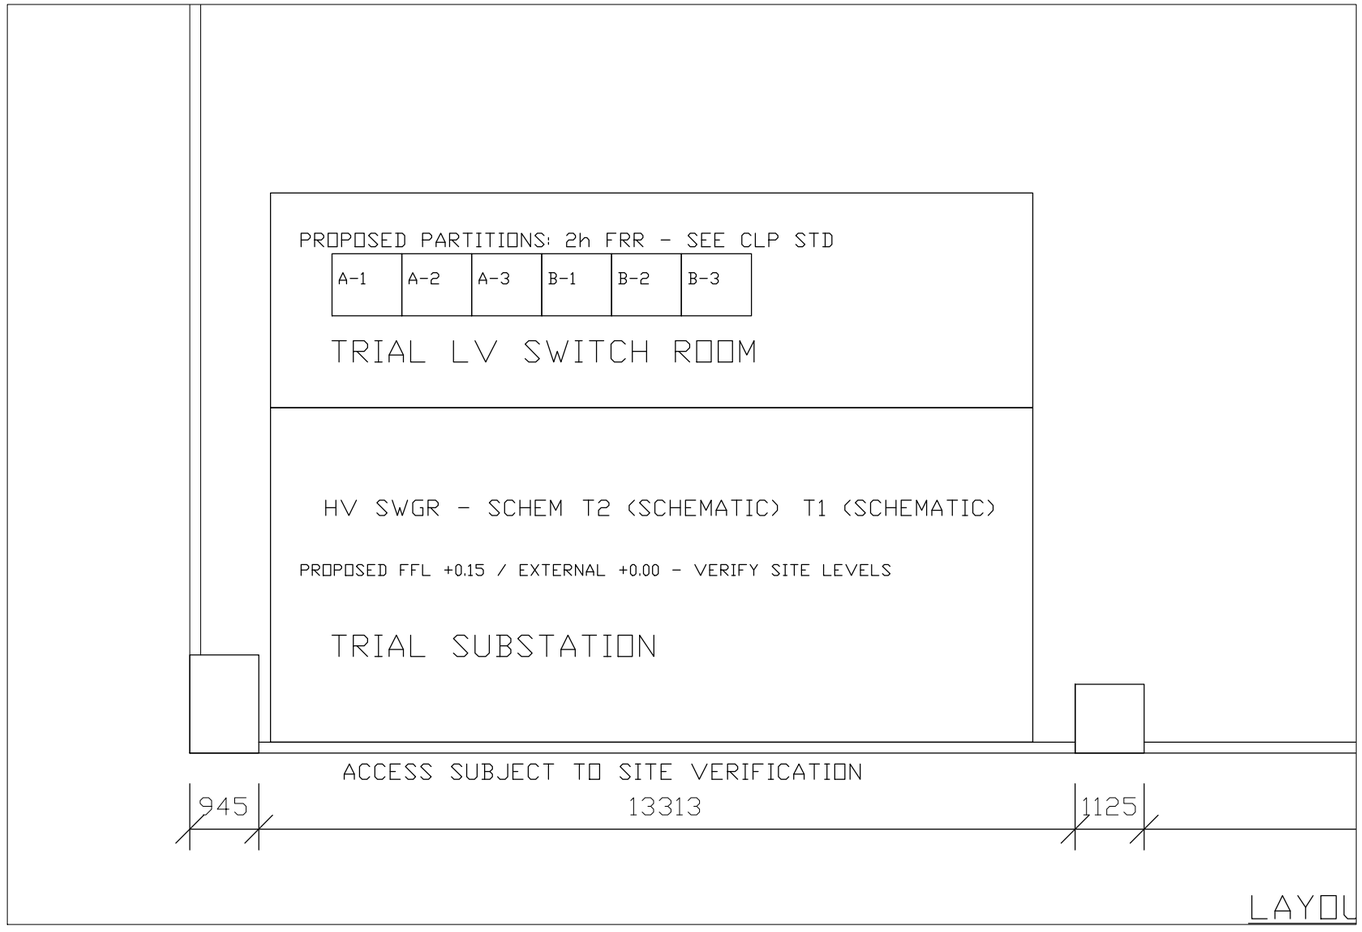
PROPOSED PARTITIONS: 2h FRR - SEE CLP STD
A-1
A-2
A-3
B-1
B-2
B-3
TRIAL LV SWITCH ROOM
HV SWGR - SCHEM T2 (SCHEMATIC) T1 (SCHEMATIC)
PROPOSED FFL +0.15 / EXTERNAL +0.00 - VERIFY SITE LEVELS
TRIAL SUBSTATION
ACCESS SUBJECT TO SITE VERIFICATION
945
13313
1125
LAYOU