
TASK 2 | OFFICE 1 NORMAL POWER

A3 PORTRAIT | SCALE 1:75 | DIMENSIONS IN mm | DB-O1

Full MS-O1-to-DB route: see incoming-route and ring-detail sheet.

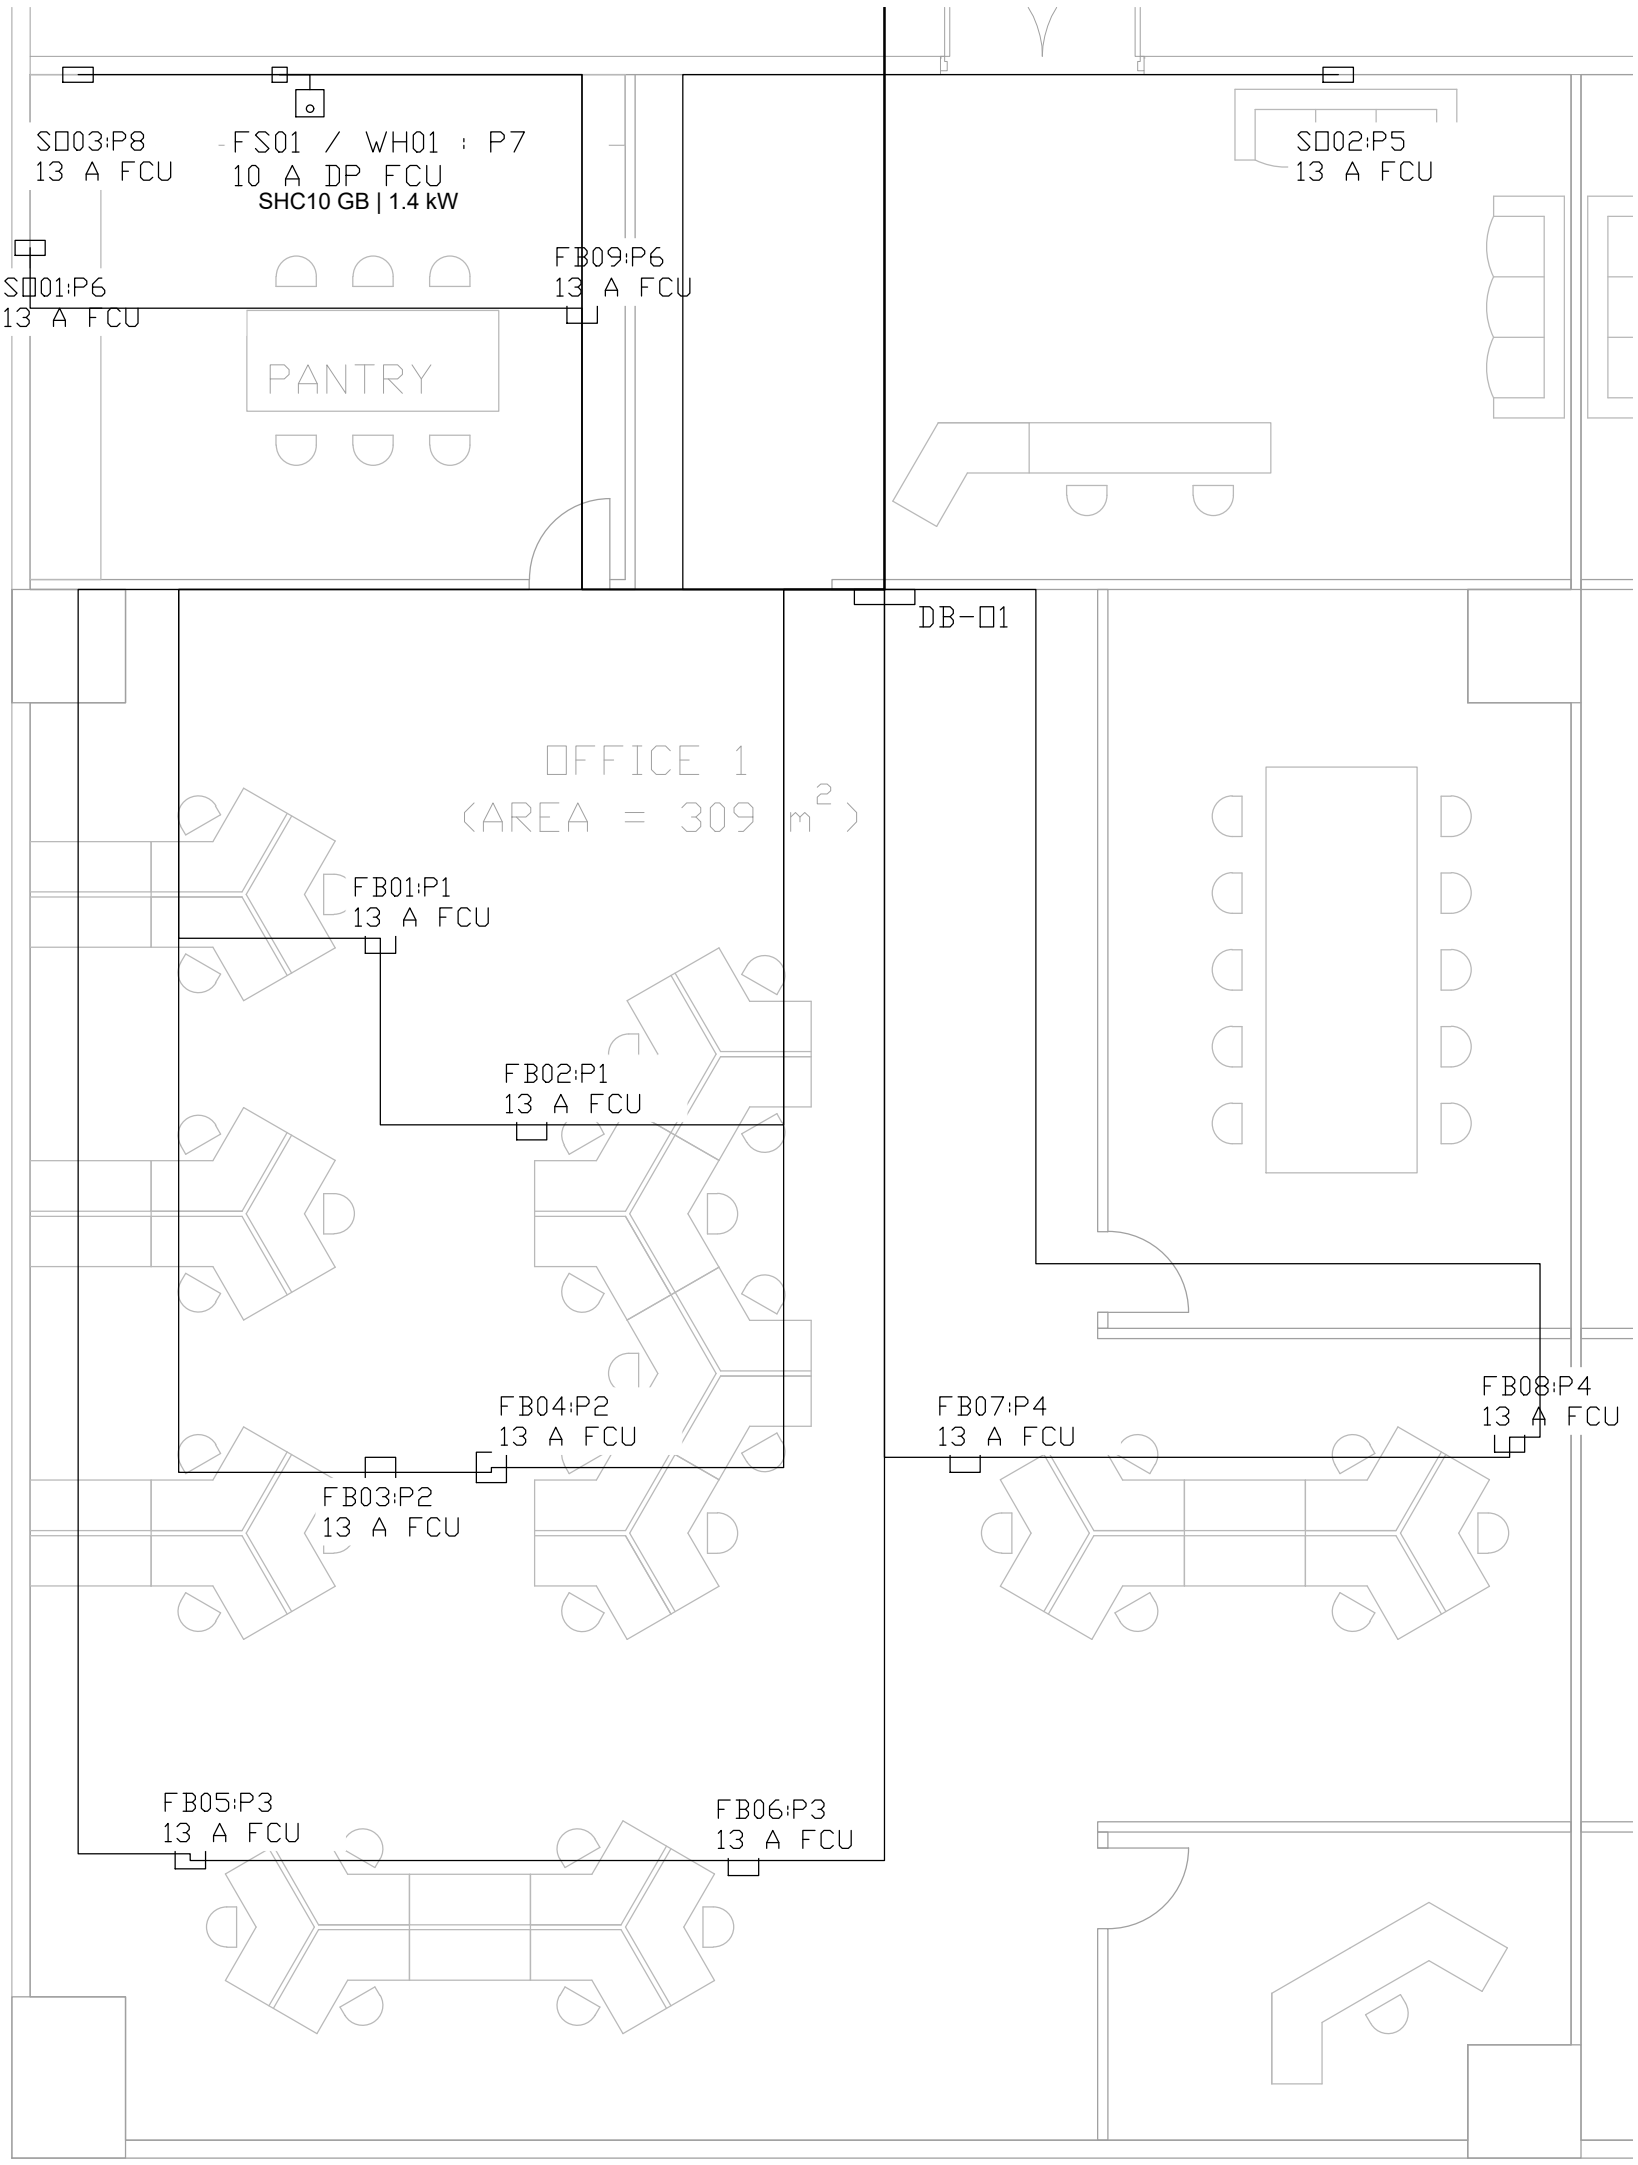

FB01-09=floorbox; SO01-03=twin socket; FS01=WH01 heater connection assembly.

Socket assemblies:13 A FCU each. WH01:10 A DP FCU. Local spur4 mm2,0.5m allowance.

P1 L1 RING B32 6 mm2 28.620m

P2 L1 RING B32 6 mm2 35.520m

P3 L2 RING B32 6 mm2 45.220m

P4 L2 RING B32 6 mm2 34.220m

P5 L1 RADIAL B32 10 mm2 15.607m

P6 L3 RADIAL B32 10 mm2 13.864m

P7 L3 RADIAL B10 4 mm2 13.107m | WH01 6.364A

P8 L3 RADIAL B32 10 mm2 15.107m

Ring L/N/CPC both ends return to same circuit. Radial L/N/CPC same stated size.

WH01: SHC10 GB Eltron235232, 1.4kW/220V; FS01 on P7 with B10 +10A DP FCU.

Containment: rings P1/P2 bank A; P3/P4 bank B; radials P5/P6/P8 bank C; P7 separate.

Individually fused point assemblies and terminals must accept selected conductor size or rated junctions.

Proposed routes follow plan; vertical/tail allowances and conditions are in Task3. Architecture retained as reference.

BSE3124 | 2026-11-07 | Read with15-way DB schematic and common circuit schedule