STEPPED OUTER SLEEVE JOINT CANDIDATE

Actual saved material section / cropped context / 1:2

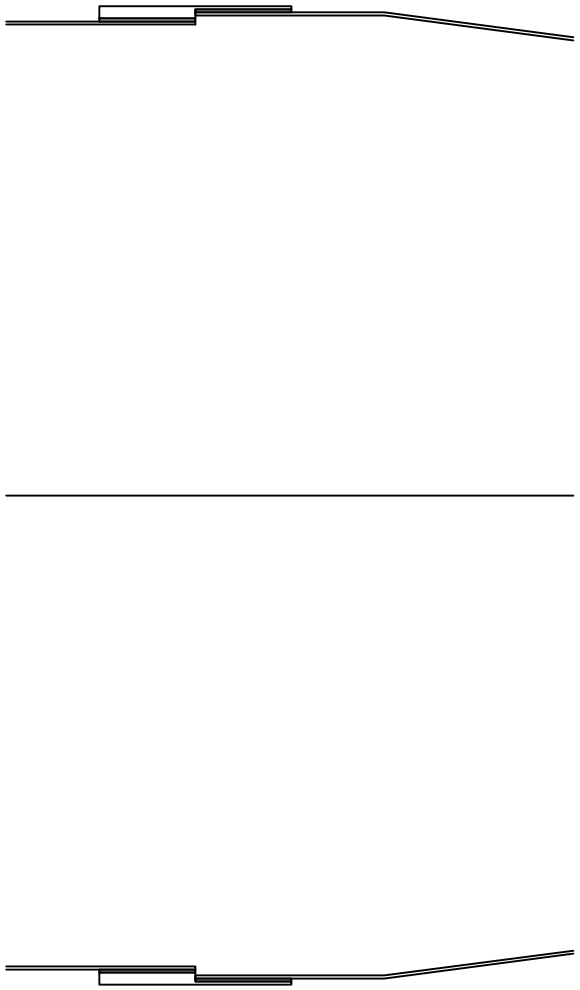

PROPOSED CUSTOM JOINT / NOT APPROVED

Existing collar OD:250.825mm

Existing reducer ID/OD:254/255.6mm

Candidate sleeve OD:258.8mm

Overlap each side:25.4mm assumed

Bondline proxy:0.8mm assumed

Minimum sleeve wall:0.8mm assumed

Upstream sleeve wall:3.1875mm

Contours:sleeve and bondline proxies

Centre line:reference flow axis

Original bodies and ports retained

Mechanical fasteners not modelled

Cure,shrinkage and adhesion unverified

No airtightness or pressure acceptance

Metal method is not UL181 closure

20mm reference

Bondline dimensions are design proxies,not manufacturer specified cured thickness.