VAV EQUIPMENT SPACE STUDY

Solid: network and casing | Dashed: inlet and both-side access reservation

20 candidate units | nominal inlet12/14in | scale1:200

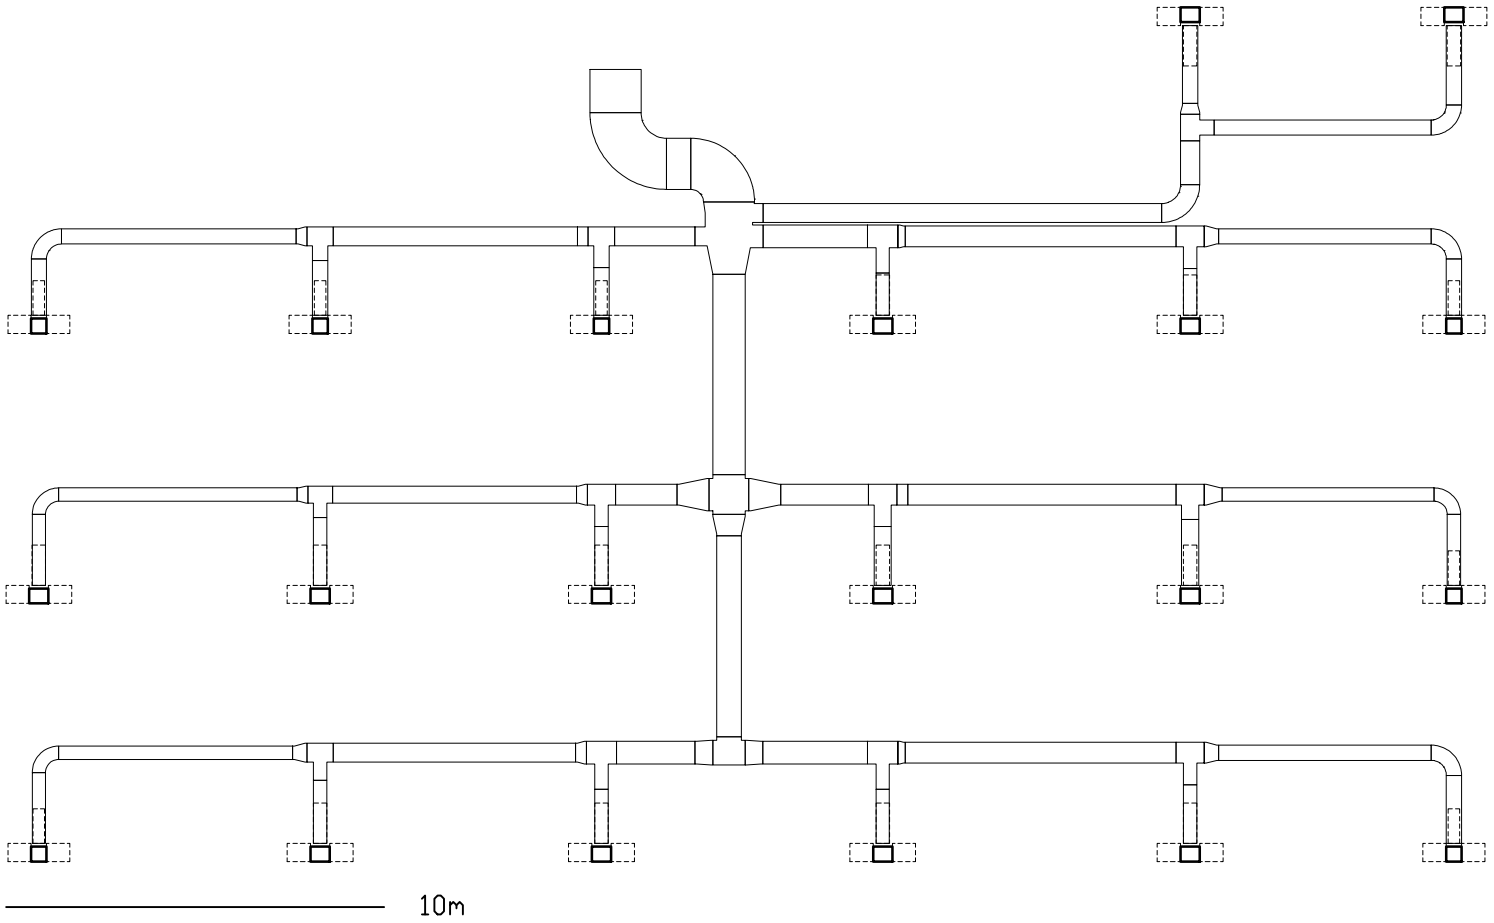

Inlet datum and z=0 are study assumptions; no connected equipment or installation acceptance

20 upstream duct replacements required; architecture, plenums, flex and full pressure unresolved