

Connection of the wired I/O from field device to DCS (Traditional wiring)



Field Devices /
End-point devices
(in the process)

Field Box
(nearby the devices to be connected)


I/O-Cabinet (electrical or automation room / cross connection room)






Device cable
usually 2-pair (depending on the
device/amount of signals
(JAMAK/NOMAK))

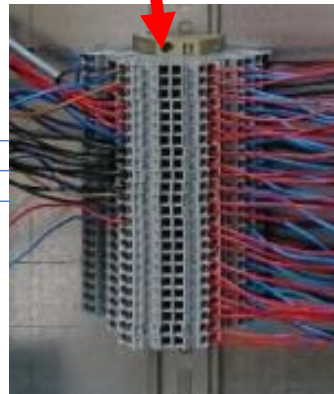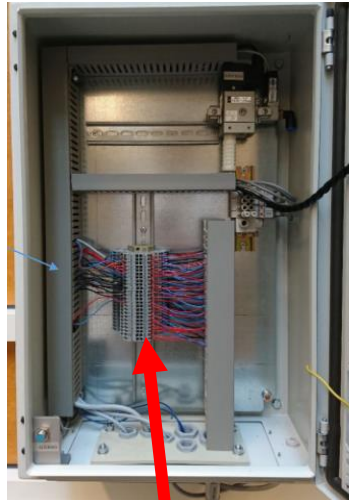

Cross connection

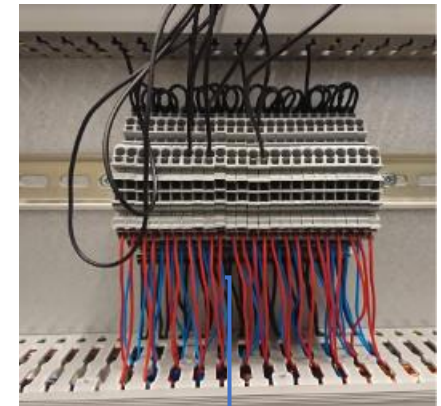

Trunk cable
usually 24-pair instrumentation cable
(JAMAK/NOMAK)

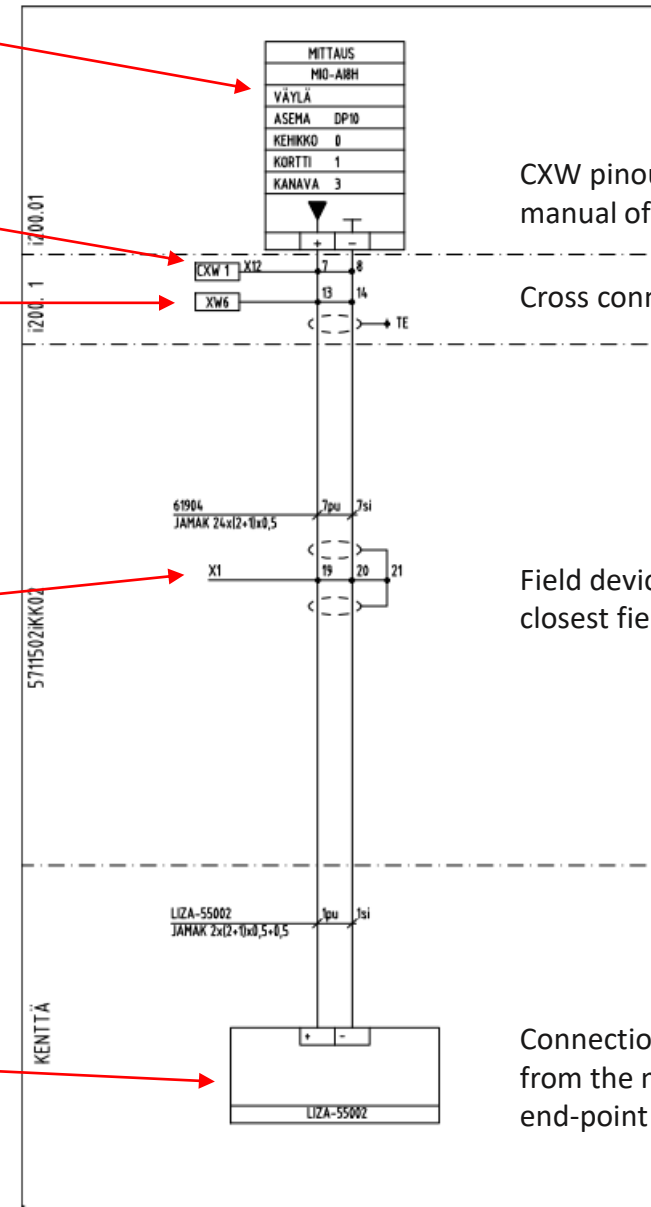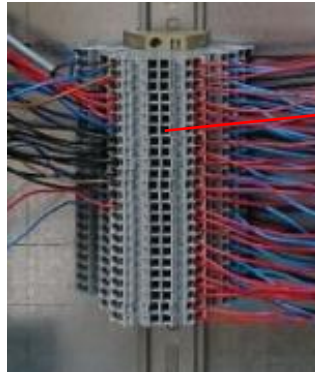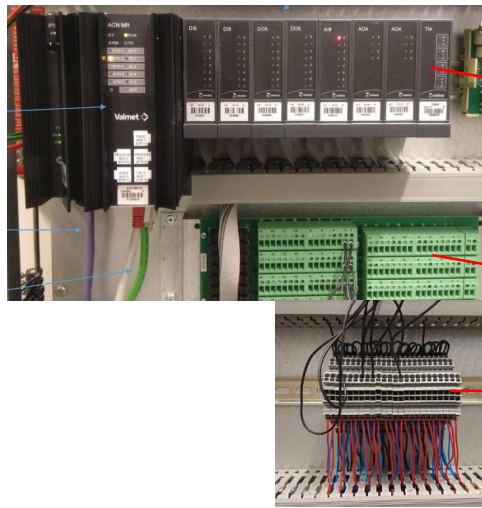

CXW pinout can be found from the manual of the I/O-module

Cross connection

Field devices are usually connected to closest field cabinet

Connection information can be found from the manual of the field device / end-point device