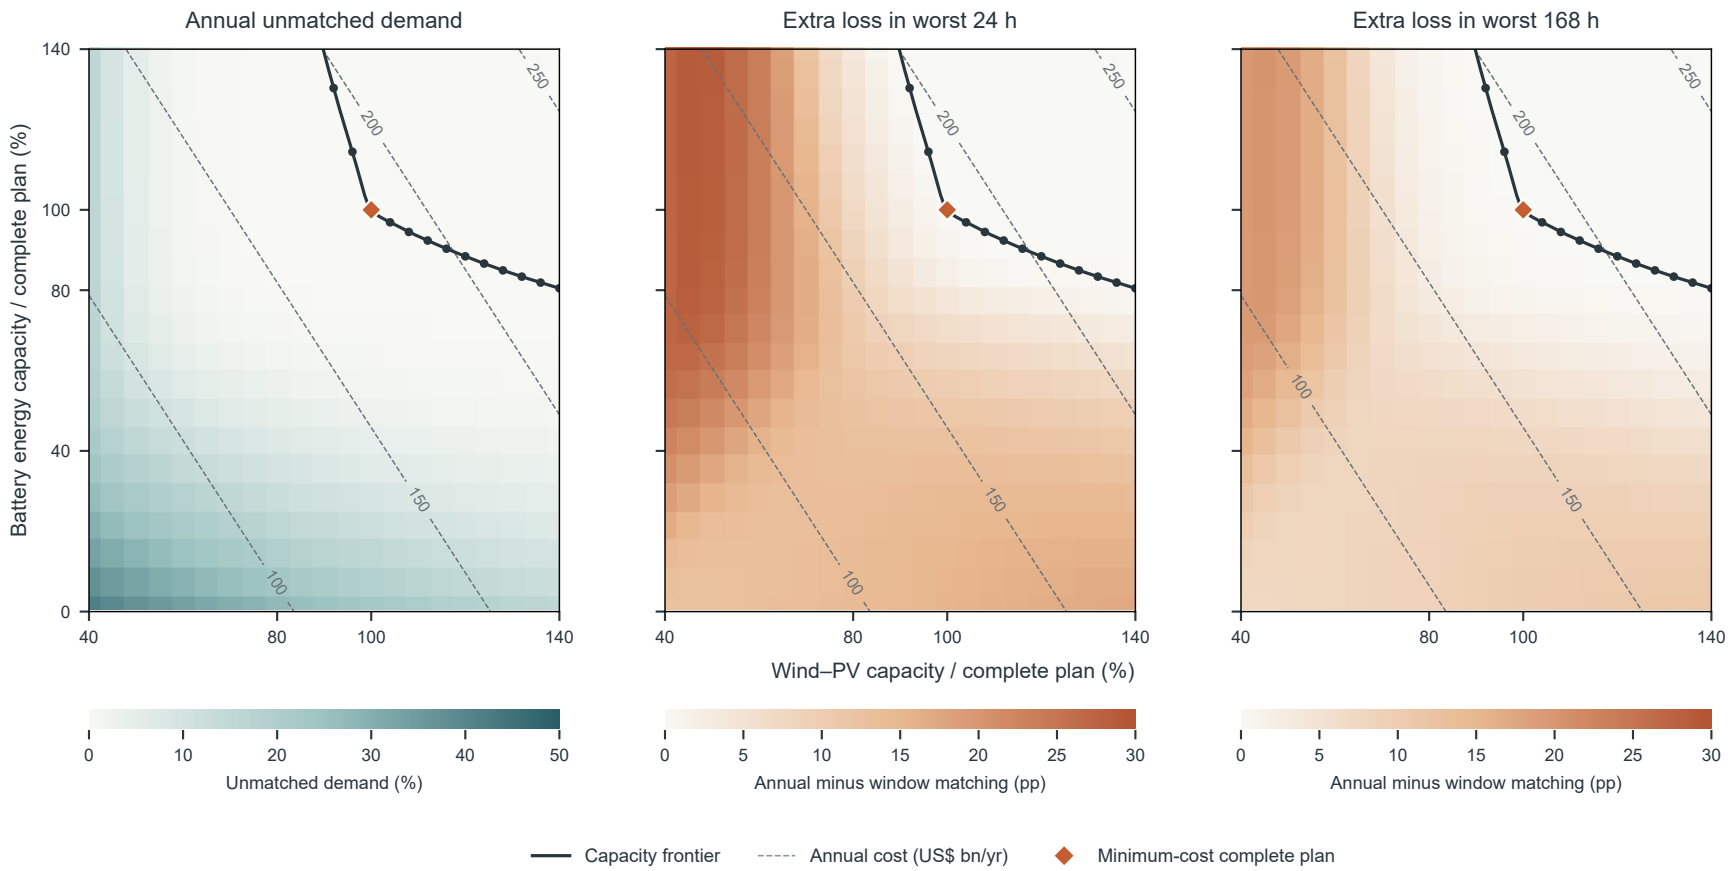
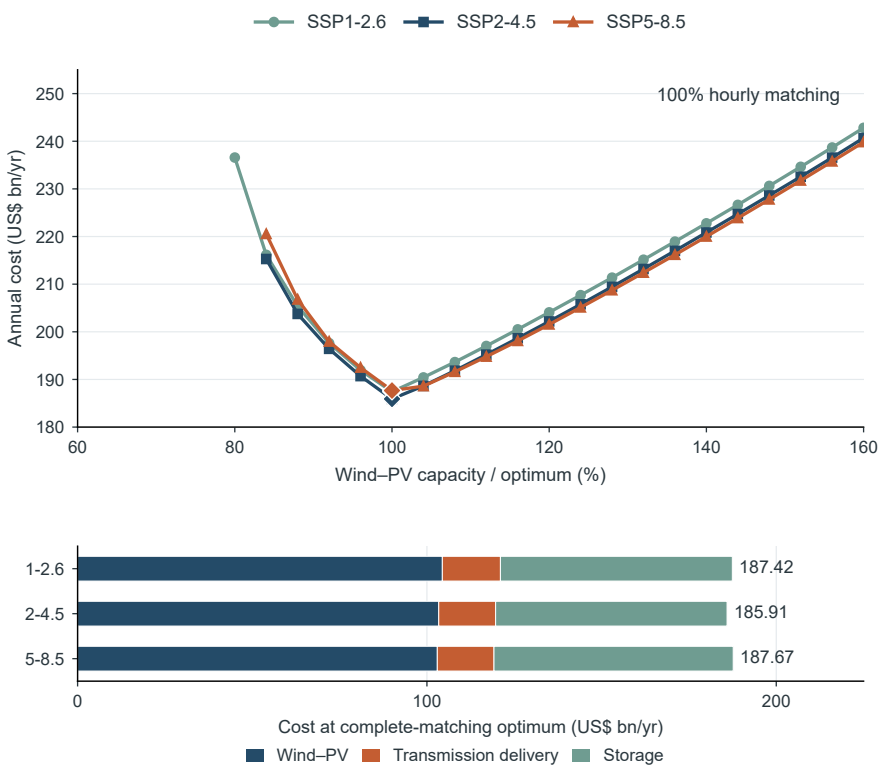
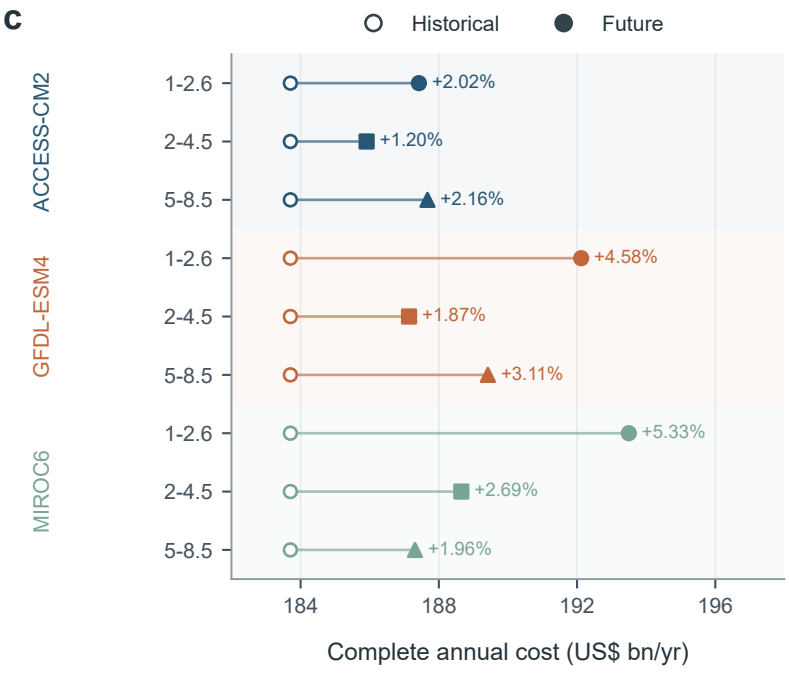
a


Annual unmatched demand
Extra loss in worst 24 h
Extra loss in worst 168 h
Battery energy capacity / complete plan (%)
Wind–PV capacity / complete plan (%)
Unmatched demand (%)
Annual minus window matching (pp)
Annual minus window matching (pp)
Capacity frontier
Annual cost (US$ bn/yr)
Minimum-cost complete plan


b


SSP1-2.6
SSP2-4.5
SSP5-8.5
100% hourly matching
Annual cost (US$ bn/yr)
Wind–PV capacity / optimum (%)
1-2.6
2-4.5
5-8.5
187.42
185.91
187.67
Cost at complete-matching optimum (US$ bn/yr)
Wind–PV
Transmission delivery
Storage


c


Historical
Future
ACCESS-CM2
GFDL-ESM4
MIROC6
1-2.6
2-4.5
5-8.5
+2.02%
+1.20%
+2.16%
+4.58%
+1.87%
+3.11%
+5.33%
+2.69%
+1.96%
Complete annual cost (US$ bn/yr)


d

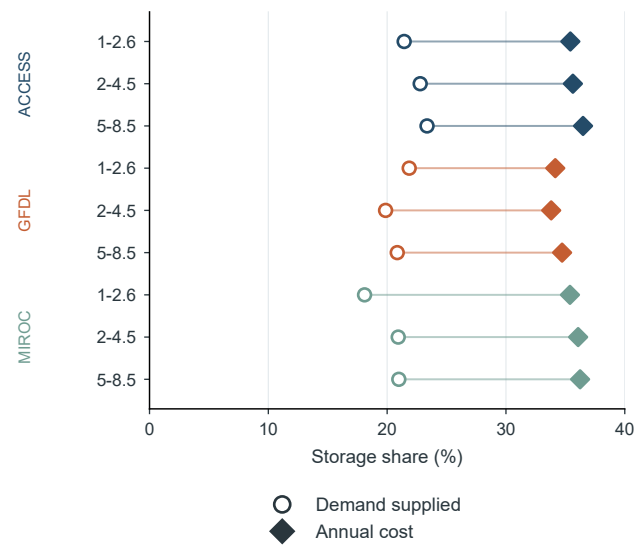
ACCESS
GFDL
MIROC
1-2.6
2-4.5
5-8.5
Storage share (%)
Demand supplied
Annual cost

e

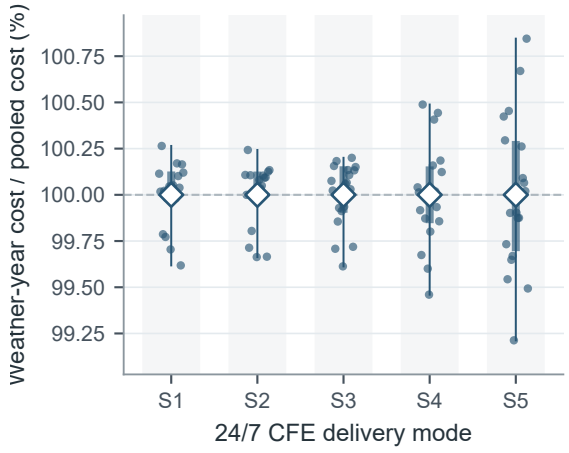
Weather-year cost / pooled cost (%)
S1
S2
S3
S4
S5
24/7 CFE delivery mode

f

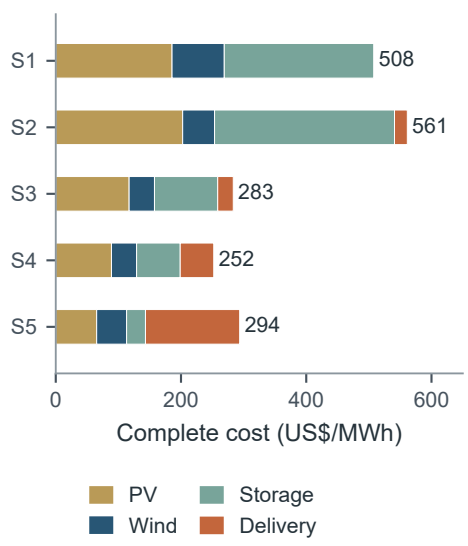
S1
S2
S3
S4
S5
508
561
283
252
294
Complete cost (US$/MWh)
PV
Storage
Wind
Delivery