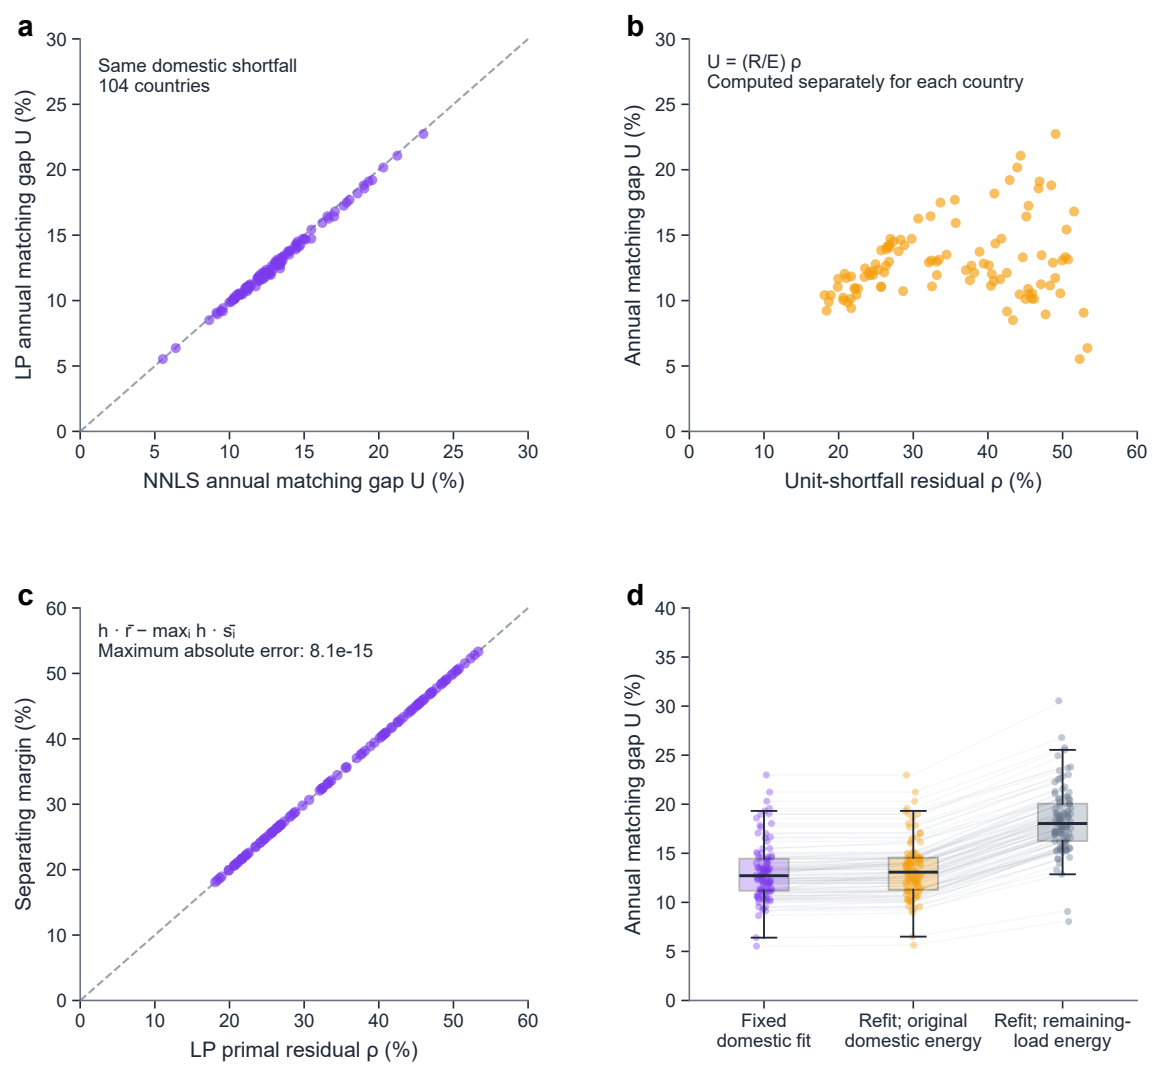
a
Same domestic shortfall
104 countries
LP annual matching gap U (%)
NNLS annual matching gap U (%)
b
U = (R/E) ρ
Computed separately for each country
Annual matching gap U (%)
Unit-shortfall residual ρ (%)
c
h · r̄ − maxᵢ h · sᵢ
Maximum absolute error: 8.1e-15
Separating margin (%)
LP primal residual ρ (%)
d
Annual matching gap U (%)
Fixed domestic fit
Refit; original domestic energy
Refit; remaining-load energy