
# Hy-Lok 105 Series

## High Pressure Ball Valves


Catalog No. H-105BV Apr. 2003




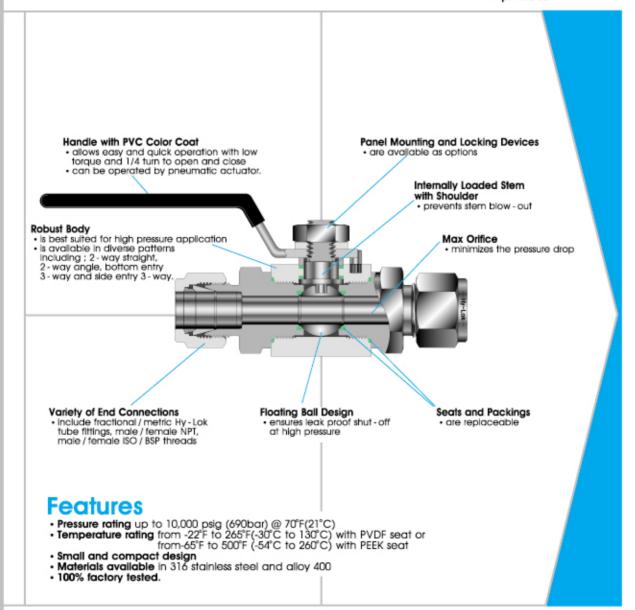


**HY-LOK CORPORATION** 

## 2-Way



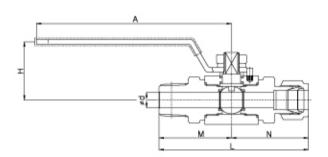


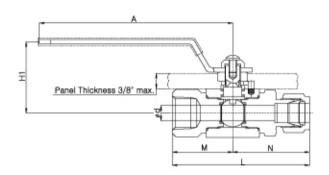

## **Table of Dimensions**

| Dania          | Dort No.  | Orifica | Cv   | End Connections | d                   |      |      | Dime  | ensions |       |      |      |
|----------------|-----------|---------|------|-----------------|---------------------|------|------|-------|---------|-------|------|------|
| Basic Part No. |           | Orifice | CV   | Inlet & Outlet  | inlet & Outlet Min. |      | N    | L     | Н       | Α     | H1   | S    |
|                | - H - 4 T |         | 1.2  | 1/4" Hy-Lok     | 4.8                 | 45.8 | 45.8 | 91.6  |         |       |      | 32.0 |
|                | -H-6T     |         | 3.7  | 3/8" Hy-Lok     | 7.11                | 47.3 | 47.3 | 94.6  |         | 126.5 |      |      |
|                | - H - 8 T |         |      | 1/2" Hy-Lok     | 10.0                | 49.8 | 49.8 | 99.6  | 38.0    |       |      |      |
|                | -F-4N     |         | 7.5  | 1/4" Female NPT |                     | 32.0 | 32.0 | 64.0  |         |       |      |      |
| H1B            | -F-6N     | 10.0    | 7.5  | 3/8" Female NPT |                     | 35.5 | 35.5 | 71.0  |         |       | 46.7 |      |
|                | -F-8N     |         |      | 1/2" Female NPT |                     | 39.5 | 39.5 | 79.0  |         |       |      |      |
|                | - M - 4 N |         | 3.7  | 1/4" Male NPT   | 7.11                | 42.7 | 42.7 | 85.4  |         |       |      |      |
|                | - M - 6 N |         | 7.2  | 3/8" Male NPT   | 9.65                | 42.7 | 42.7 | 85.4  |         |       |      |      |
|                | - M - 8 N |         | 7.5  | 1/2" Male NPT   | 10.0                | 47.6 | 47.6 | 95.2  |         |       |      |      |
|                | -F- 8N    |         | 10.0 | 1/2" Female NPT |                     | 45.0 | 45.0 | 90.0  | 50.8    | 162.0 | 60.6 | 40.0 |
|                | - F - 12N |         |      | 3/4" Female NPT | 12.7                | 45.0 | 45.0 | 90.0  |         |       |      |      |
| H2B            | - M - 12N | 12.7    |      | 3/4" Male NPT   |                     | 52.6 | 52.6 | 105.2 |         |       |      |      |
|                | - H - 10T |         |      | 5/8" Hy-Lok     |                     | 55.3 | 55.3 | 110.6 |         |       |      |      |
|                | - H - 12T |         |      | 3/4" Hy-Lok     |                     | 55.3 | 55.3 | 110.6 |         |       |      |      |
|                | - F - 12N |         | 20.0 | 3/4" Female NPT | 20.0                | 45.0 | 45.0 | 90.0  |         |       |      |      |
|                | - F - 16N |         | 30.0 | 1" Female NPT   | 20.0                | 49.1 | 49.1 | 98.2  | 55.6    |       |      | 50.0 |
|                | - H - 12T | 100     | 19.0 | 3/4" Hy-Lok     | 15.74               | 58.3 | 58.3 | 116.6 |         | 1400  |      |      |
| НЗВ            | - H - 16T | 19.0    | 30.0 | 1" Hy-Lok       | 20.0                | 64.9 | 64.9 | 129.8 |         | 162.0 | 65.6 |      |
|                | - M - 12N |         | 19.0 | 3/4" Male NPT   | 15.74               | 57.6 | 57.6 | 115.2 |         |       |      |      |
|                | - M - 16N |         | 30.0 | 1" Male NPT     | 20.0                | 62.4 | 62.4 | 124.8 |         |       |      |      |

All dimensions in millimeters. Dimensions shown with Hy-Lok nuts in finger-tight position, where applicable.

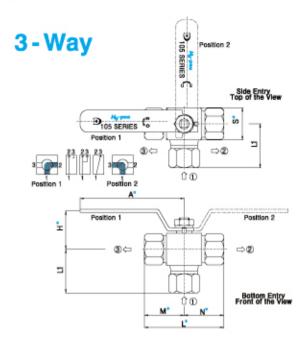

"A"marked dimensions are the same as of 2 - way valve.

## **Table of Dimensions**

| Basi | Basic Part No. |      | End Connections | dt    | L1   |  |
|------|----------------|------|-----------------|-------|------|--|
| DUSI |                |      | Inlet & Outlet  | Min.  |      |  |
|      | - 3H - 4T      |      | 1/4" Hy-Lok     | 4.8   | 53.3 |  |
|      | -3H - 6T       |      | 3/8" Hy-Lok     | 7.11  | 54.8 |  |
| н1В  | -3H - 8T       | 10.0 | 1/2" Hy-Lok     |       | 54.0 |  |
| пів  | -3F - 4N       | 10.0 | 1/4" Female NPT | 10.0  | 36.5 |  |
|      | -3F- 6N        |      | 3/8" Female NPT | 10.0  | 40.0 |  |
|      | -3F - 8N       |      | 1/2" Female NPT |       | 44.0 |  |
|      | - 3H - 10T     |      | 5/8" Hy-Lok     | 12.7  | 65.3 |  |
| H2B  | - 3H - 12T     | 12.7 | 3/4" Hy-Lok     |       | 65.3 |  |
| HZB  | -3F - 8N       | 12.7 | 1/2" Female NPT | 12.7  | 49.5 |  |
|      | - 3F - 12N     |      | 3/4" Female NPT |       | 55.0 |  |
|      | - 3H - 12T     |      | 3/4" Hy-Lok     | 15.74 | 69.8 |  |
| нзв  | - 3H - 16T     | 19.0 | 1" Hy-Lok       | 20.0  | 69.8 |  |
| пов  | - 3F - 12N     | 19.0 | 3/4" Female NPT | 20.0  | 56.5 |  |
|      | - 3F - 16N     |      | 1" Fernale NPT  | 20.0  | 60.6 |  |

All dimensions in millimeters. Dimensions shown with Hy-Lok nuts in finger tight position, where applicate.
"T"See dimension table on page2

## **Technical Data**

#### Materials of Construction

|               | Grade/ASTM                  | Specification   |  |  |  |  |
|---------------|-----------------------------|-----------------|--|--|--|--|
| Description   | Valve Body Material         |                 |  |  |  |  |
|               | SS316                       | Alloy 400       |  |  |  |  |
| Handle        | Stainless Steel w           | ith PVC Coating |  |  |  |  |
| Lock Nut      | Stainless Steel with Washer |                 |  |  |  |  |
| Pin           | Stainless Steel             |                 |  |  |  |  |
| Stem          | \$\$316/A276                |                 |  |  |  |  |
| Stem Packing* | PTFE                        |                 |  |  |  |  |
| Ball*         | SS316/A276                  |                 |  |  |  |  |
| Seats*        | PVDF (st                    | andard)         |  |  |  |  |
| End Connector | SS316/A276                  | Alloy 400/B164  |  |  |  |  |
| End Seals*    | PTFE/Viton                  |                 |  |  |  |  |
| Body          | SS316/A479                  | Alloy 400/B164  |  |  |  |  |
|               |                             |                 |  |  |  |  |

Note: "\*" marked are wetted parts. Lubricant is silicone based."

#### Handle

- · Handle is made of stainless steel with PVC coat in yellow.
- Other colors are available upon request.

#### Sour Gas Service

is provided to meet NACE Standard MR - 01 - 75.

#### Testing

- Each valve is tested with nitrogen @ 1000psig(69bar) to max leak rate of 0.1SCCM.
- Hydrostatic shell test is performed at 1.5 times the working pressure.
- Optional tests are available upon request.

## Pressure and Temperature Rating

#### ■ H1B Types

| -1110 13600        |                          |              |                                  |                              |  |  |  |  |  |
|--------------------|--------------------------|--------------|----------------------------------|------------------------------|--|--|--|--|--|
| - 1                | Materials                |              | Pressure Rating                  | Temperature                  |  |  |  |  |  |
| Seat               | Stem End<br>Packing Seal |              | @ -65°F ~ 70°F<br>(-54°C ~ 21°C) | Rating                       |  |  |  |  |  |
| PVDF<br>(standard) |                          |              | 6,000 psig                       | -22°F~265°F<br>(-30°C~130°C) |  |  |  |  |  |
| PCTFE              | PT                       | PTFE (410 b) | (410 bar)                        | -22°F~355°F<br>(-30°C~180°C) |  |  |  |  |  |
| PEEK               |                          |              | 10,000 psig<br>(690 bar)         | -65°F~500°F<br>(-54°C~260°C) |  |  |  |  |  |

#### ■ H2B, H3B Types

| N                  | 1aterials       |             | Pressure Rating              | Temperature<br>Rating        |  |  |
|--------------------|-----------------|-------------|------------------------------|------------------------------|--|--|
| Seat               | Stem<br>Packing | End<br>Seal | @ -65°F~70°F<br>(-54°C~21°C) |                              |  |  |
| PVDF<br>(standard) |                 |             | 5,000 psig                   |                              |  |  |
| PCTFE              | PTFE            | Viton       | (340 bar)                    | -10°F~375°F<br>(-23°C~191°C) |  |  |
| PEEK               |                 |             | 6,000 psig<br>(410 bar)      | ,                            |  |  |

#### Note

- 1. The above pressure rating is for 2-way straight pattern valves. 80% of the above rating shall be applicable to 2-way angle pattern valves and 3-way valves.
- The rated pressure shown above is the maximum allowable pressure to the seat. If the system requires higher pressure to test, the valve must be in open position before and during test so as not to damage the seat.
- When valves with Hy-Lok Fitting end connections are connected to tubing, the working pressure of tubing must be considered in the calculation of total system working pressure.


## **High Pressure Ball Valves**

## 105 Series

## Panel Mounting

| Valve<br>Type | Orifice | d   | D    | L×L   |
|---------------|---------|-----|------|-------|
| н1В           | 10.0    | 5.0 | 30.0 | 26×26 |
| H2B           | 12.7    | 5.0 | 38.0 | 34×34 |
| НЗВ           | 19.0    | 5.0 | 38.0 | 44×44 |

All dimensions in millimeters.




Screw Holes in valves are M4 x 6mm Depth

## Torque for Turning Handle (N · m)

| Valve<br>Type Orifice | Orifica | Working Pressure - psig |       |       |       |       |       |       |       |       |        |     |
|-----------------------|---------|-------------------------|-------|-------|-------|-------|-------|-------|-------|-------|--------|-----|
|                       | 0       | 1.000                   | 2.000 | 3.000 | 4.000 | 5.000 | 6.000 | 7.000 | 8.000 | 9.000 | 10.000 |     |
| нів                   | 10.0    | 1.6                     | 1.4   | 1.4   | 1.6   | 2.1   | 2.3   | 2.7   | 2.9   | 3.3   | 3.7    | 4.0 |
| H2B                   | 12.7    | 3.3                     | 2.9   | 3.8   | 4.3   | 5.0   | 5.2   | 5.6   | -     | -     | -      | -   |
| НЗВ                   | 19.0    | 3.2                     | 3.1   | 4.2   | 6.5   | 8.0   | 8.6   | 9.6   | -     | -     | -      | -   |

## **Ordering Information**

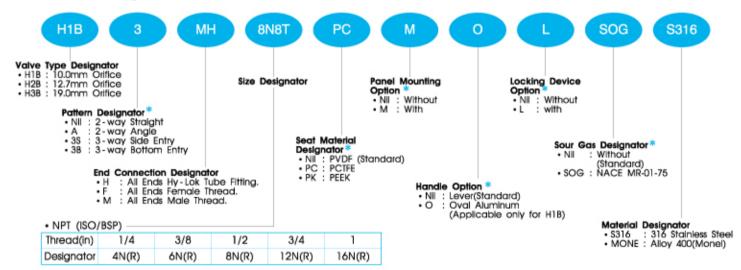

Tube

| Fractional | O.D.(in)   | 1/4 | 3/8 | 1/2 | 3/4 | 1   |
|------------|------------|-----|-----|-----|-----|-----|
| Tube       | Designator | 4T  | 6T  | 8T  | 12T | 16T |
| Metric     | O.D.(mm)   | 6   | 10  | 12  | 20  | 25  |
| Tube       | Designator | 6M  | 10M | 12M | 20M | 25M |

Note \*: No designator is required for standard items, e.g. H1B - F - 6N - S316.

#### ■ QUALITY SYSTEM CERTIFICATES



ISO 9001 CERTIFICATE NO.GQC 212 ASME SECT II (MO) CERTIFICATE NO. QSC 584

## SAFETY IN VALVE SELECTION

Proper installation, materials compatibility, operation and maintenance of these valves are the responsibility of the user. The total system design must be taken into consideration to ensure optimal performance and safety.

#### ■ TYPE APPROVALS (for Hy-Lok Tube Fittings)



American Bureau Shipping CERTIFICATE NO.00-BK502B8-X



Lloyd's Register CERTIFICATE NO.01/10075



GERMANISCHER LLOYD CERTIFICATE NO.57798-91 HIH



DET NORSKE VERITAS CERTIFICATE NO.P - 9100



Distributed by :

www.hy-lok.com