
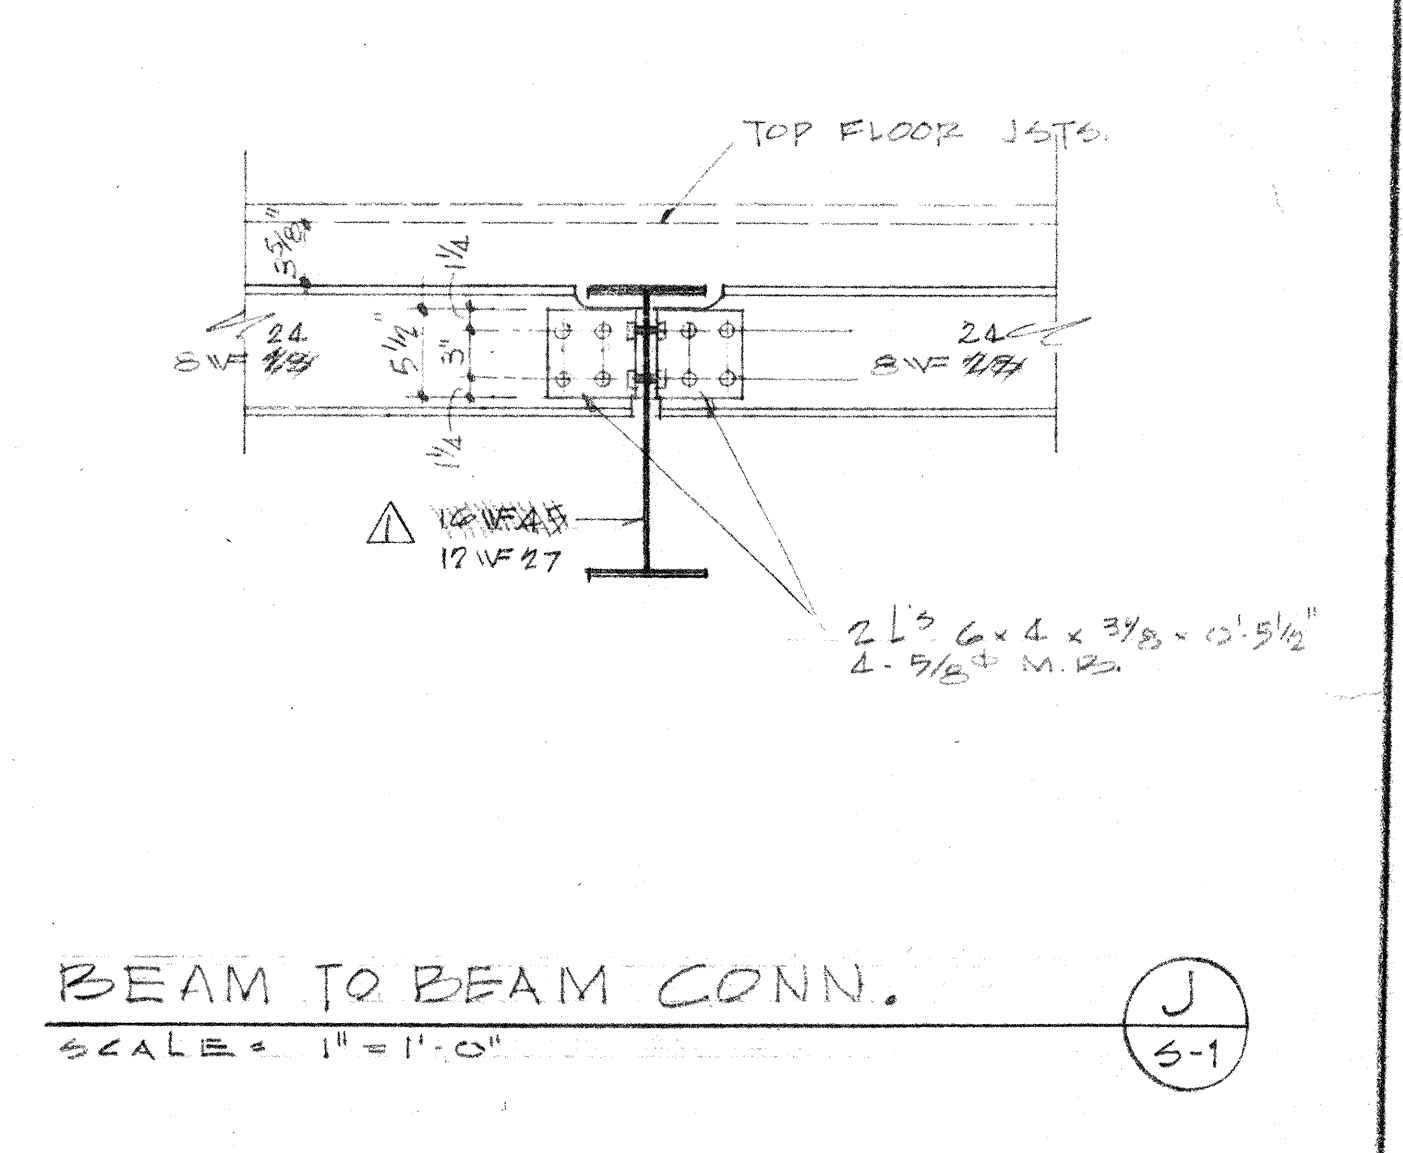
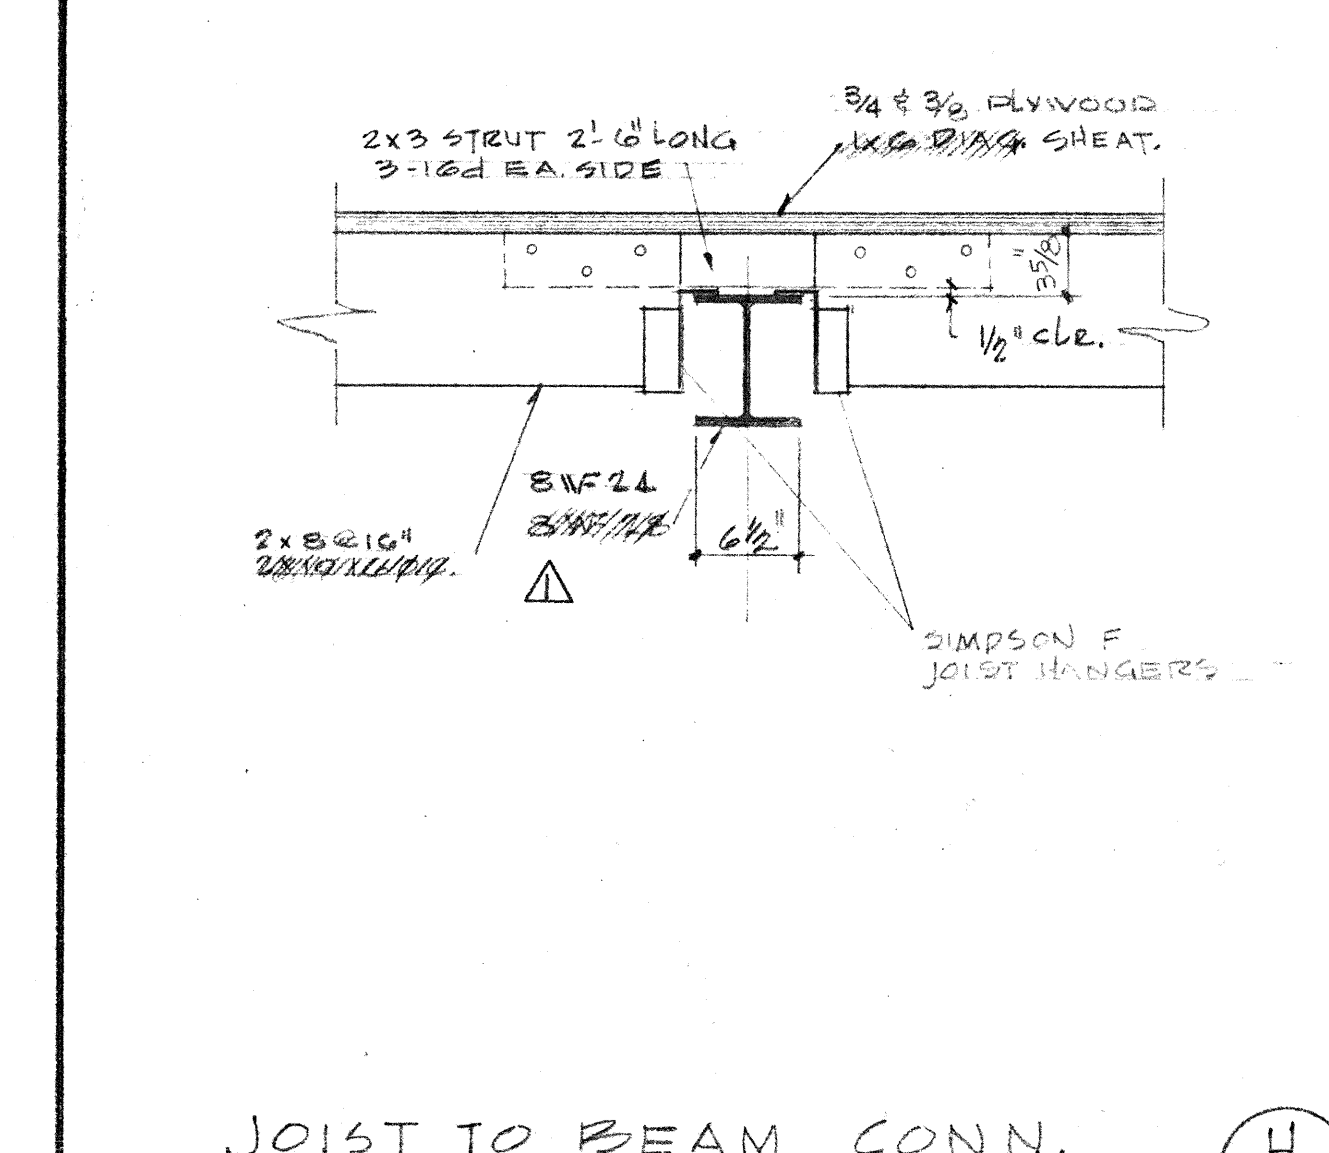
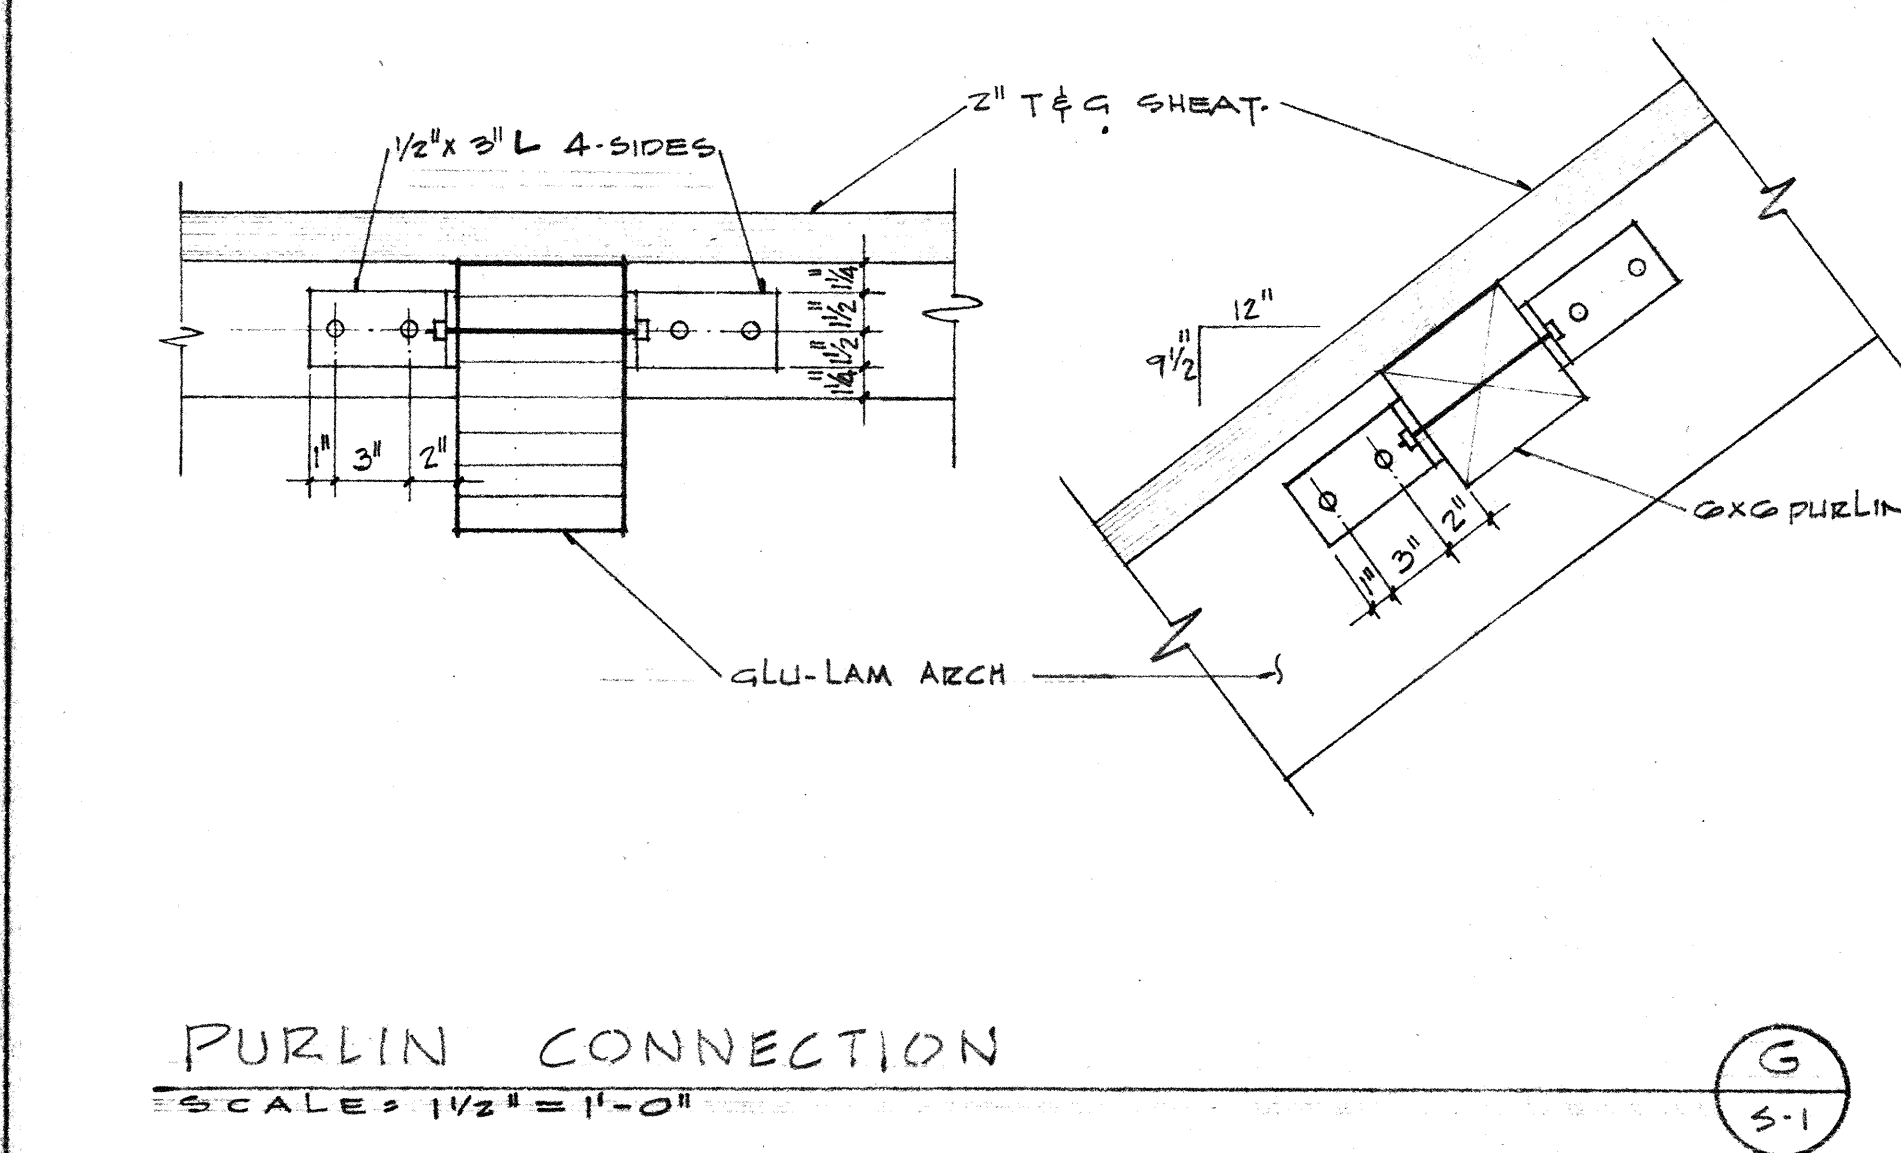
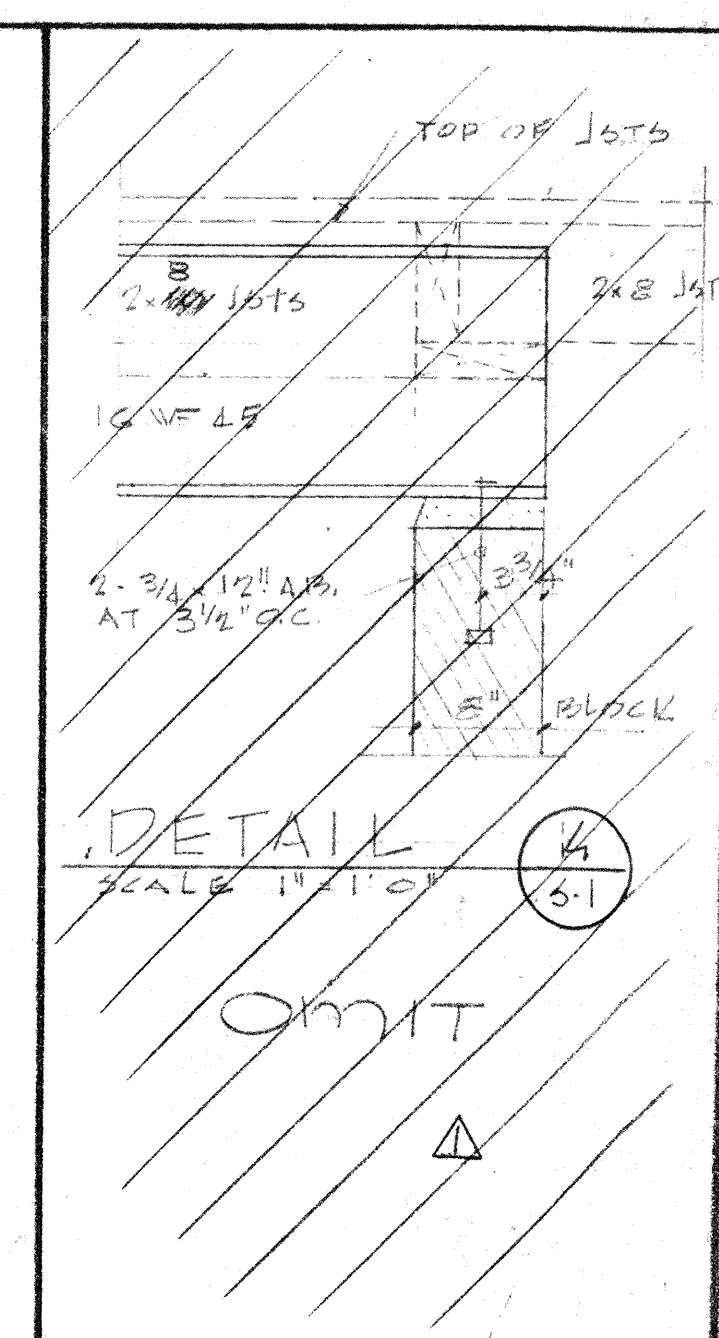
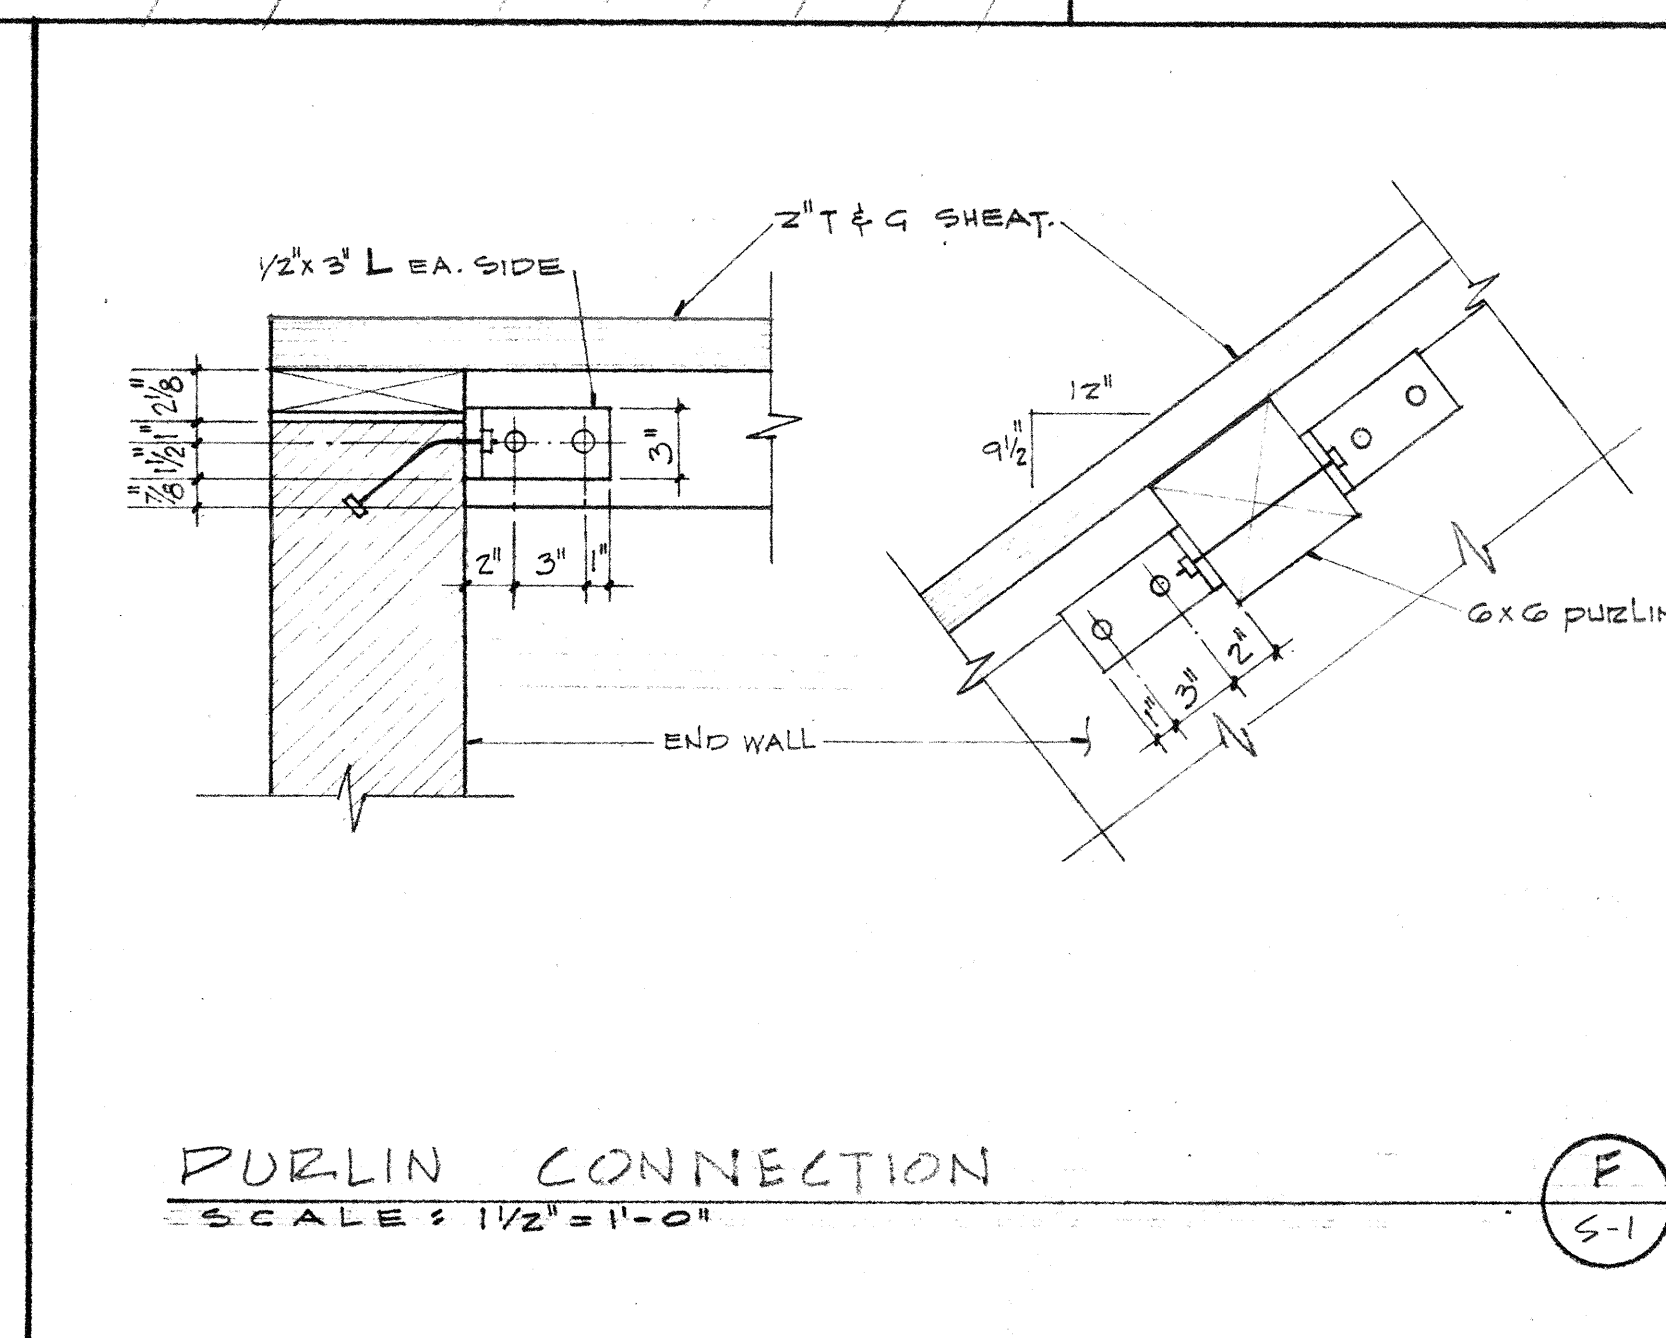
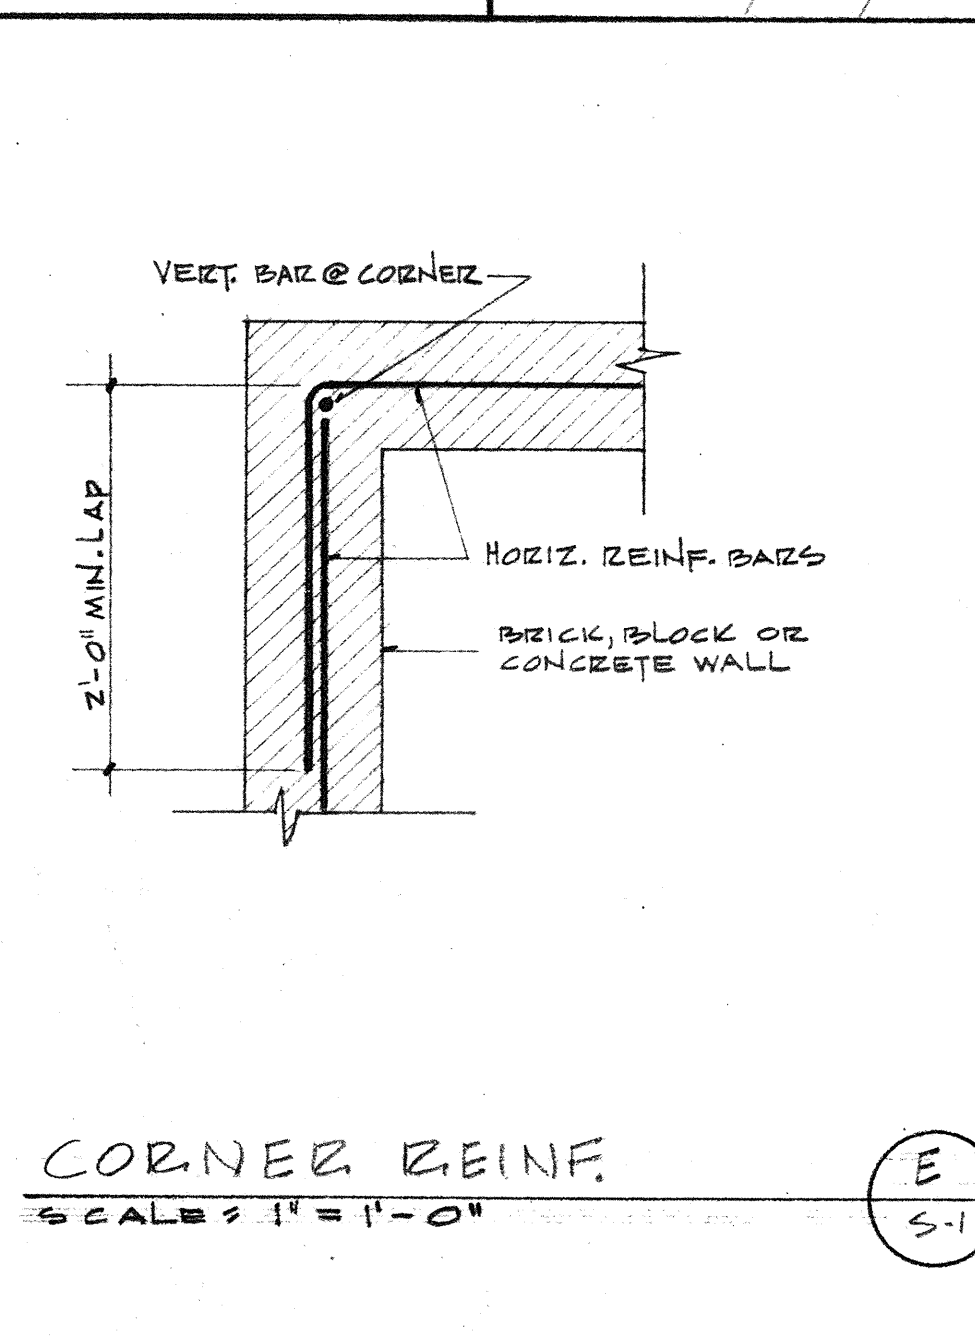
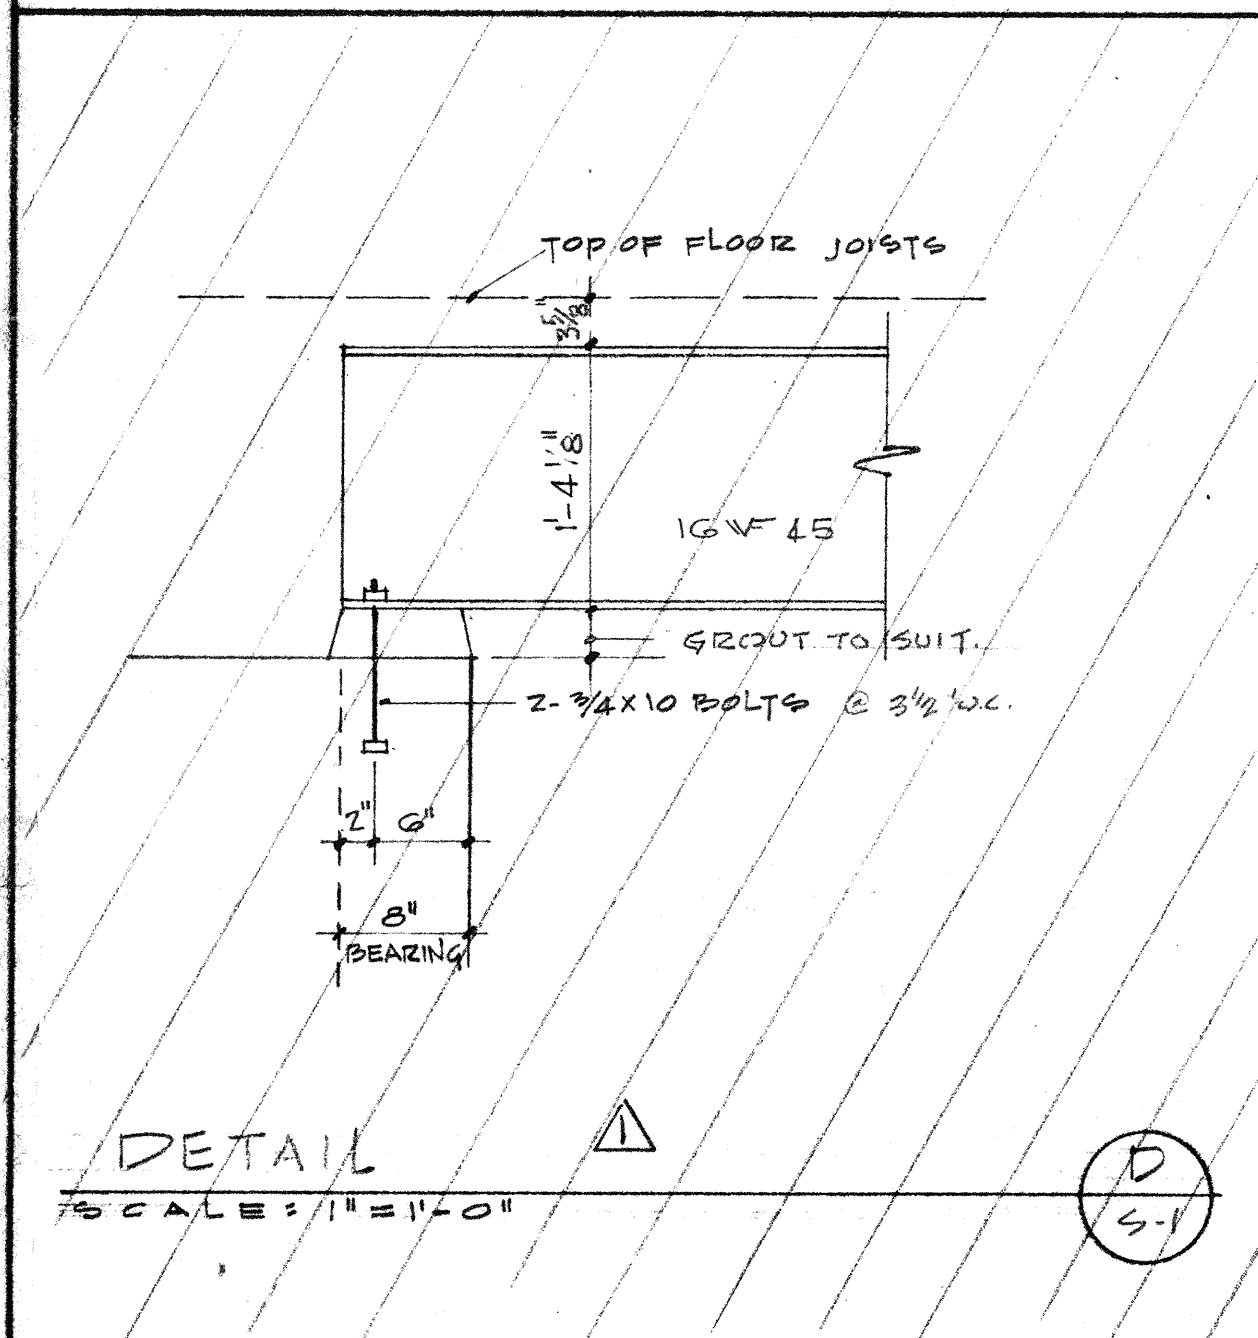
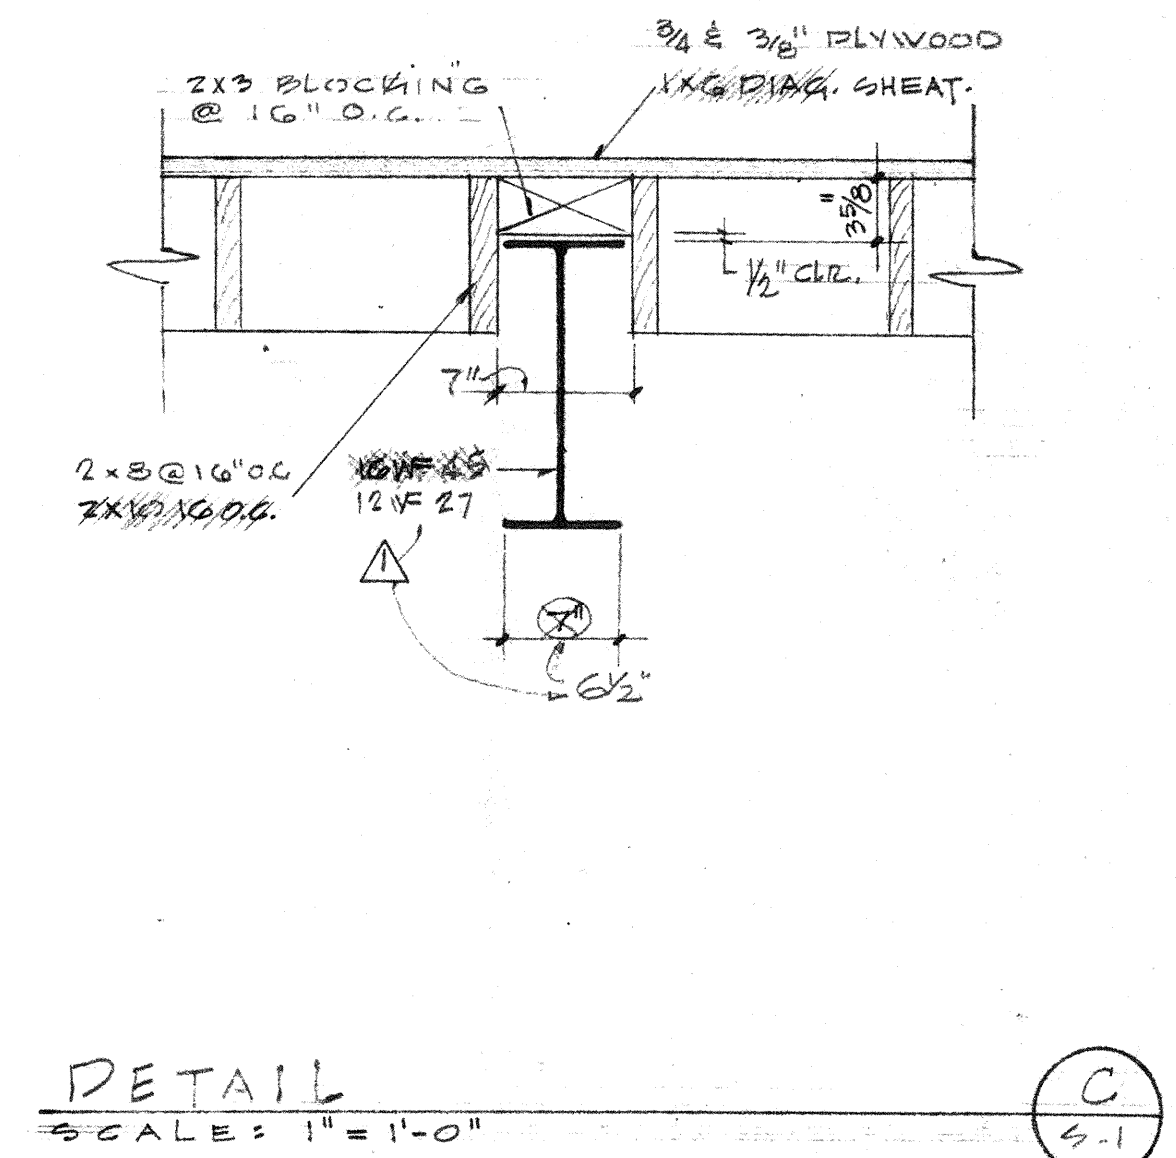
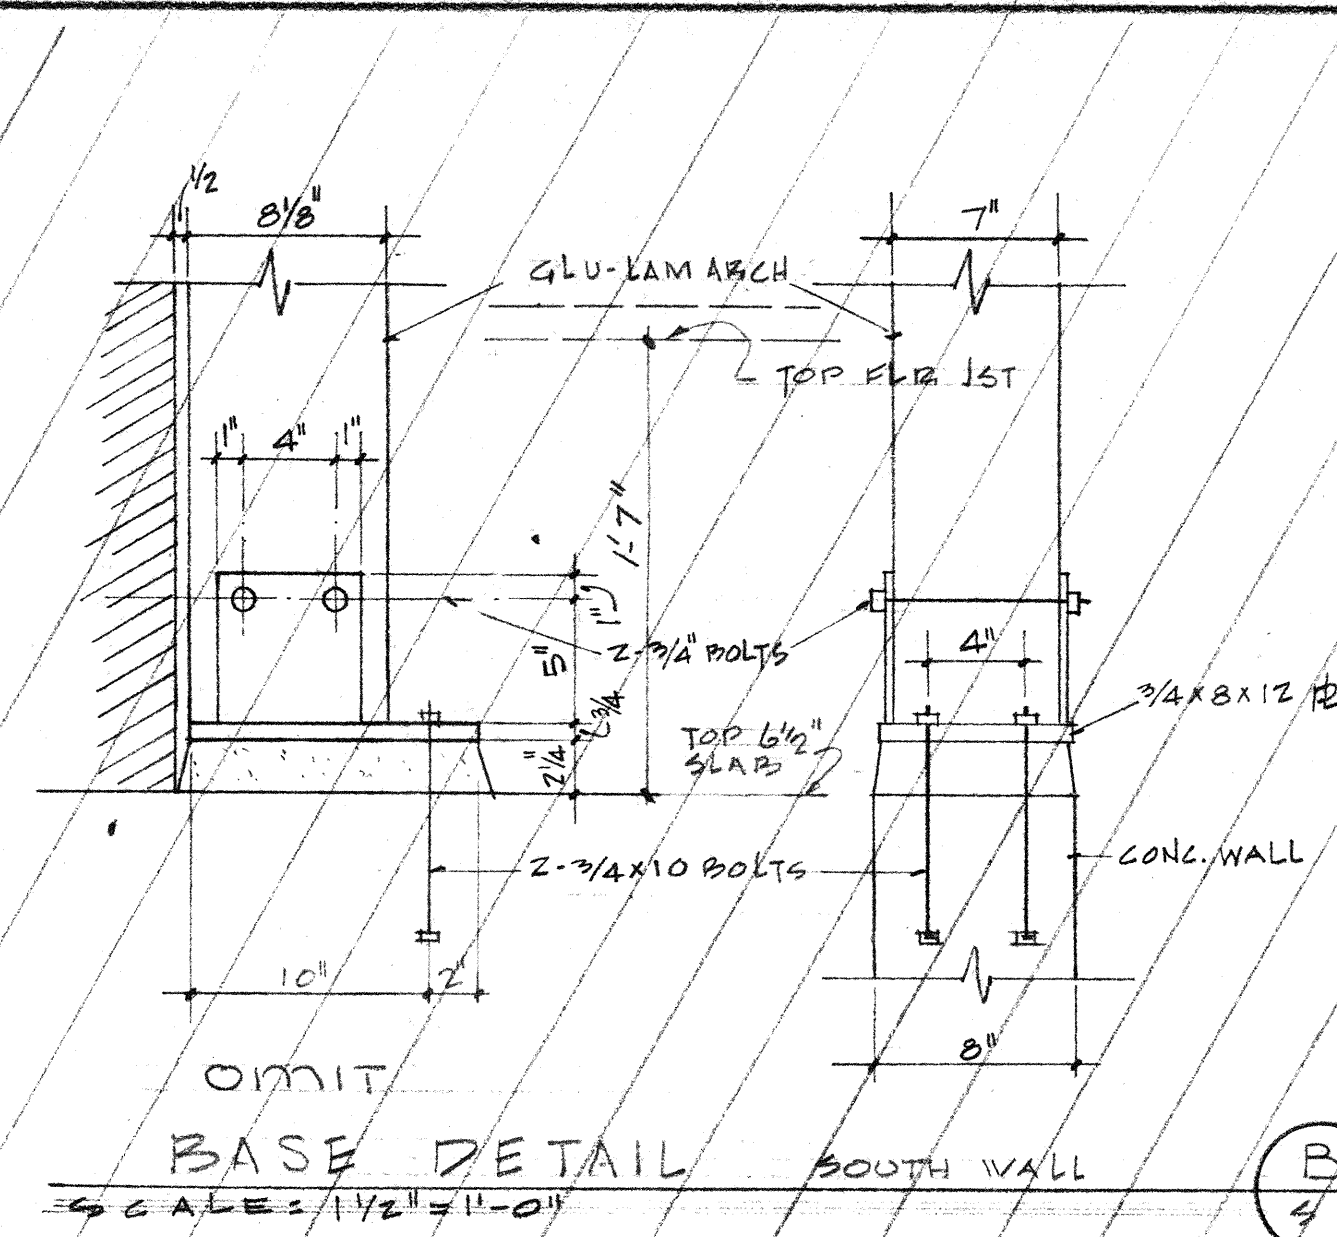


STRUCTURAL NOTES

- Soil type is medium stiff, sandy clay.
- Soil bearing value used in design is 2,000 p.s.f.
- Bottoms of all footings shall be at least 1'-0" below natural undisturbed soil or finish grade, whichever is lower.
- Backfill around footings shall be compacted by tamping, but not by flooding.
- Should any subsurface conditions be encountered that could affect the new construction (such as fill deposits, abandoned cesspools or utilities, ground water, etc.) such condition shall be called to the attention of the Structural Engineer.
- All concrete shall be 1:2-1/2:3-1/2 mix, 5.4 sacks cement per yard. Maximum water content shall be 7-1/2 gallons per sack of cement (2,000 p.s.f. @ 28 days).
- The maximum size aggregate shall be 3/4" for slabs and walls less than 8" in thickness, and 1-1/2" for walls 8" or thicker, in least dimension.
- Reinforcing bars shall be intermediate grade deformed bars conforming to ASTM A15-57T. Deformation shall conform to ASTM A305-56T.
- Welded wire mesh shall conform to ASTM A185-56T.
- Where bars are spliced they shall be lapped a minimum of 32 bar diameters.
- Minimum concrete coverage of bars shall be 3" where concrete is poured against earth; 2" where formed but in contact with earth; 1-1/2" in walls, beams and columns; and 3/4" for formed slabs.
- All slabs shall have a steel trowel finish and be level to within 1/4" in any ten feet.
- Subgrades under slabs shall be dempened before pouring and shall be cured by keeping continuously wet for four days after pouring or by sealing surface with Thompson's Water Seal.
- Forms for slabs and beams shall not be removed or disturbed for 7 days after pouring.
- All exposed surfaces shall be formed with sanded plywood, and any fins or other projections shall be removed. Any voids shall be filled. The entire surface shall be "sacked" to provide a uniform, attractive finish.
- All brick shall be grade MW conforming to ASTM C62.
- Mortar shall consist of one part Portland cement, 1/4 to 1/2 part hydrated lime or lime putty, and a volume of sand not less than 2-1/2 nor more than 3 times the sum of the volumes of cement and limes used.
- Grout shall consist of one part Portland cement, 3 parts sand, and 2 parts pea gravel.
- Adjacent to all openings there shall be 1 - #5 bars vertically the full height of the wall and 1 - #5 bar horizontally extending 2'-0" minimum beyond the sides of the opening. This shall include door openings.
- Provide dowels in the footing for each vertical bar. Dowels shall be the same size as the bar above.
- Shoring for lintels shall remain undisturbed for 7 days after pouring. All cells in lintels shall be filled with grout.
- All horizontal framing lumber, unless otherwise noted, shall be grade marked Construction Grade Douglas Fir.
- All vertical framing lumber shall be standard grade Douglas Fir except that posts shall be Construction Grade when the least dimension is 4" or greater.
- All exposed members 4" and thicker in narrowest dimension shall be grade marked Select Structural Douglas Fir.
- All sills resting on concrete within 4'-0" of grade shall be foundation grade Redwood or treated Douglas Fir.
- Floor joists shall be bridged (metal or wood) or blocked at not to exceed 8'-0" on center.
- Roof joists shall be blocked or bridged (metal or wood) at not to exceed 10'-0" on center.
- Bolt holes shall be the same diameter as the bolt to insure a driving fit and washers shall be provided under bolt heads and nuts when bearing against wood.
- Plywood sheathing shall be interior grade C-C with exterior glue with joints staggered and laid with face grain perpendicular to rafters. Nailing around perimeter of sheets shall be as called for on the drawings and 8d at 12" along intermediate bearings.
- High roof sheeting shall be 2" T & G boards nailed at each bearing with 2 16d nails per board.
- Nailing for framing shall conform to Table 25-K, U.B.C., 1964 Edition.
- Glued laminated beams shall be Combination A. See architectural specifications for finish. Shop drawings to be submitted to the Architect for approval.
- All structural steel shall conform to ASTM A36. Clip angles and minor members shall be ASTM A7 or A36.
- All fabricated items shall be painted with one coat of zinc chromate primer.
- Should any condition arise where the intent of the drawings is in doubt, or where there is a discrepancy between the drawings and field conditions, the Architect and Engineer shall be notified for procedure to be followed.

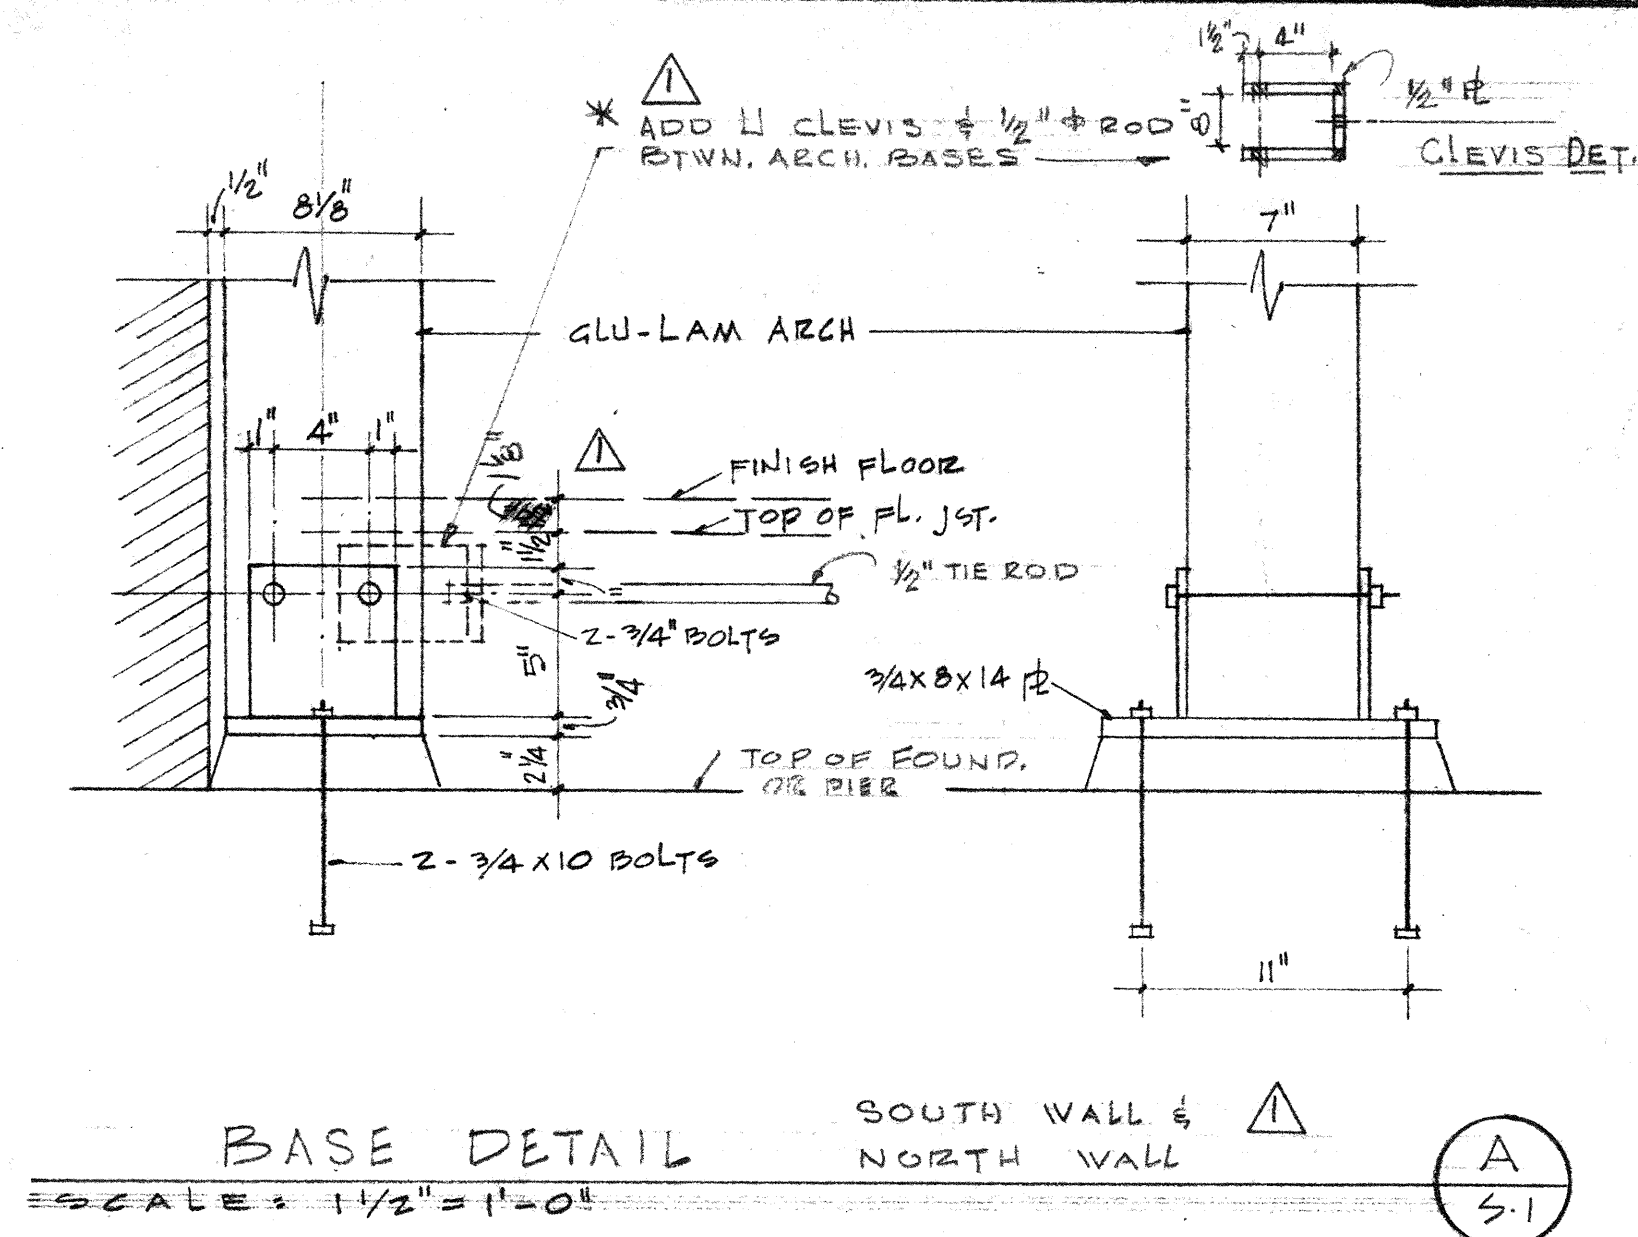

STRUCTURAL NOTES & TYP. DETAILS

REVISIONS	PARISH HALL ADDITION
1-3-1-66	FOR ST. EDMUND'S EPISCOPAL CHURCH
	1175 SAN GABRIEL BLVD. SAN MARINO, CALIFORNIA
DRAWN BY	BREO FREEMAN
CHECKED BY	ARCHITECT
DATE	12-20-65
	PASADENA 1, CALIFORNIA
JOB NO.	927
SHEET NO.	5-1
OF 9	