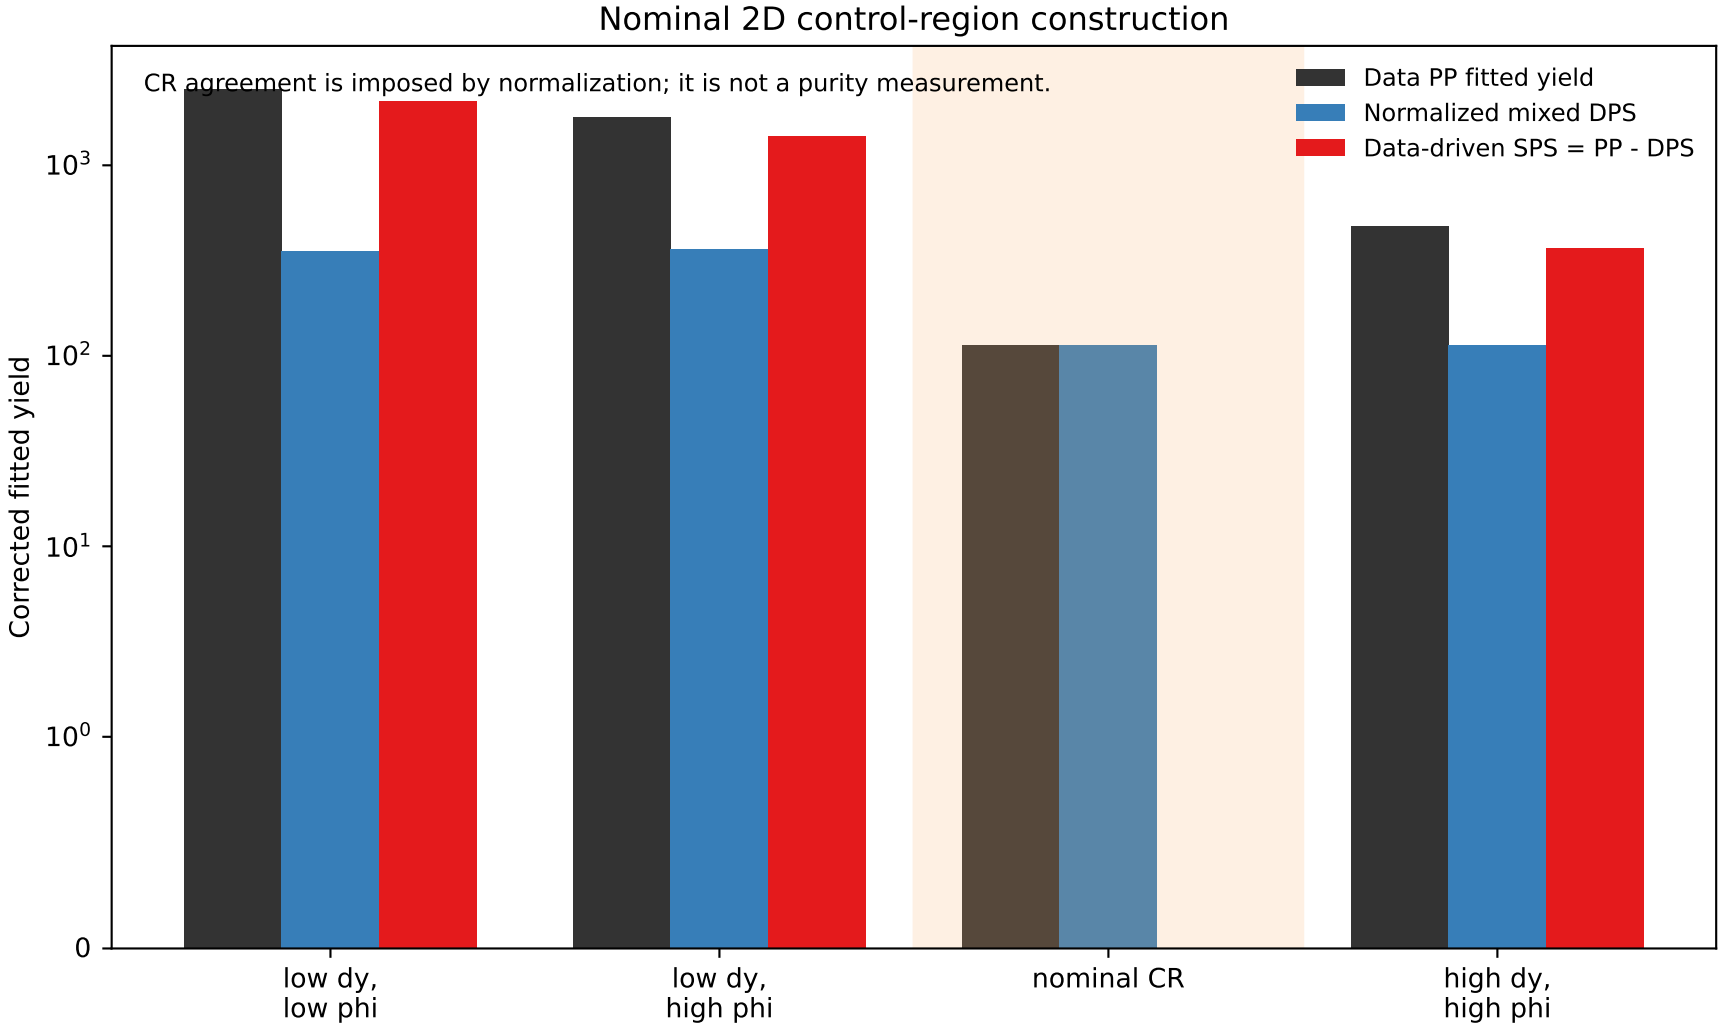
Nominal 2D control-region construction
CR agreement is imposed by normalization; it is not a purity measurement.
Data PP fitted yield
Normalized mixed DPS
Data-driven SPS = PP - DPS
Corrected fitted yield
10^3
10^2
10^1
10^0
0
low dy, low phi
low dy, high phi
nominal CR
high dy, high phi