AI Guardian - Water Safety Dashboard

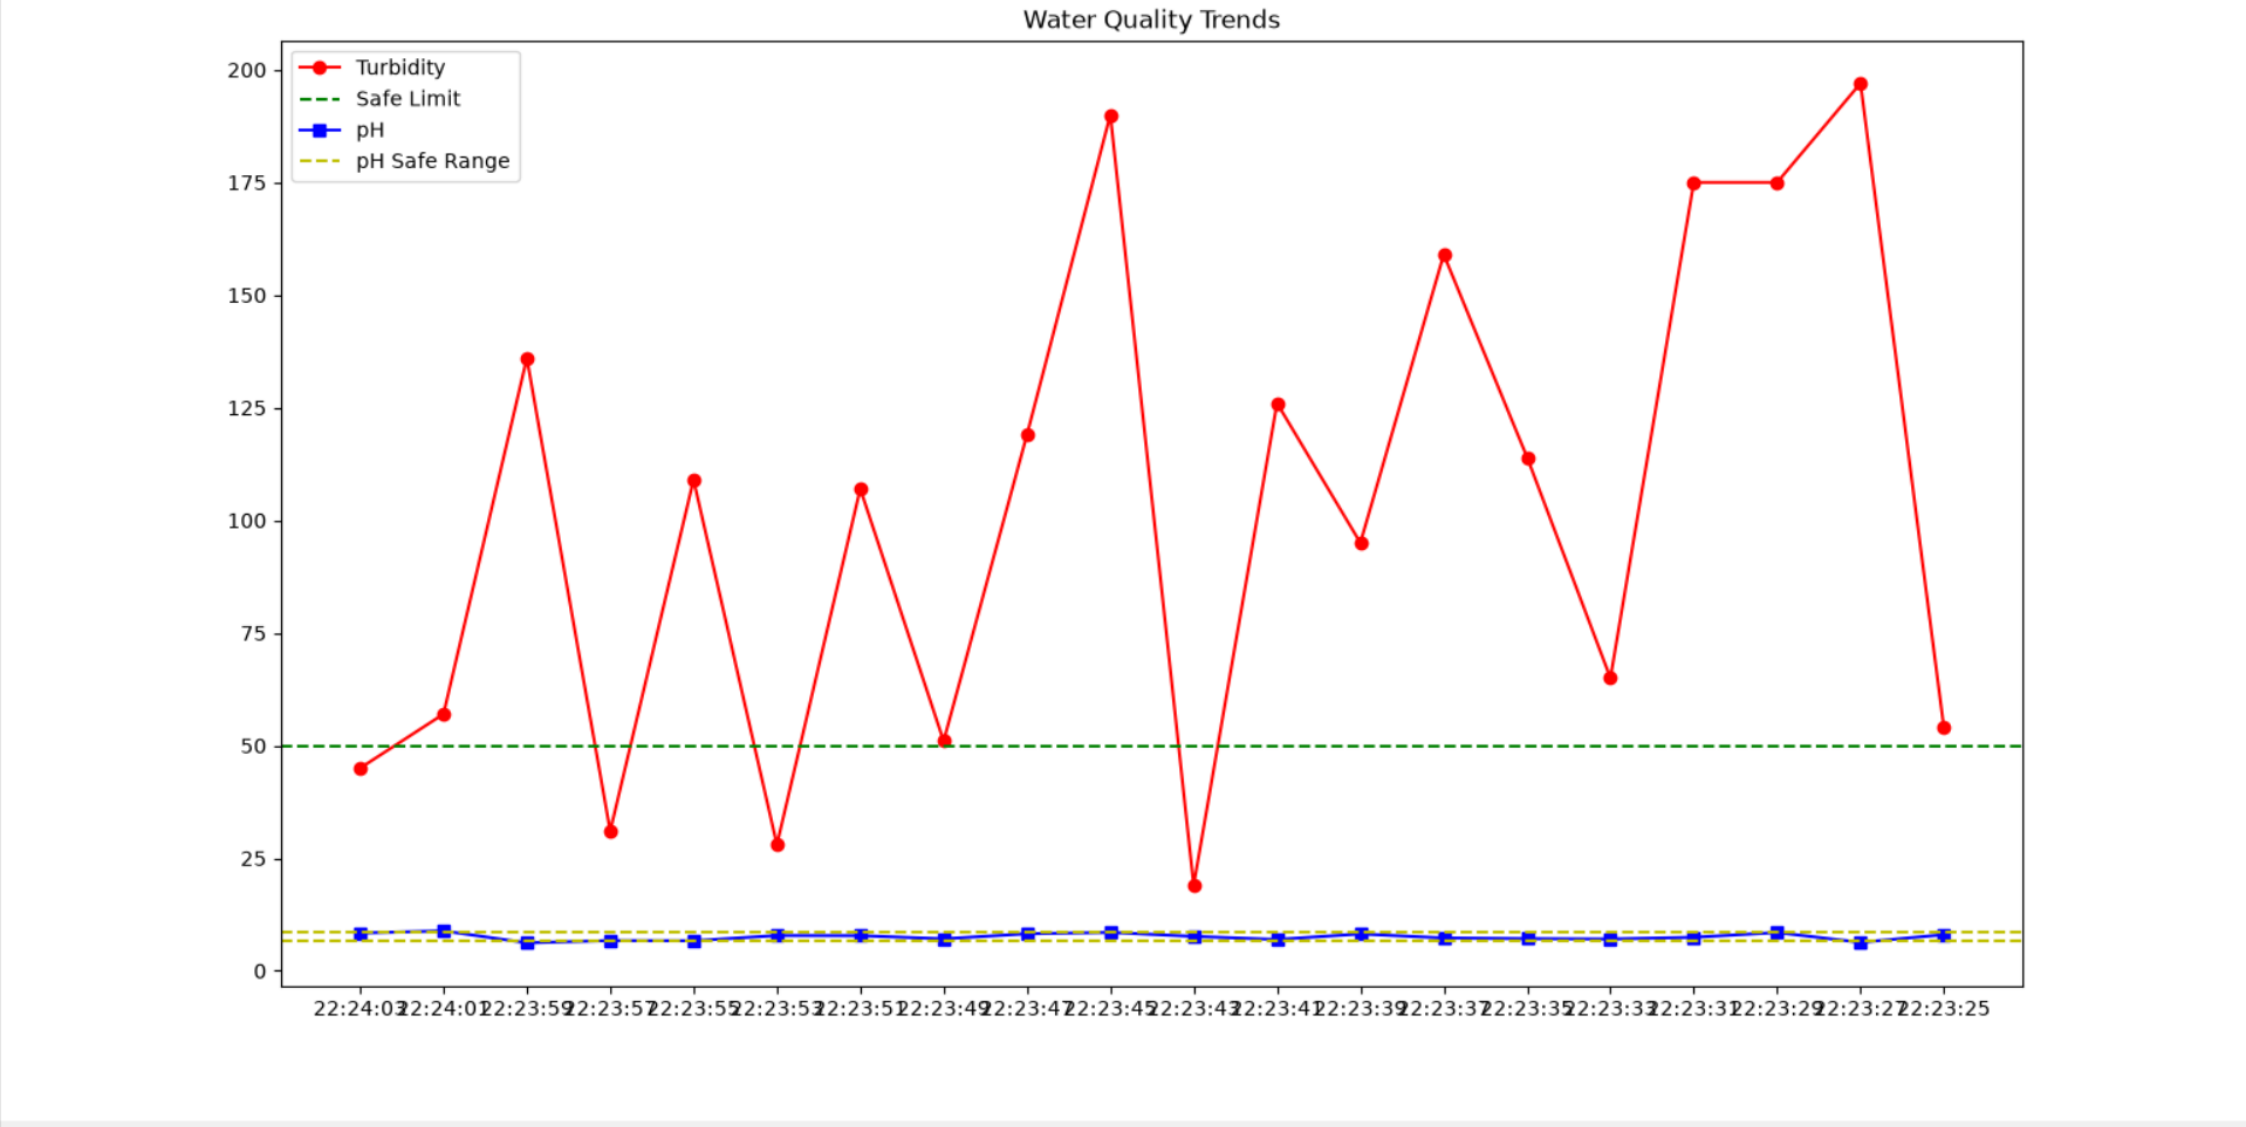
Status: UNSAFE → DIVERT SEWAGE

22:22:56 | Turbidity=130, pH=7.49, UNSAFE → DIVERT SEWAGE
22:22:58 | Turbidity=48, pH=7.15, SAFE → NORMAL FLOW
22:23:00 | Turbidity=136, pH=7.89, UNSAFE → DIVERT SEWAGE
22:23:02 | Turbidity=67, pH=8.33, UNSAFE → DIVERT SEWAGE
22:23:04 | Turbidity=67, pH=6.37, UNSAFE → DIVERT SEWAGE
22:23:06 | Turbidity=141, pH=6.75, UNSAFE → DIVERT SEWAGE
22:23:08 | Turbidity=110, pH=7.82, UNSAFE → DIVERT SEWAGE
22:23:10 | Turbidity=172, pH=6.18, UNSAFE → DIVERT SEWAGE
22:23:12 | Turbidity=70, pH=8.11, UNSAFE → DIVERT SEWAGE
22:23:14 | Turbidity=122, pH=6.54, UNSAFE → DIVERT SEWAGE

Time	Turbidity	pH	Status
22:23:12	70	8.11	UNSAFE → DIVERT SEWAGE
22:23:14	122	6.54	UNSAFE → DIVERT SEWAGE
22:23:16	96	7.24	UNSAFE → DIVERT SEWAGE
22:23:18	141	6.66	UNSAFE → DIVERT SEWAGE
22:23:20	198	8.08	UNSAFE → DIVERT SEWAGE
22:23:22	44	8.28	SAFE → NORMAL FLOW
22:23:24	54	8.03	UNSAFE → DIVERT SEWAGE
22:23:27	197	6.33	UNSAFE → DIVERT SEWAGE
22:23:29	175	8.5	UNSAFE → DIVERT SEWAGE
22:23:31	175	7.45	UNSAFE → DIVERT SEWAGE

Generate Graph

Figure 1


Water Quality Trends
Turbidity
Safe Limit
pH
pH Safe Range
200
175
150
125
100
75
50
25
0
22:24:03
22:24:01
22:23:59
22:23:57
22:23:55
22:23:53
22:23:51
22:23:49
22:23:47
22:23:45
22:23:43
22:23:41
22:23:39
22:23:37
22:23:35
22:23:33
22:23:31
22:23:29
22:23:27
22:23:25

MySQL 8.0 Command Line Cli

```
mysql> SELECT * FROM sensor_data;
```

id	timestamp	turbidity	ph	status
1	2026-10-08 22:22:57	130	7.49	UNSAFE ? DIVERT SEWAGE
2	2026-10-08 22:22:59	48	7.15	SAFE ? NORMAL FLOW
3	2026-10-08 22:23:01	136	7.89	UNSAFE ? DIVERT SEWAGE
4	2026-10-08 22:23:03	67	8.33	UNSAFE ? DIVERT SEWAGE
5	2026-10-08 22:23:05	67	6.37	UNSAFE ? DIVERT SEWAGE
6	2026-10-08 22:23:07	141	6.75	UNSAFE ? DIVERT SEWAGE
7	2026-10-08 22:23:09	110	7.82	UNSAFE ? DIVERT SEWAGE
8	2026-10-08 22:23:11	172	6.18	UNSAFE ? DIVERT SEWAGE
9	2026-10-08 22:23:13	70	8.11	UNSAFE ? DIVERT SEWAGE
10	2026-10-08 22:23:15	122	6.54	UNSAFE ? DIVERT SEWAGE
11	2026-10-08 22:23:17	96	7.24	UNSAFE ? DIVERT SEWAGE
12	2026-10-08 22:23:19	141	6.66	UNSAFE ? DIVERT SEWAGE
13	2026-10-08 22:23:21	198	8.08	UNSAFE ? DIVERT SEWAGE
14	2026-10-08 22:23:23	44	8.28	SAFE ? NORMAL FLOW
15	2026-10-08 22:23:25	54	8.03	UNSAFE ? DIVERT SEWAGE
16	2026-10-08 22:23:27	197	6.33	UNSAFE ? DIVERT SEWAGE
17	2026-10-08 22:23:29	175	8.5	UNSAFE ? DIVERT SEWAGE
18	2026-10-08 22:23:31	175	7.45	UNSAFE ? DIVERT SEWAGE
19	2026-10-08 22:23:33	65	7.07	UNSAFE ? DIVERT SEWAGE
20	2026-10-08 22:23:35	114	7.15	UNSAFE ? DIVERT SEWAGE
21	2026-10-08 22:23:37	159	7.3	UNSAFE ? DIVERT SEWAGE
22	2026-10-08 22:23:39	95	8.19	UNSAFE ? DIVERT SEWAGE
23	2026-10-08 22:23:41	126	6.97	UNSAFE ? DIVERT SEWAGE
24	2026-10-08 22:23:43	19	7.65	SAFE ? NORMAL FLOW
25	2026-10-08 22:23:45	190	8.53	UNSAFE ? DIVERT SEWAGE
26	2026-10-08 22:23:47	119	8.23	UNSAFE ? DIVERT SEWAGE
27	2026-10-08 22:23:49	51	7.11	UNSAFE ? DIVERT SEWAGE
28	2026-10-08 22:23:51	107	7.81	UNSAFE ? DIVERT SEWAGE
29	2026-10-08 22:23:53	28	7.84	SAFE ? NORMAL FLOW
30	2026-10-08 22:23:55	109	6.68	UNSAFE ? DIVERT SEWAGE
31	2026-10-08 22:23:57	31	6.72	SAFE ? NORMAL FLOW
32	2026-10-08 22:23:59	136	6.22	UNSAFE ? DIVERT SEWAGE
33	2026-10-08 22:24:01	57	8.87	UNSAFE ? DIVERT SEWAGE
34	2026-10-08 22:24:03	45	8.4	SAFE ? NORMAL FLOW
35	2026-10-08 22:24:05	87	8.01	UNSAFE ? DIVERT SEWAGE
36	2026-10-08 22:24:07	34	6.05	UNSAFE ? DIVERT SEWAGE
37	2026-10-08 22:24:09	45	8.22	SAFE ? NORMAL FLOW
38	2026-10-08 22:24:11	176	8.05	UNSAFE ? DIVERT SEWAGE
39	2026-10-08 22:24:13	167	7.34	UNSAFE ? DIVERT SEWAGE
40	2026-10-08 22:24:15	51	6.62	UNSAFE ? DIVERT SEWAGE
41	2026-10-08 22:24:17	144	8.59	UNSAFE ? DIVERT SEWAGE
42	2026-10-08 22:24:19	199	7.89	UNSAFE ? DIVERT SEWAGE
43	2026-10-08 22:24:21	99	6.56	UNSAFE ? DIVERT SEWAGE

```sql
CREATE DATABASE water_ai;

USE water_ai;

CREATE TABLE sensor_data (
    id INT AUTO_INCREMENT PRIMARY KEY,
    timestamp DATETIME,
    turbidity INT,
    ph FLOAT,
    status VARCHAR(50)
);

CREATE TABLE actions (
    id INT AUTO_INCREMENT PRIMARY KEY,
    timestamp DATETIME,
    command VARCHAR(50)
);
```

```sql
CREATE TABLE community_contacts (
    id INT AUTO_INCREMENT PRIMARY KEY,
    name VARCHAR(50),
    phone_number VARCHAR(15)
);
```

```sql
INSERT INTO community_contacts (name, phone_number)
VALUES ('Resident1', '+919876543210'),
       ('Resident2', '+919812345678');
```

```
AI Guardian Alert:
Unsafe water detected!
Turbidity: 120, pH: 6.2
Action: Divert sewage immediately
```