

# Switching Transient Analysis Of Capacitor Coupled Substation

Ntombifuthi Ngwenya  
Electrical Engineering Department  
Tshwane University of Technology  
eMalahleni Campus, South Africa  
[Ntongwe.nn@gmail.com](mailto:Ntongwe.nn@gmail.com)

Agha Francis Nnachi  
Electrical Engineering Department  
Tshwane University of Technology  
eMalahleni Campus, South Africa  
[nnachiaf@tut.ac.za](mailto:nnachiaf@tut.ac.za)

Bolanle T Abe  
Electrical Engineering Department  
Tshwane University of Technology  
eMalahleni Campus, South Africa  
[AbeBT@tut.ac.za](mailto:AbeBT@tut.ac.za)

**Abstract**— Capacitor Coupled Substation is one of the low-cost technology for rural electrification (RE). However, the basic component of CCS is a capacitor and switching on the CCS during energisation process can result in an unwanted, high-frequency inrush current and transient overvoltage. These transients can lower the lifetime of CCS and can damage the electromagnetic switches such as circuit breakers. This paper, therefore, presents switching transient analysis of capacitor-coupled substation (CCS). Firstly, a CCS is modelled and simulated using MATLAB/Simulink. Transient response of the CCS with and without Ferro-resonance circuit is investigated. Secondly, a prototype of CCS was constructed, and the same investigation was done.

Among many observations, it was generally observed through simulation and practical results that the tapping voltage oscillates when Ferro-resonance circuit is not incorporated

**Keywords**— Capacitor Coupled Substation, Resonance, transient, Rural electrification

## I. INTRODUCTION

Literature indicated that more than 1.6 billion people, mostly in developing countries, do not have access to electricity and that most of them live in rural areas [1] [2]. The various un-conventional rural electrification (URE) technologies that have been identified and explored in various literatures are as follows:

- Single Wire Earth Return (SWER) [3] [4],
- Shielded Wire Schemes (SWSs) [5],
- Voltage transformers (ASVTs) [6], [7] and
- Capacitor Coupled Substation.

This URE sub-station technology offers significant opportunities for reduction of construction, operating and maintenance costs of grid-based rural electrification. This Grid-based electricity offers a cheaper option for lighting and small appliances usage in rural settlements [8].

Capacitor coupled substation technology is originated from the concept of capacitive divider technique to transform high voltage to medium voltage for delivering electric power to remote areas. With this technique, energy is drawn from electric field of high voltage transmission line by use of discrete capacitors. When compared with the conventional electromagnetic circuit, this technique leads to significant cost reduction [9]. However, since the fundamental component of CCS is a capacitor, switching on the CCS during energisation process can result in an unwanted, high-frequency inrush

current and transient overvoltage. These transients can lower the lifetime of CCS and can damage the electromagnetic switches such as circuit breakers. This paper, therefore, presents an analysis of switching transient of a capacitor-coupled substation. In this paper, results of a MATLAB/Simulink model and a practical prototype are presented.

## II. MATHEMATICAL MODELING

Figure 1 shows the basic single-line diagram of a Capacitor Coupled Substation. Transient response characteristics depend on two factors [10]:

- The coupling capacitor value
- Ferro-resonance – Suppression circuit design

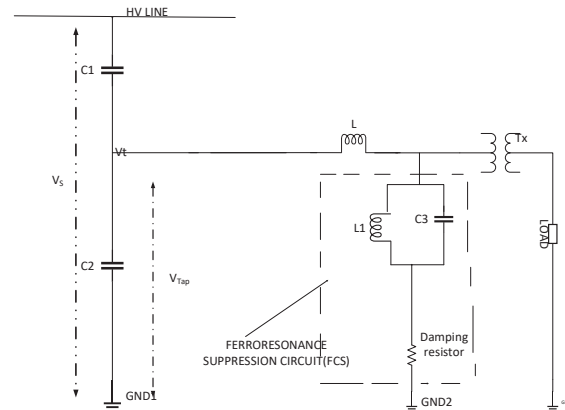


Fig 1 Single line diagram of a CCS [10]

### A. The coupling capacitor value

A CCS is made of a number of capacitor units connected in series. The number of capacitor units depends on the applied primary voltage level. Two values represent the CCS capacitance: one for the equivalent capacitance above the intermediate voltage point ( $C_1$ ) and the other for the intermediate capacitance below the intermediate voltage point ( $C_2$ ). High capacitance value in a CCS decreases the CCS transient magnitude. However, increasing the CCS capacitance value can increase the CCS cost but decreases the

CCS transient response. Hence, design engineers must strike a balance between CCS performance and cost [10] [11].

### B. Ferro-resonance suppression circuit design

Ferro-resonance sometimes called nonlinear resonance is a type of resonance which occurs when a circuit containing a nonlinear inductance is fed from a source that has series capacitance, and the circuit is subjected to a disturbance such as the opening of a switch.

In CCS construction, Ferro-resonance circuit (FRC) is incorporated to suppress any nonlinear resonance called Ferro-resonance. Two types of Ferro-resonance suppression circuit are active and passive Ferro-resonance.

Active Ferro-resonance suppression circuits (AFSC) consists of an LC parallel tuning circuit with a loading resistor. The LC tuning circuit resonates at the system frequency and presents a high impedance voltage to the fundamental voltage. For frequencies above or below the fundamental frequency, the LC parallel resonant impedance gradually reduces to the resistance of the loading resistor and attenuates the energy off-nominal-frequency voltage [12].

Passive Ferro-resonance suppression circuits (PFSC) have permanently connected saturable inductor, loading resistor and an air-gap loading resistor. Once a Ferro-resonance oscillation exists, the induced voltage flashes over the gap and shunts in the loading resistance, to attenuate the oscillation energy [12].

### C. Capacitor selection

Capacitors are chosen in such a way that  $C_1$  is smaller than  $C_2$  by a factor that can give the desired voltage level at the

output [13] , [14]. With  $V_s$  and  $V_{Tap}$  being the supply voltage and Tap voltage (reduced voltage) respectively and the impedances of the capacitance  $C_1$  and  $C_2$  being  $Z_1$  and  $Z_2$ , voltage ratio as a function of the divider impedances or capacitance is written as:

$$V_{tap} = \frac{Z_2}{Z_1 + Z_2} V_s = \frac{C_1}{C_1 + C_2} V_s \quad (1)$$

The coefficient  $\frac{Z_2}{Z_1 + Z_2}$  is the transformation ratio of the system.

The conditions for selection of  $C_1$  and  $C_2$  are detailed in [14].

The FSC block in figure 1 represents the Ferro-resonance suppression circuit. The FSC comprises of a capacitor  $C_3$ , an inductor  $L_1$  connected in parallel and a damping resistor  $R$  connected in series. Values of capacitor  $C_3$ , inductance  $L_1$  and  $R$  are calculated as follows [15]:

$$C_f = C_3 = C_{th} = C_1 + C_2 \quad (2)$$

$$L_1 = L_f \leq \frac{1}{(2\pi f)^2 C_f} \quad (3)$$

$$3\sqrt{L/C} < R < \left(\frac{2}{3}\right)\sqrt{\frac{L}{C}} \quad (4)$$

### III. SIMULATION CASE STUDY AND RESULTS

This section covers MATLAB/Simulink model of CCS used for the case study. The parameters used for simulation are as follows:

Transformer rating 1 KVA, Capacitor  $C_1 = 0.375\mu F$ , Capacitor  $C_2 = 3.075\mu F$ ,  $V_s = 240V$ , Inductor  $L = 3 H$ , Primary side of Transformer = 525 V, Secondary side of Transformer = 220V, Damping resistor = 4.4 k $\Omega$ , Load = 2 k $\Omega$

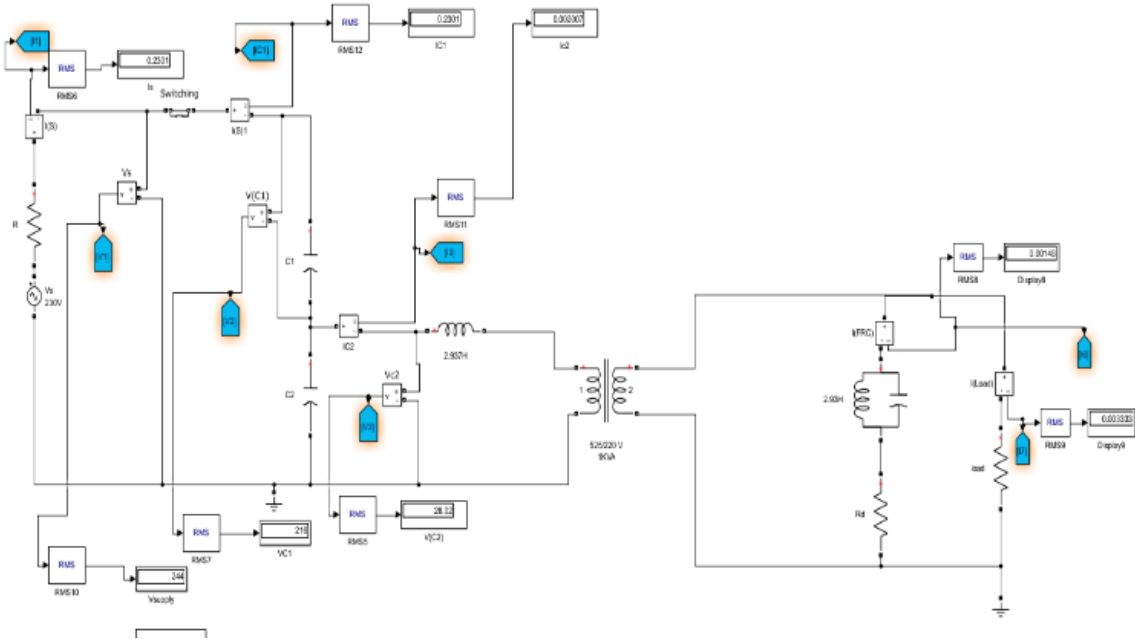


Fig 2 MATLAB/Simulink model of for CCS

### A. CCS with FRC and No Load

A disturbance is initiated by switching of the CCS from supply at 0.3 seconds and switched it back to supply at 0.4 seconds. Figure 3 shows the current and voltage  $I_S$  and  $V_S$  at the point of connection. It can be seen that the Supply Voltage remains stable and the current does not show any inrush when the CCS is switched back on. This shows that the FRC suppresses inrush current.

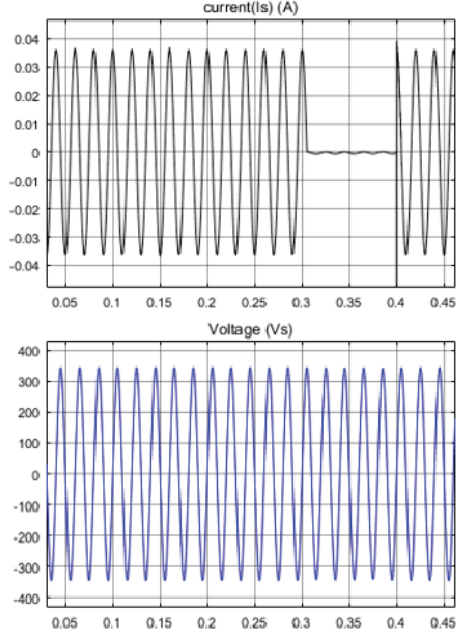


Fig 3 CCS with FRC at No Load:  $V_S$  and  $I_S$

Fig 4 shows the voltage and current  $V_{C1}$  and  $I_{C1}$ , respectively. It can be seen that  $V_{C1}$  and  $I_{C1}$  remained stable after the disturbance.

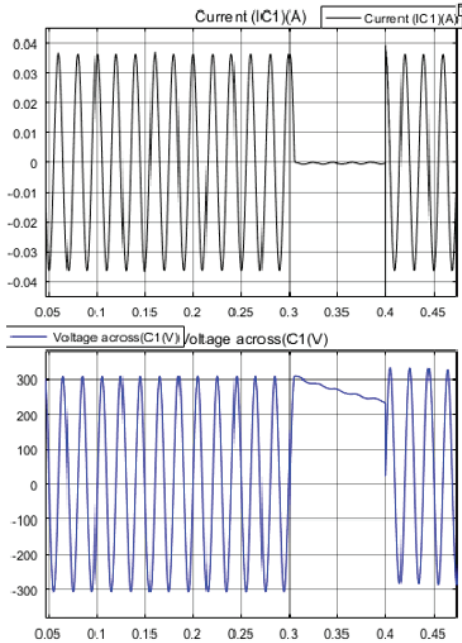


Fig 4 CCS with FRC at No Load:  $V_{C1}$  and  $I_{C1}$

Fig 5 shows the voltage and current  $V_{C2}$  and  $I_{C2}$ , respectively. It can be seen that  $V_{C2}$  discharges to zero during the disturbance, oscillates and stabilised in about 0.2 seconds. The current  $I_{C2}$  fluctuates and stabilise after 0.2 seconds.

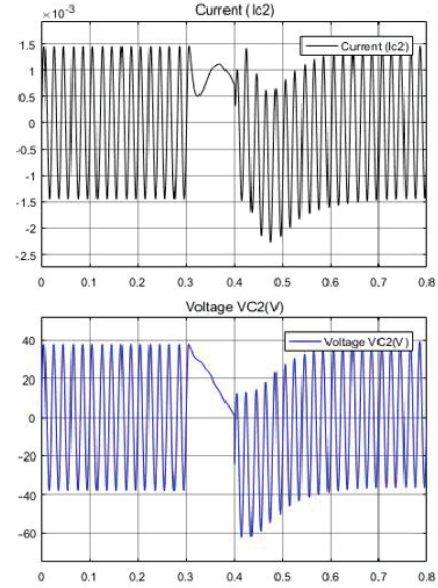


Fig 5 CCS with FRC at No Load:  $V_{C2}$  and  $I_{C2}$

### B. CCS with No FRC and No Load

At this case, the CCS is simulated without an FRC. A disturbance is initiated at 0.3 seconds, which lasted for 0.1 seconds, and power returns at 0.4 seconds.

Figure 6 shows the supply current  $I_S$  and voltage  $V_S$  at the point of connection. It can be seen that the Supply Voltage remains stable, but the current  $I_S$  gives a high inrush current when the CCS is switched back on. Comparing this current with that of figure 3 shows that the FRC is working effectively.

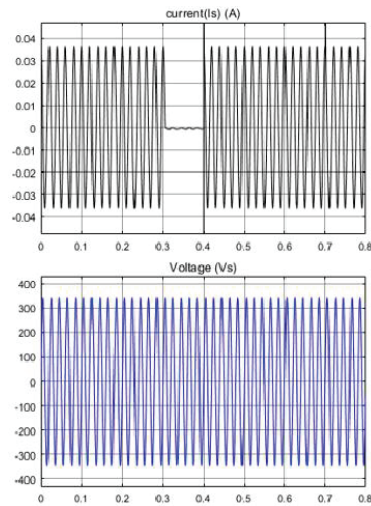


Fig 6 CCS with no FRC at No Load:  $V_S$  and  $I_S$

Fig 7 shows the voltage and current  $V_{C1}$  and  $I_{C1}$ , respectively. It can be seen that  $V_{C1}$  stabilises after the disturbance and current  $I_{C1}$  gave a half cycle of inrush current and settled quickly.

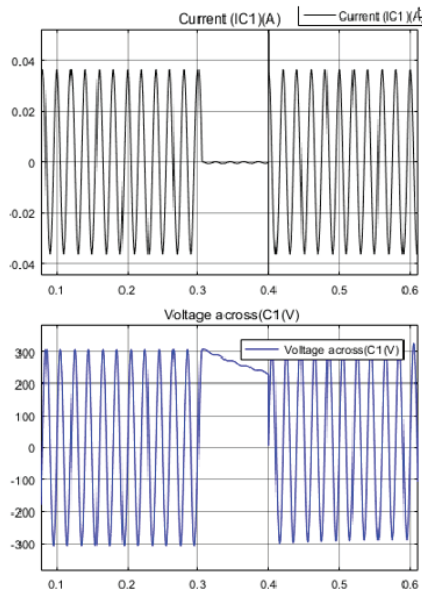


Fig 7 CCS No FRC at No-Load:  $V_{C1}$  and  $I_{C1}$

Fig 8 shows the voltage and current  $V_{C2}$  and  $I_{C2}$ , respectively. It can be seen that  $V_{C2}$  is unstable and oscillates after the disturbance. The current  $I_{C2}$  gives a very high inrush current and continues to fluctuate. Therefore, the FRC circuit is critical in CCS technology, and care must be taken in the selection of the components of FRC for transient stability of CCS.

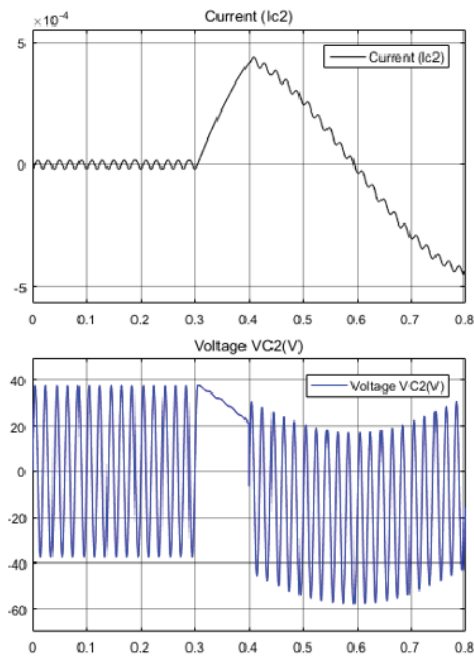


Fig 8 CCS with No FRC at No-Load:  $V_{C2}$  and  $I_{C2}$

#### IV. EXPERIMENTAL SETUP

In order to verify the simulation work, a small prototype of CCS is constructed. Figure 9 shows the experimental prototype, which was developed to verify the concept and the simulation results.

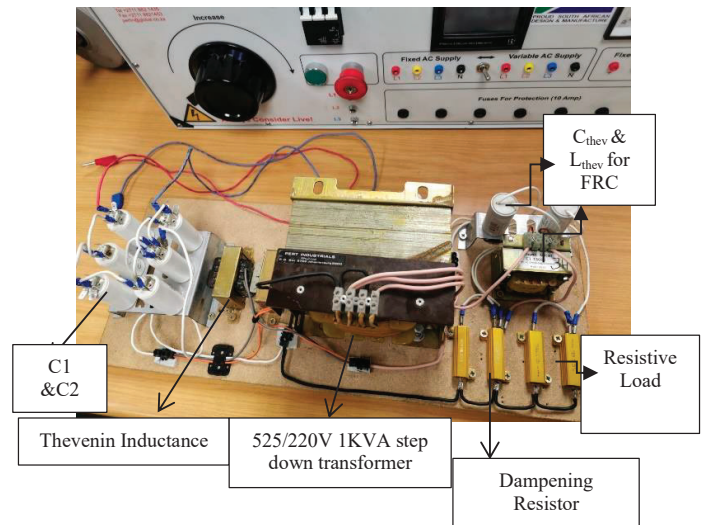


Fig 9 CCS Circuit practical setup

With 240 Vac supply voltage to the CCS, the following readings in table 1 were obtained.

**Table 1: Voltages across measured on the CCS using a multi-meter**

Across $V_{C2}$	32.27V
Across the Thevenin Inductance	20.39V
Primary side of the Transformer	12.97V

##### A. CCS with FRC and No-Load

A disturbance is initiated on the circuit, which lasts for 1 second. From Fig 10 and Fig 11,  $V_{C2}$  Voltage drops and stabilises quicker.

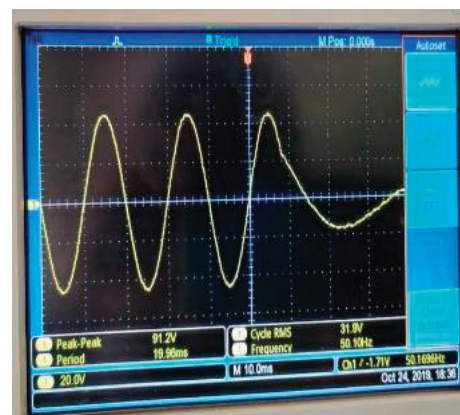


Fig 10 CCS with FRC and No-load:  $V_{C2}$



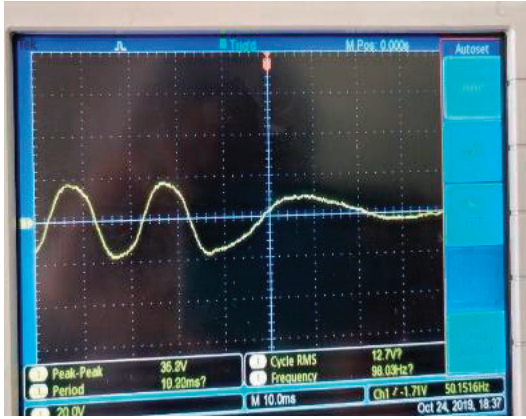


Fig 11 CCS Voltage behaviour at Primary side of the transformer after the Inductance

### B. CCS with No FRC and No Load ( $V_{C2}$ )

A disturbance is initiated on the circuit, which lasts for 1 second. Figure 12 shows that  $V_{C2}$  oscillates when the CCS was switched back on depicting figure 8 of the simulation result.

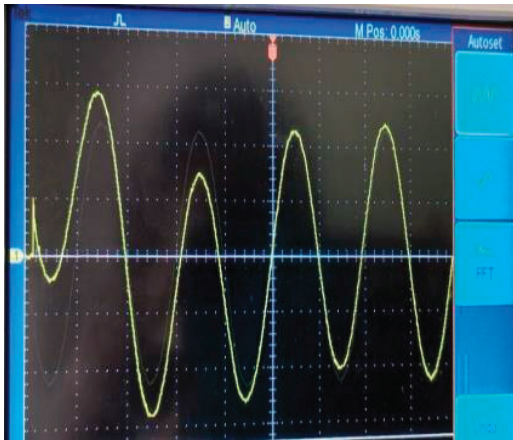


Fig 12 CCS with No FRC and No-load:  $V_{C2}$

## V. CONCLUSION

In this paper, switching transient analysis of capacitor-coupled substation (CCS) is presented. A CCS is modelled and simulated using MATLAB/Simulink, and an experimental prototype is developed for the transient study.

In both simulation and experiment, transient response of the CCS with and without Ferro-resonance circuit is investigated. Among many observations, it was generally observed through that the tapping voltage oscillates when the ferro-resonance circuit is not incorporated. Therefore, FRC circuit is critical in CCS technology, and care must be taken in its selection for transient stability of CCS.

## VI. REFERENCES

- [1] D. Kooijman-van and C. AL, "Impact of electricity access to rural enterprises," *energy for sustainable development* 14(2010) 14-21, Bolivia, Tanzania and Vietnam, 2009.
- [2] E. Cecelski, "Enabling equitable access to rural electrification: current thinking and major activities in energy, poverty and gender," *Energy news* Vol 5 nr 3, 2002.
- [3] Hossein-Zadeh, Nasser and P. Wolfs, "Distribution of Electrical Power to Rural areas- Australian Experience and Implantation Possibility in Developing Countries," in *AUPEC 2009 Proceedings*, 2009.
- [4] N. Chapman, "Features-When One Wire Is Enough-Australia's rural consumers benefit from single-wire earth return systems," in *Transmission and Distribution World* 53.4, 2001.
- [5] F. Iliceto, F. Gatta, P. Masato and H. Sysoulath, "Rural Electrification in Developing Countries with the Shield Wire Scheme. Applications in Laos," *CIGRE paper C6-301*, Paris, 2004.
- [6] M. J. Saulo and T. G. Charles, "Implication of using auxiliary service voltage transformer sub-stations for rural electrification," 2014.
- [7] M. Saulo, C. Gaunt and M. Mbogho, "Comparative Assessment of Capacitor Coupling Sub-station and Auxiliary Service Voltage Transformer for Rural Electrification," in *2nd Annual Kabarak international conference at Kabarak University 16th -18th*, Nakuru, Kenya, 2012(a).
- [8] G. Michael, J. Saulo and C. Trevor, "The impact of capacitor coupled sub-station in rural electrification of Sub-Saharan Africa".
- [9] L. Bolduc, Bouchard and G. Beaulieu, "Capacitor divider substation," in *IEEE Trans Power delivery* Vol 12, July 1997.
- [10] H. Daqing and J. Roberts, "Capacitive Voltage Transformers: Transient Overreach Concerns and Solutions for Distance Relaying," *Schweitzer Engineering Laboratories Inc. Pullman, WA, USA*, 2000.
- [11] T. Raphaelalani, N. Ijumba and A. Jimoh, "Capacitive divider system for feeding a distribution network from an EHV line," *Lusaka*, 2000.
- [12] S. J. Michael, P. Mombasa, G. T. Charles and M. S. Marangi, "Penetration Level of Capacitor Coupling Sub-station on a Power Transmission Network".
- [13] Kulman, "High voltage instrument transformer," in *ABB*, 2006.
- [14] M. J. Saulo, "Penetration Level of Un-Conventional Rural Electrification Technologies on Power Networks," *University of Capetown*, 2014.
- [15] M. Sanaye-Pasand and R. Aghazadeh, "Capacitive Voltage Substations Ferro resonance Prevention using power electronics devices International conference on power system," in *International Conference on Power Systems Transients-IPST*, New Orleans, 2003.