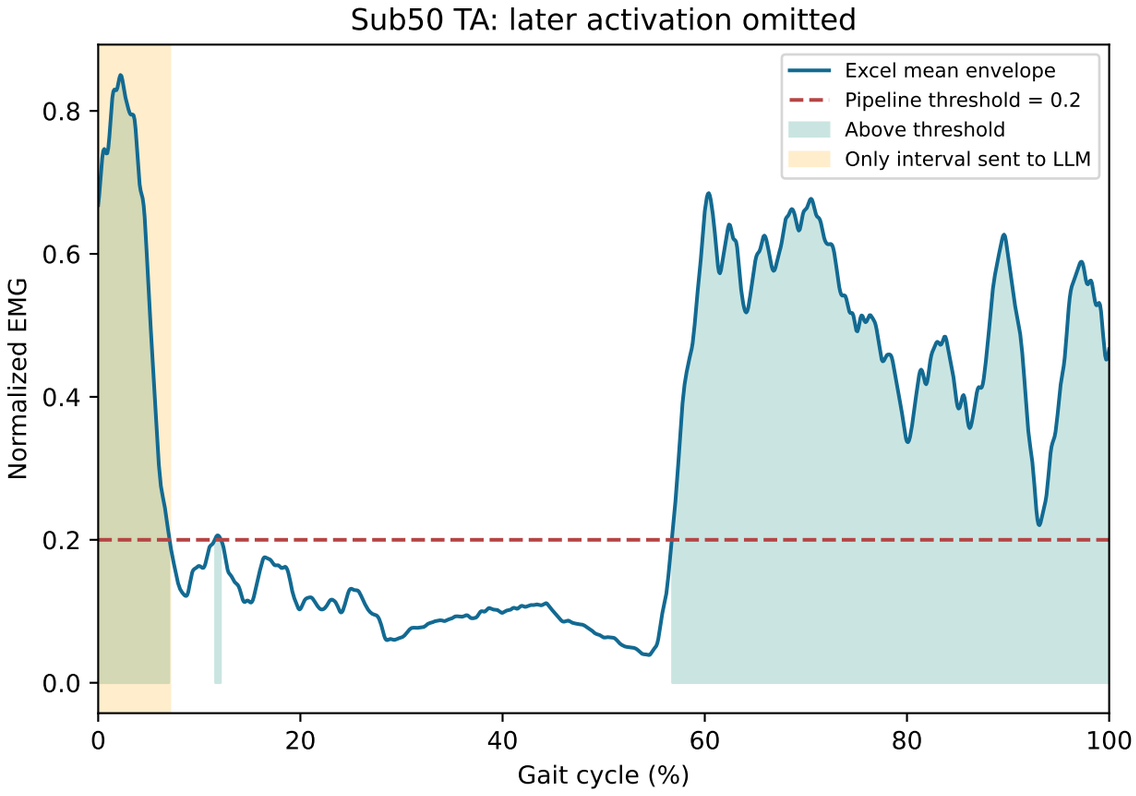
Sub50 TA: later activation omitted
Excel mean envelope
Pipeline threshold = 0.2
Above threshold
Only interval sent to LLM
Normalized EMG
Gait cycle (%)

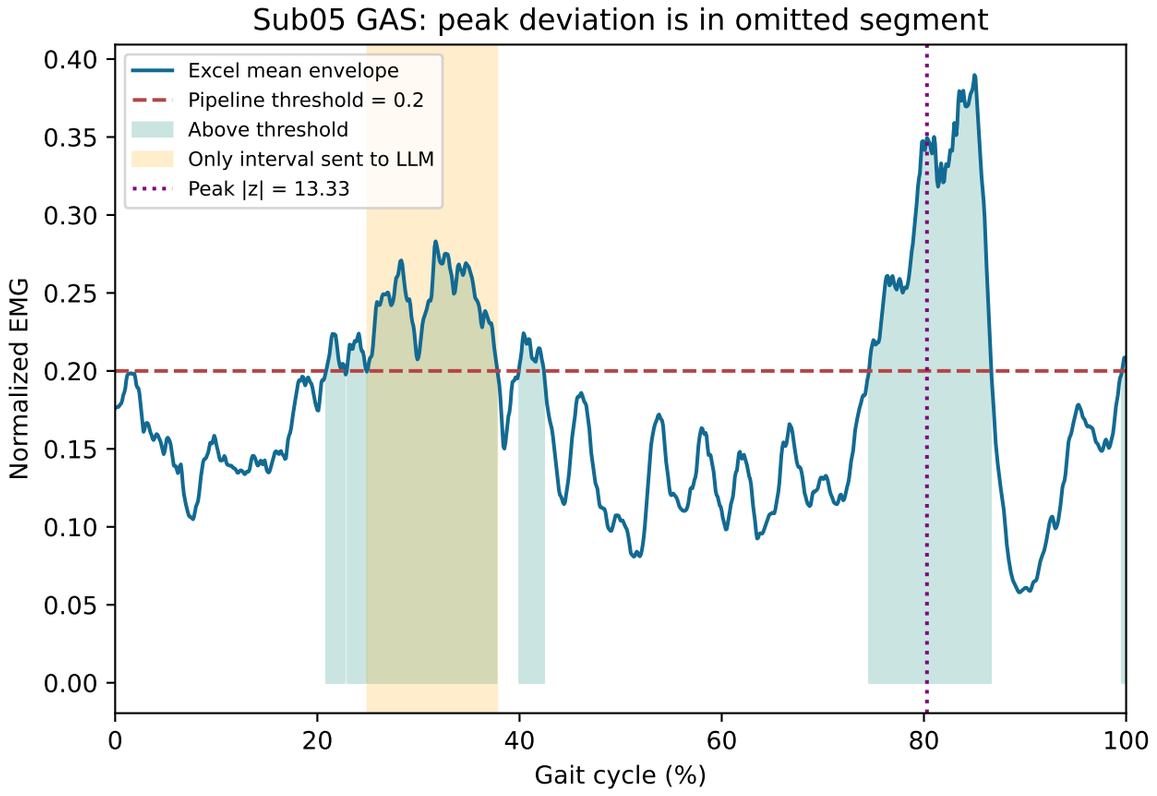
Sub05 GAS: peak deviation is in omitted segment
Excel mean envelope
Pipeline threshold = 0.2
Above threshold
Only interval sent to LLM
Peak |z| = 13.33
Normalized EMG
Gait cycle (%)

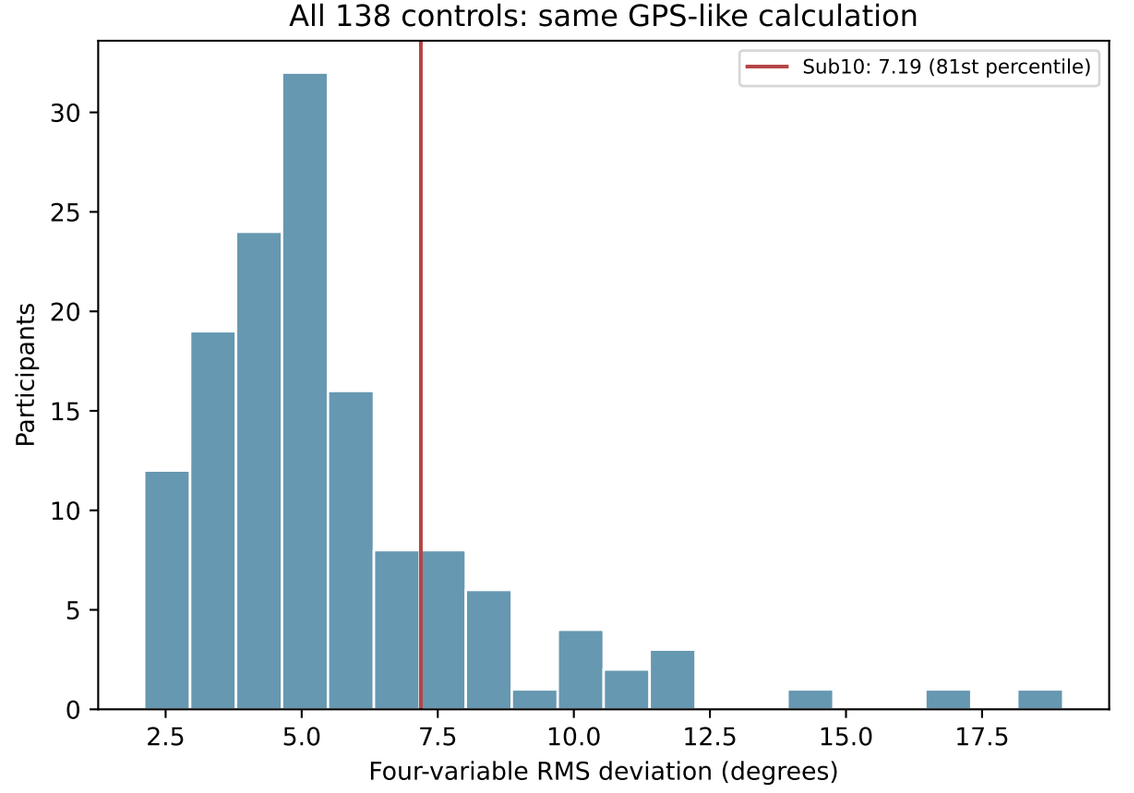
All 138 controls: same GPS-like calculation
Sub10: 7.19 (81st percentile)
Participants
Four-variable RMS deviation (degrees)

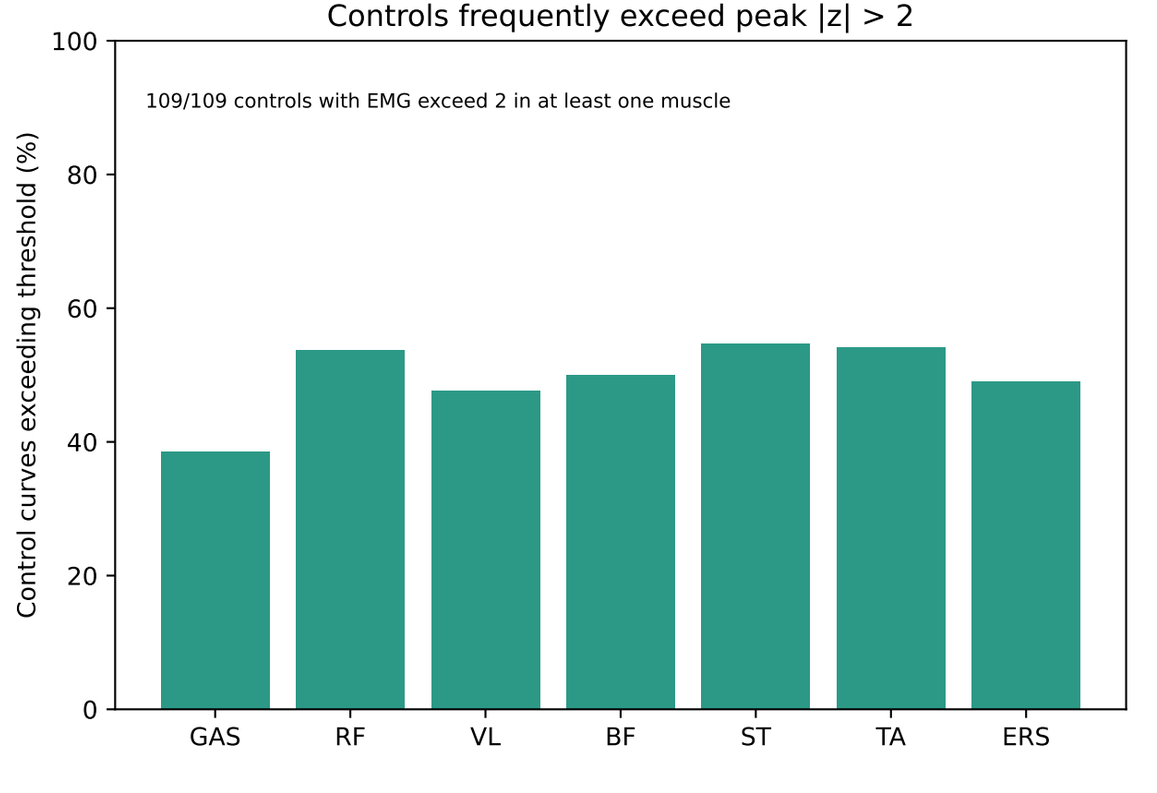
Controls frequently exceed peak |z| > 2
109/109 controls with EMG exceed 2 in at least one muscle
Control curves exceeding threshold (%)
GAS
RF
VL
BF
ST
TA
ERS