


同為 $s = 1.0 \times 10^{-3} \text{ M}$ ，化學計量係數使離子濃度與 K_{sp} 形式不同



$$K_{sp} = s^2 = 1.0 \times 10^{-6}$$

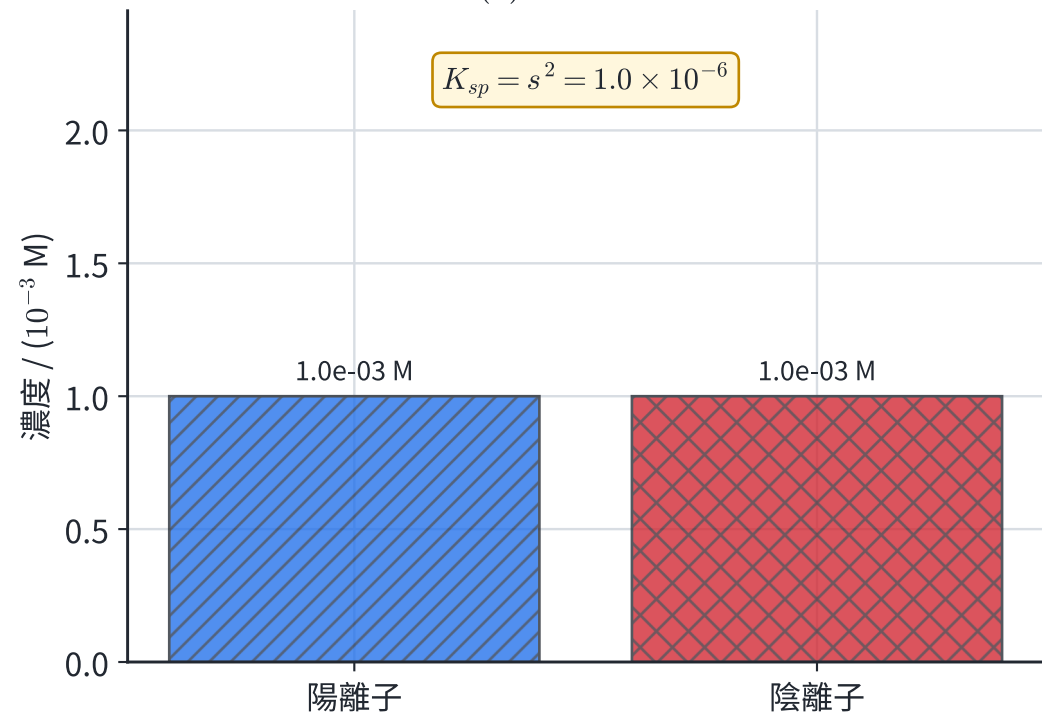

$$K_{sp} = s(2s)^2 = 4.0 \times 10^{-9}$$

