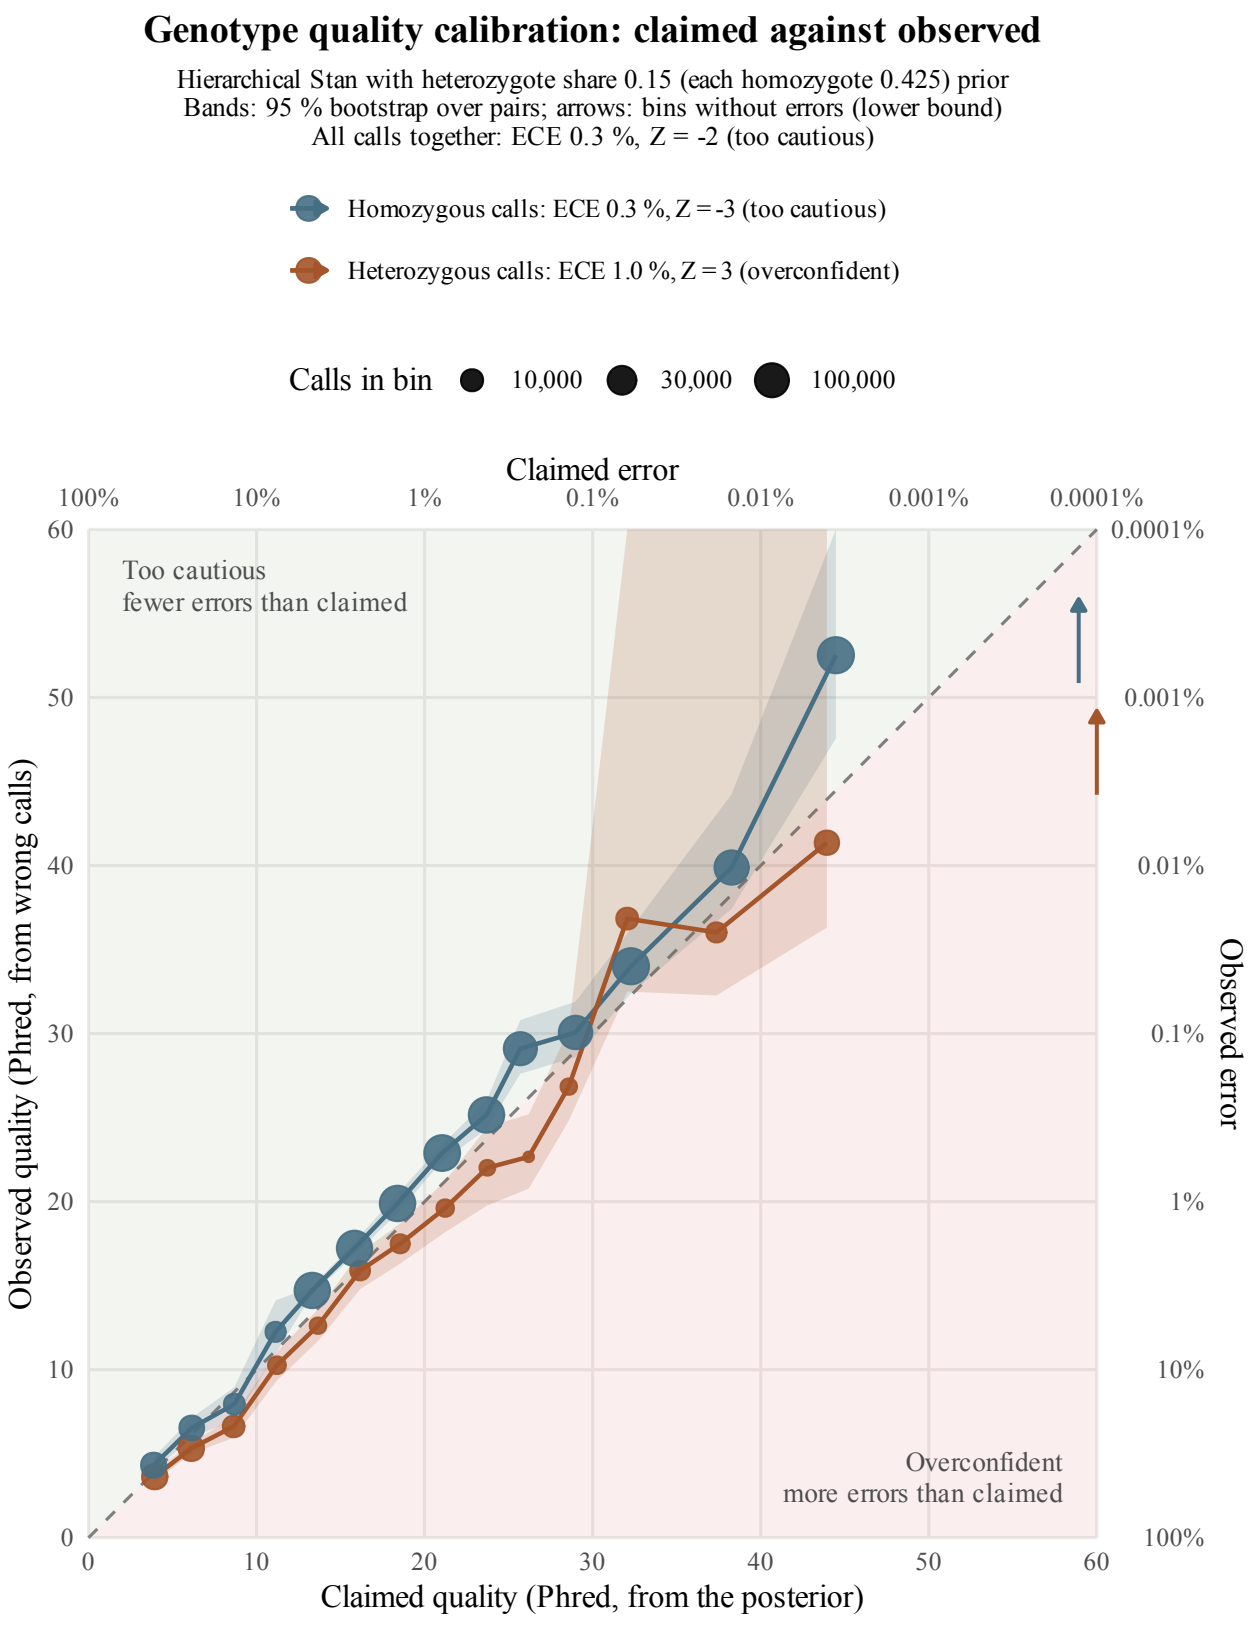
Genotype quality calibration: claimed against observed
Hierarchical Stan with heterozygote share 0.15 (each homozygote 0.425) prior
Bands: 95 % bootstrap over pairs; arrows: bins without errors (lower bound)
All calls together: ECE 0.3 %, Z = -2 (too cautious)
Homozygous calls: ECE 0.3 %, Z = -3 (too cautious)
Heterozygous calls: ECE 1.0 %, Z = 3 (overconfident)
Calls in bin
10,000
30,000
100,000
Claimed error
100%
10%
1%
0.1%
0.01%
0.001%
0.0001%
Too cautious
fewer errors than claimed
Overconfident
more errors than claimed
Observed quality (Phred, from wrong calls)
Observed error
Claimed quality (Phred, from the posterior)
0
10
20
30
40
50
60