Trials → assessment mean → innovation

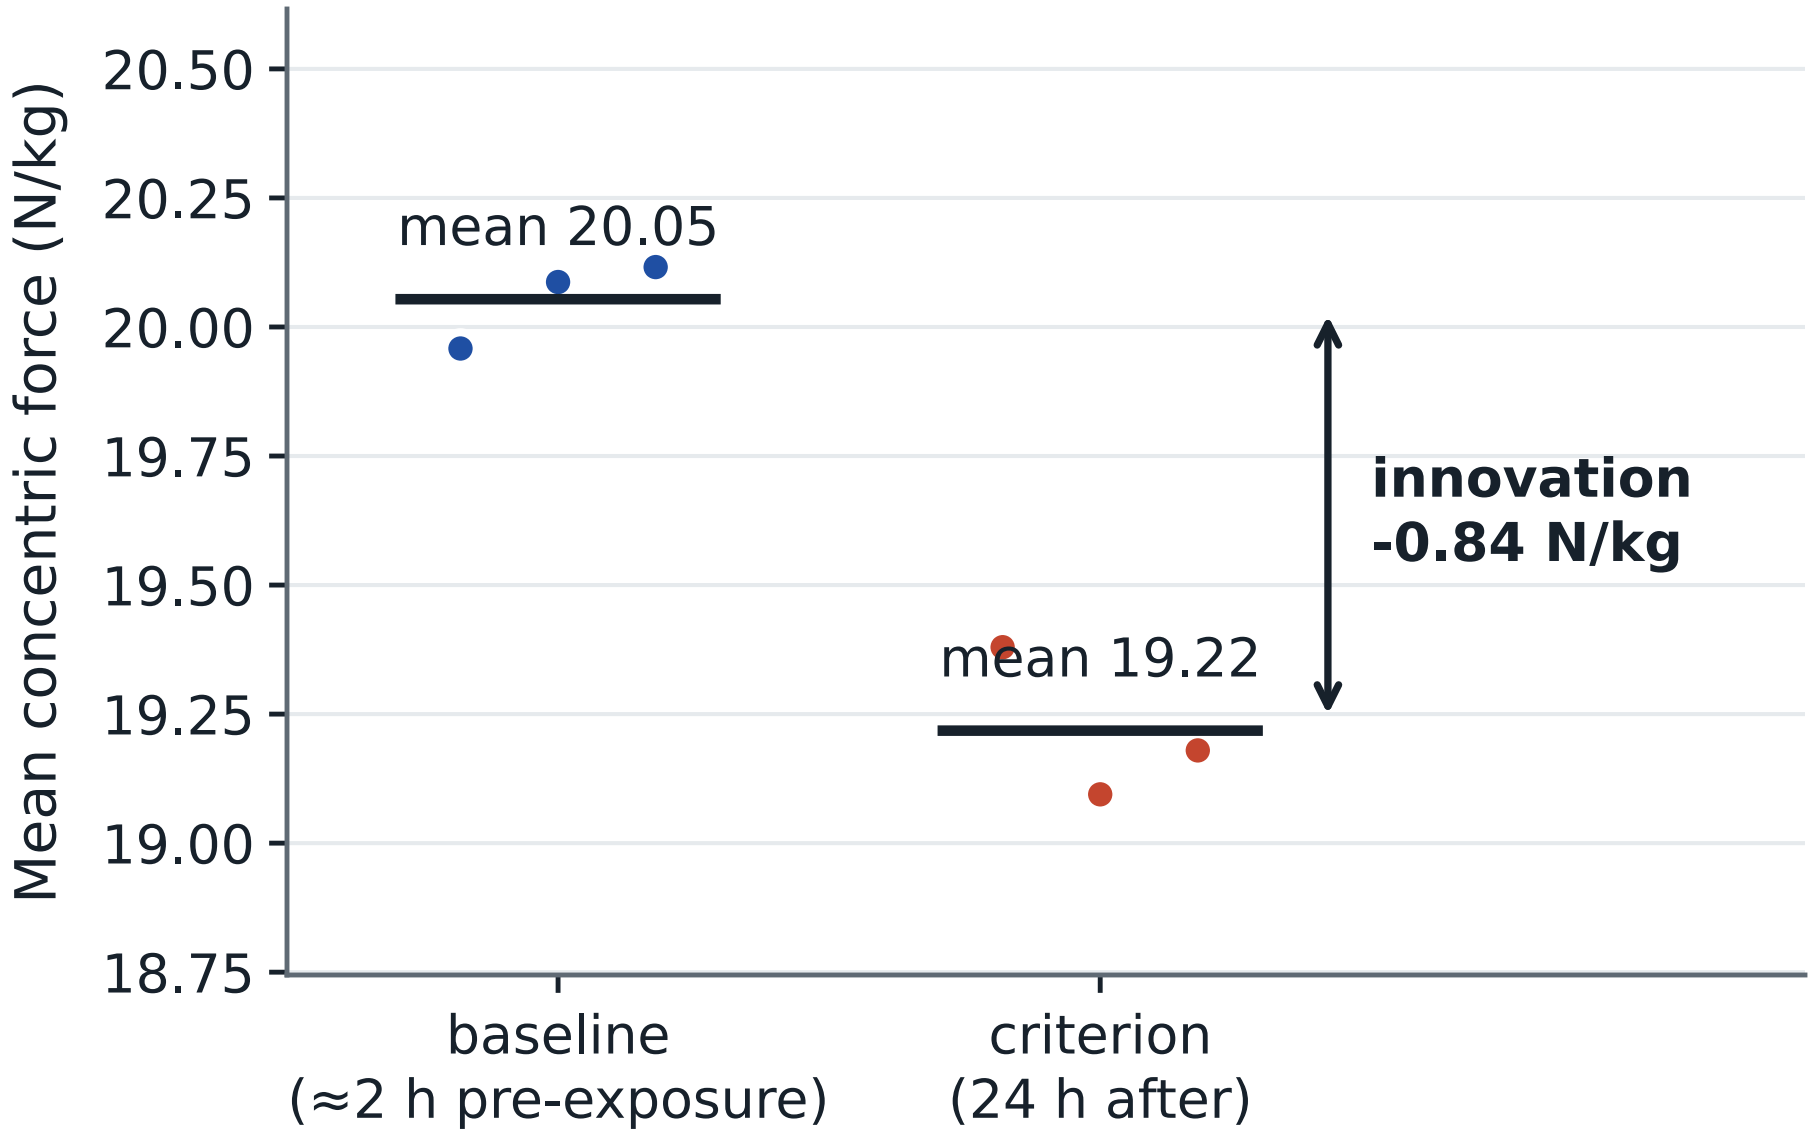

Illustrative: truth 20 N/kg, a_f = 0.04, a_s = 0.03;
trial noise from the generator's measurement model.