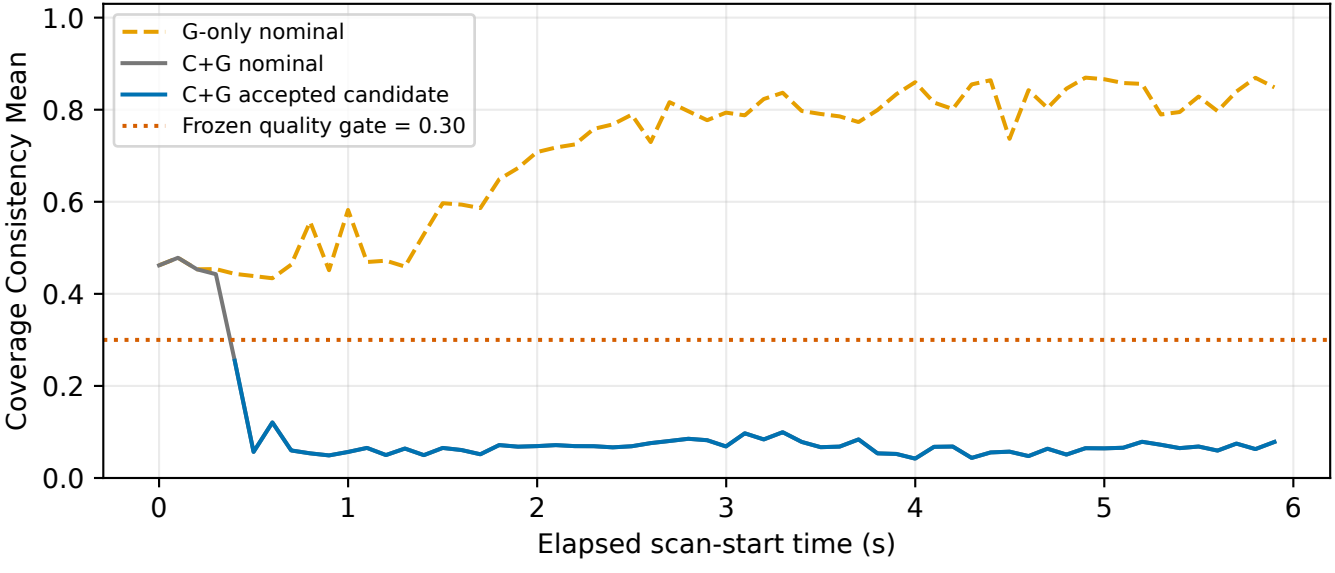
G-only nominal
C+G nominal
C+G accepted candidate
Frozen quality gate = 0.30
Coverage Consistency Mean
1.0
0.8
0.6
0.4
0.2
0.0
0
1
2
3
4
5
6
Elapsed scan-start time (s)