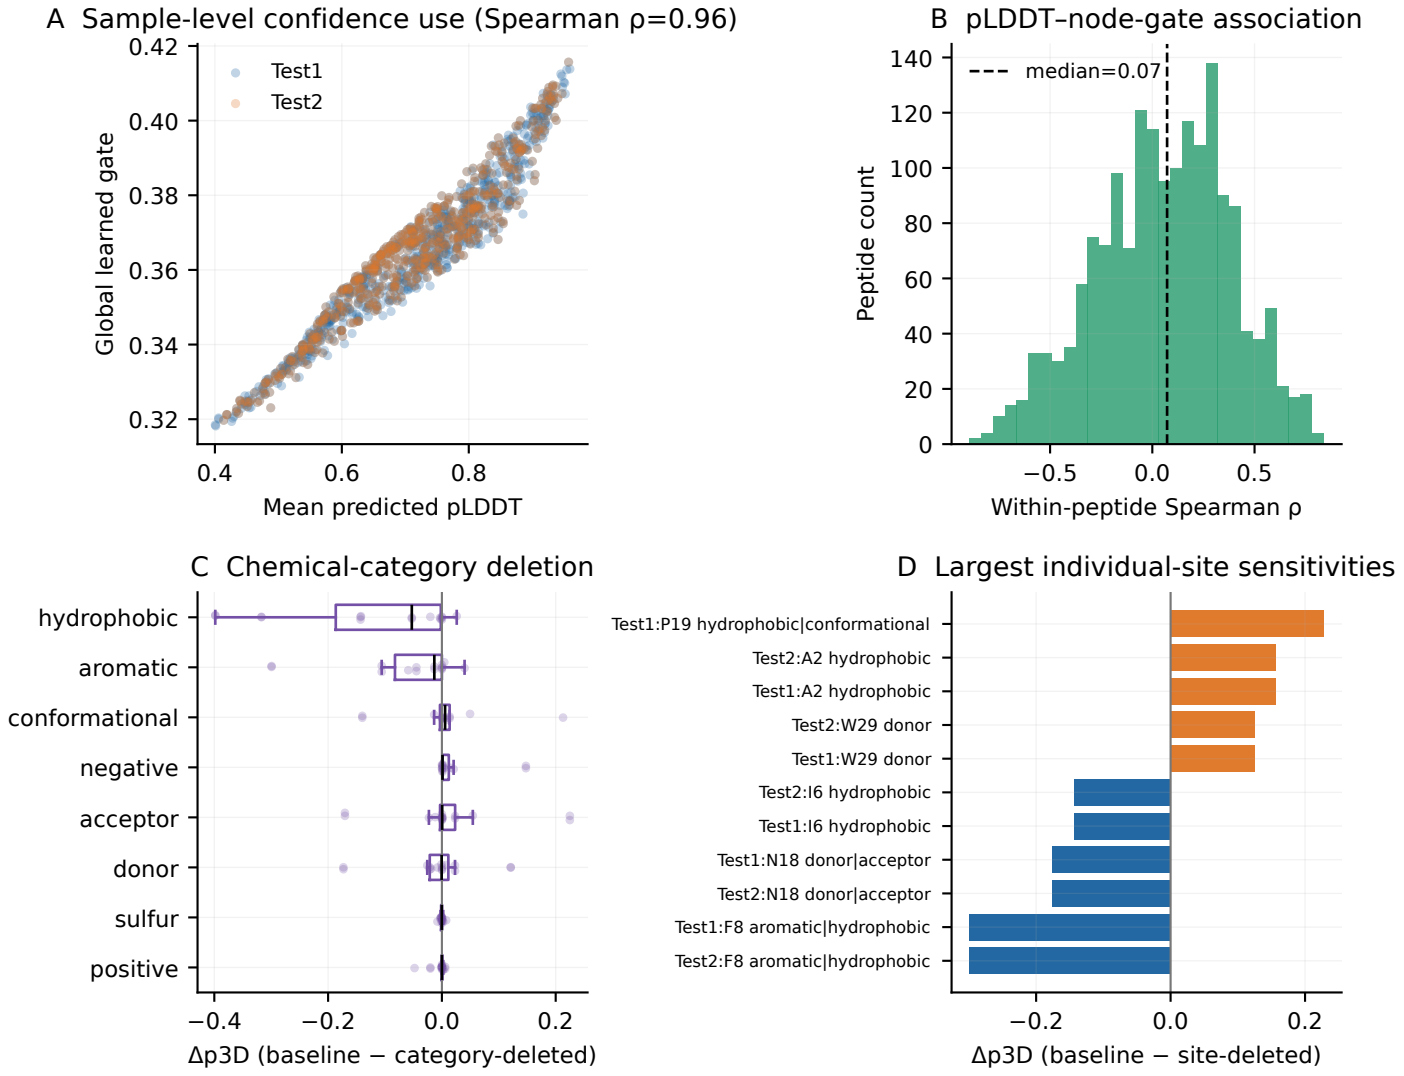
A Sample-level confidence use (Spearman ρ=0.96)
Test1
Test2
Global learned gate
Mean predicted pLDDT
B pLDDT–node-gate association
median=0.07
Peptide count
Within-peptide Spearman ρ
C Chemical-category deletion
hydrophobic
aromatic
conformational
negative
acceptor
donor
sulfur
positive
Δp3D (baseline − category-deleted)
D Largest individual-site sensitivities
Test1:P19 hydrophobic|conformational
Test2:A2 hydrophobic
Test1:A2 hydrophobic
Test2:W29 donor
Test1:W29 donor
Test2:I6 hydrophobic
Test1:I6 hydrophobic
Test1:N18 donor|acceptor
Test2:N18 donor|acceptor
Test1:F8 aromatic|hydrophobic
Test2:F8 aromatic|hydrophobic
Δp3D (baseline − site-deleted)