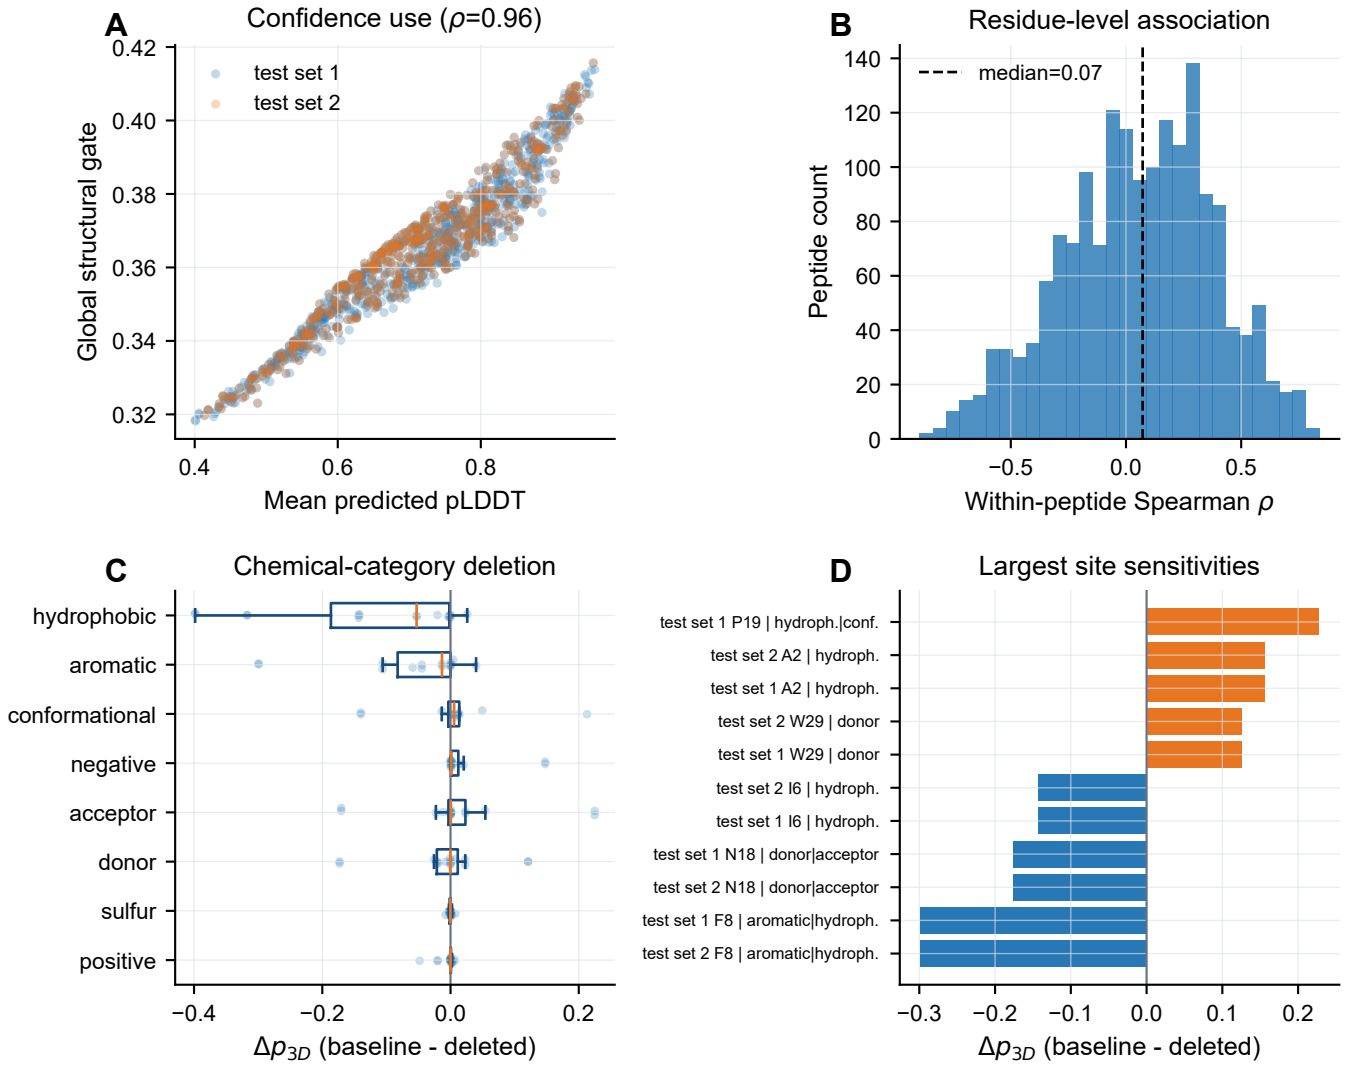

A
Confidence use (ρ=0.96)
test set 1
test set 2
Global structural gate
Mean predicted pLDDT
B
Residue-level association
median=0.07
Peptide count
Within-peptide Spearman ρ
C
Chemical-category deletion
hydrophobic
aromatic
conformational
negative
acceptor
donor
sulfur
positive
Δp3D (baseline - deleted)
D
Largest site sensitivities
test set 1 P19 | hydroph.|conf.
test set 2 A2 | hydroph.
test set 1 A2 | hydroph.
test set 2 W29 | donor
test set 1 W29 | donor
test set 2 I6 | hydroph.
test set 1 I6 | hydroph.
test set 1 N18 | donor|acceptor
test set 2 N18 | donor|acceptor
test set 1 F8 | aromatic|hydroph.
test set 2 F8 | aromatic|hydroph.
Δp3D (baseline - deleted)