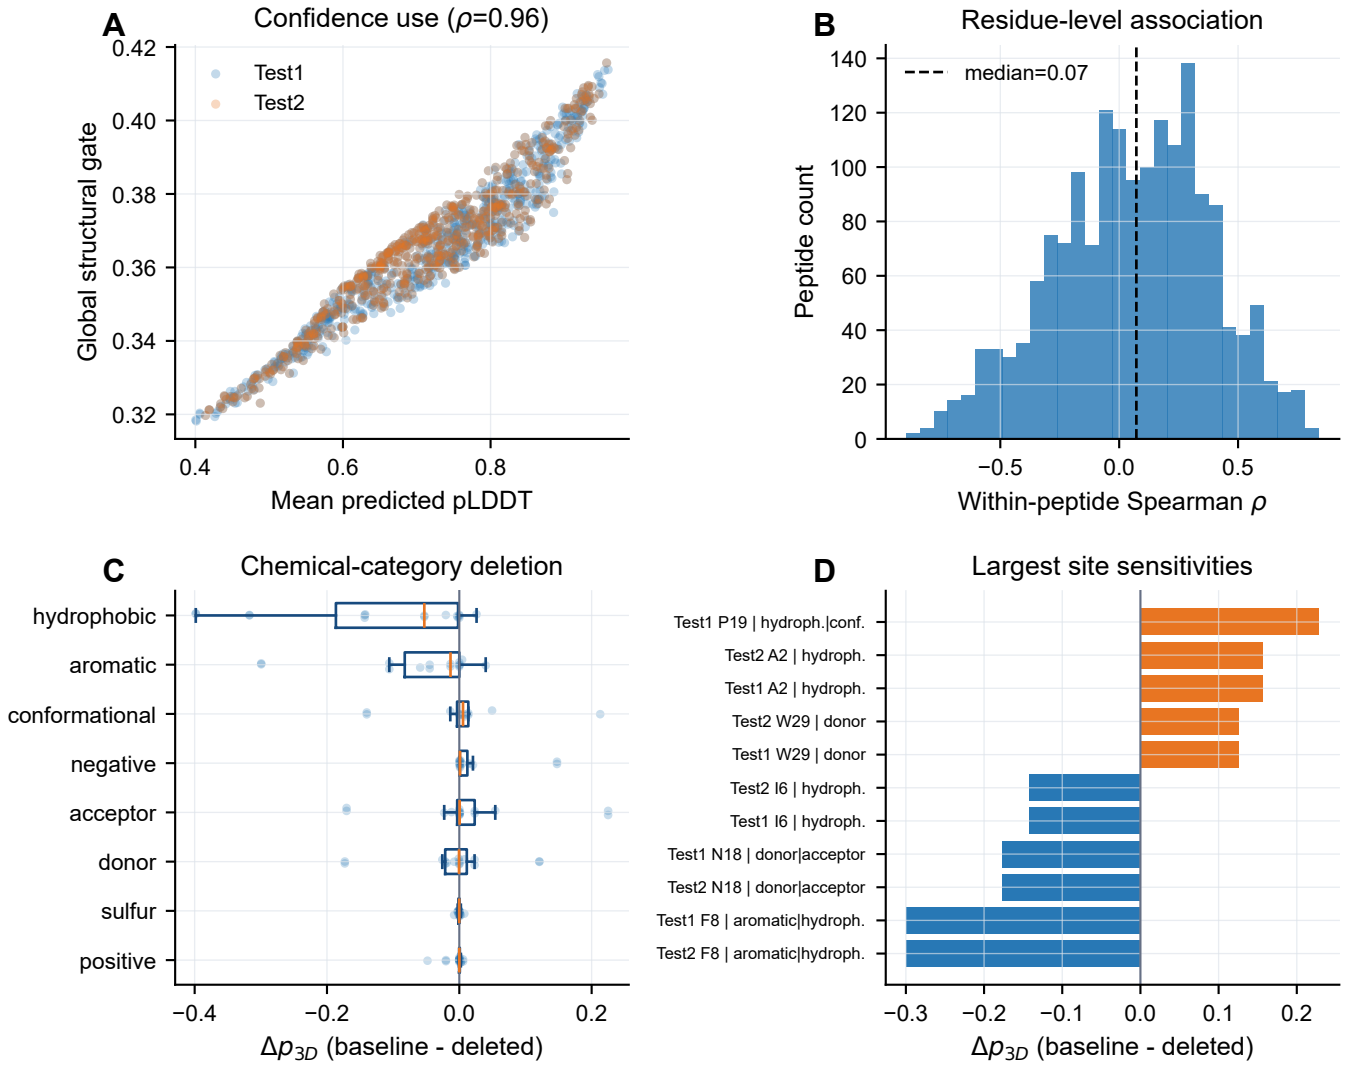

A
Confidence use (ρ=0.96)
Test1
Test2
Global structural gate
Mean predicted pLDDT
B
Residue-level association
median=0.07
Peptide count
Within-peptide Spearman ρ
C
Chemical-category deletion
hydrophobic
aromatic
conformational
negative
acceptor
donor
sulfur
positive
Δp3D (baseline - deleted)
D
Largest site sensitivities
Test1 P19 | hydroph.|conf.
Test2 A2 | hydroph.
Test1 A2 | hydroph.
Test2 W29 | donor
Test1 W29 | donor
Test2 I6 | hydroph.
Test1 I6 | hydroph.
Test1 N18 | donor|acceptor
Test2 N18 | donor|acceptor
Test1 F8 | aromatic|hydroph.
Test2 F8 | aromatic|hydroph.
Δp3D (baseline - deleted)