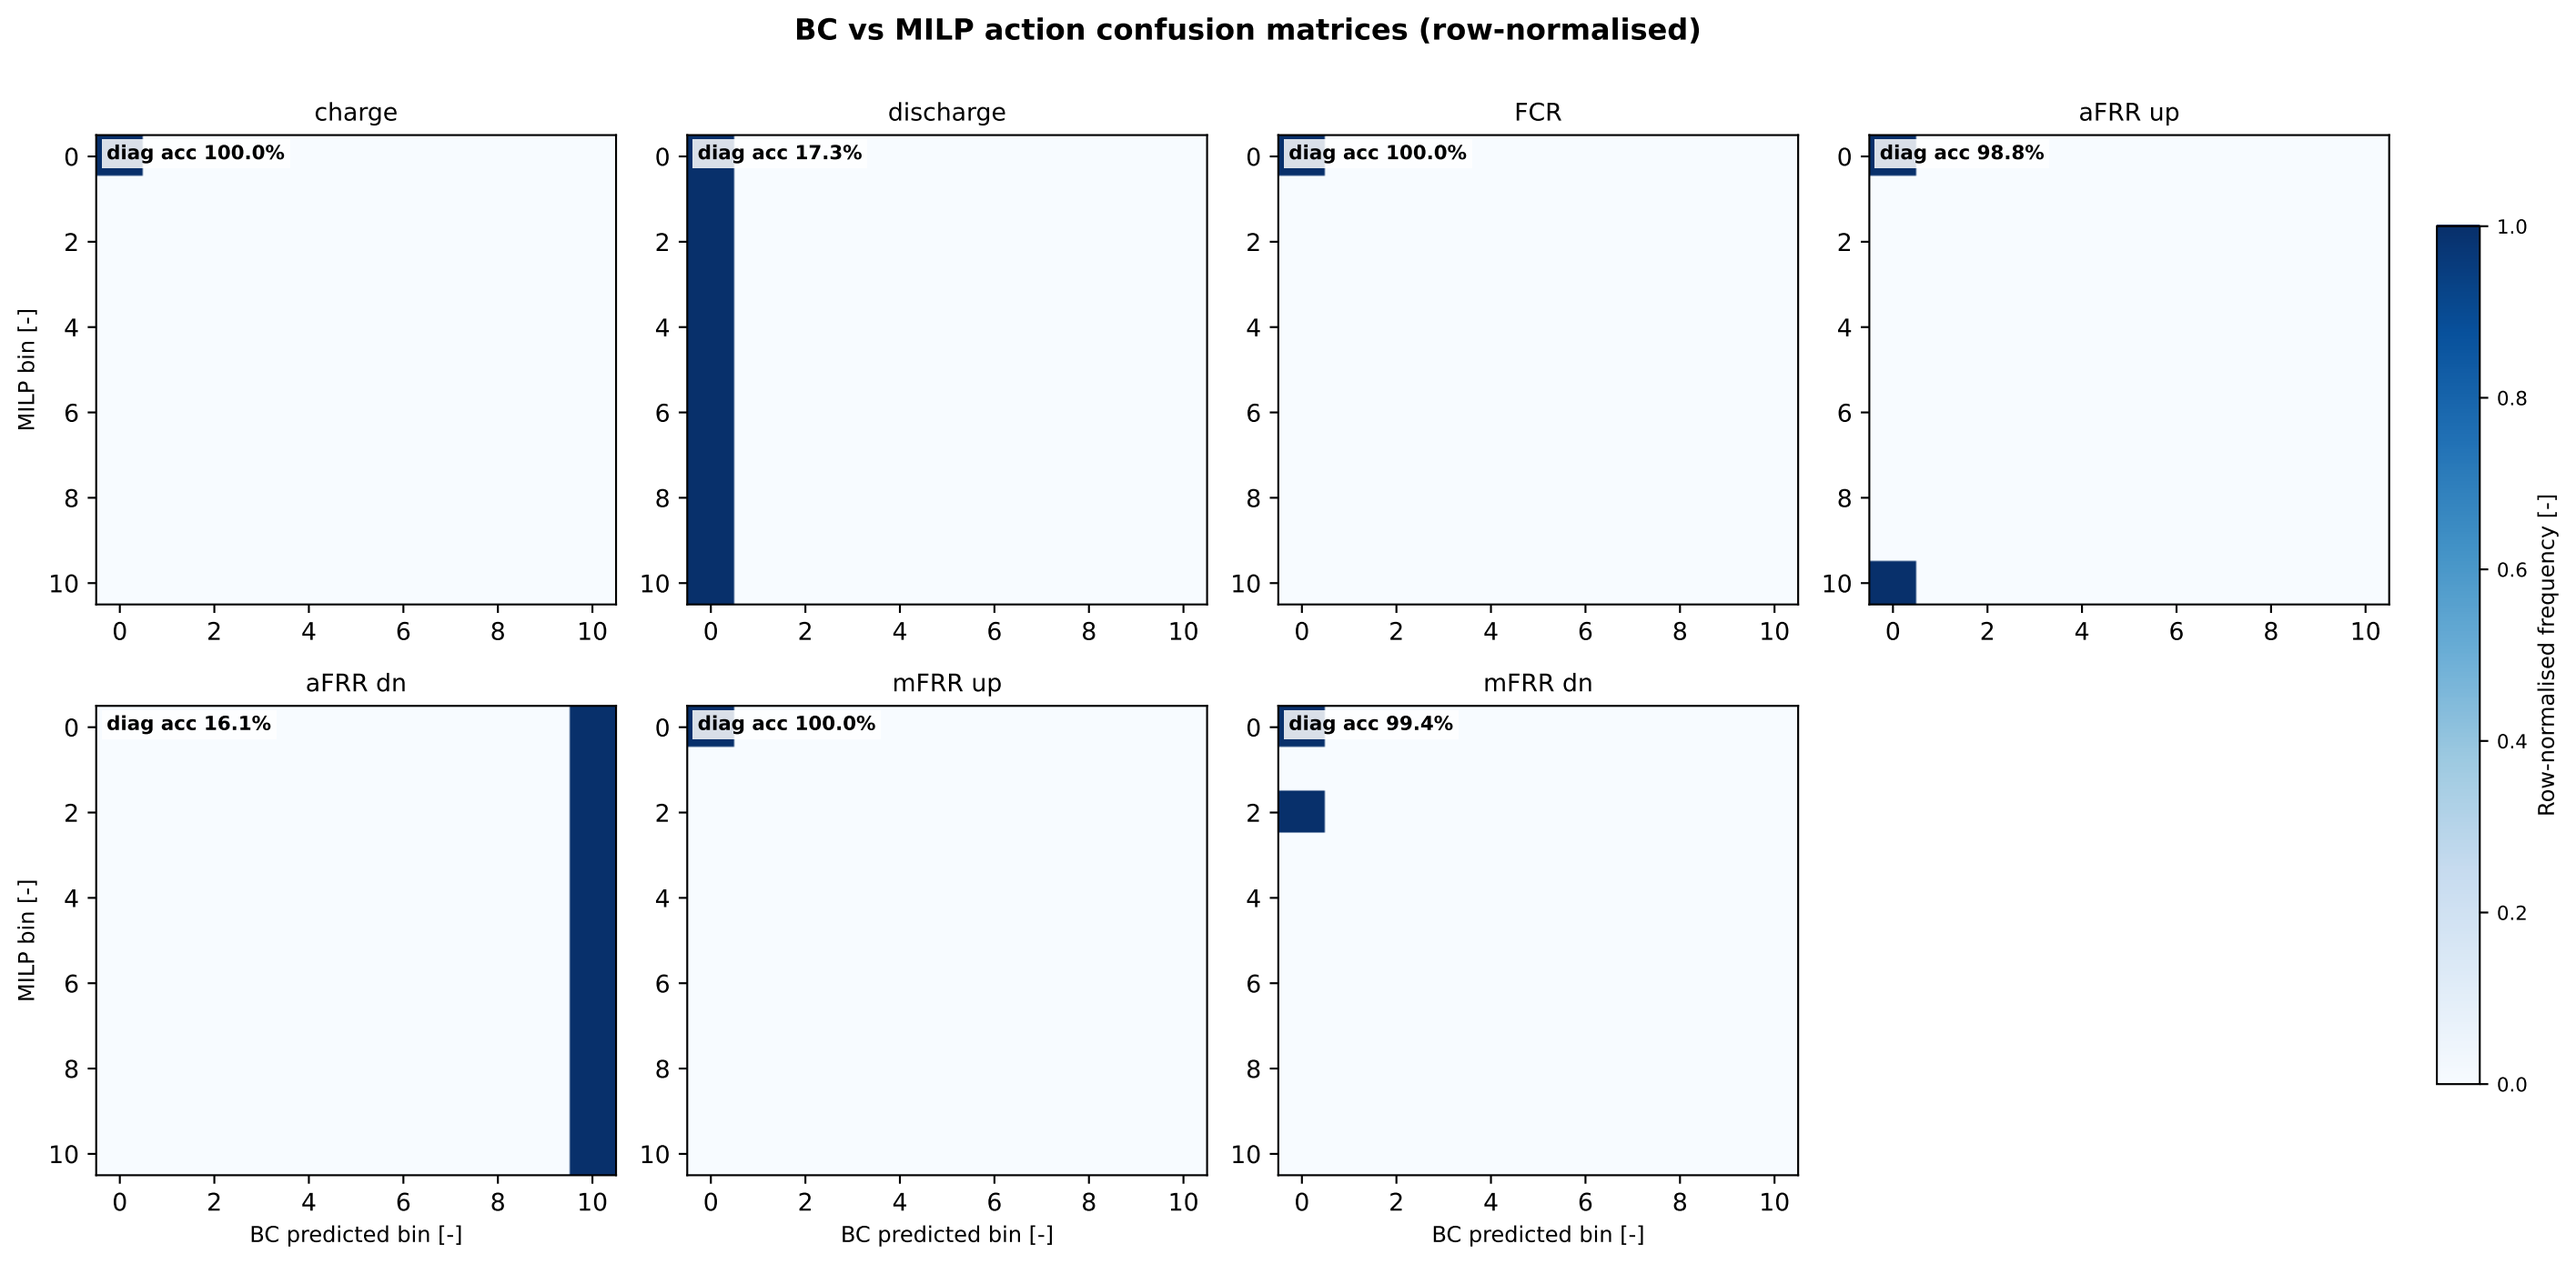
BC vs MILP action confusion matrices (row-normalised)
charge
diag acc 100.0%
discharge
diag acc 17.3%
FCR
diag acc 100.0%
aFRR up
diag acc 98.8%
aFRR dn
diag acc 16.1%
mFRR up
diag acc 100.0%
mFRR dn
diag acc 99.4%
MILP bin [-]
BC predicted bin [-]
Row-normalised frequency [-]
0
2
4
6
8
10
0.0
0.2
0.4
0.6
0.8
1.0