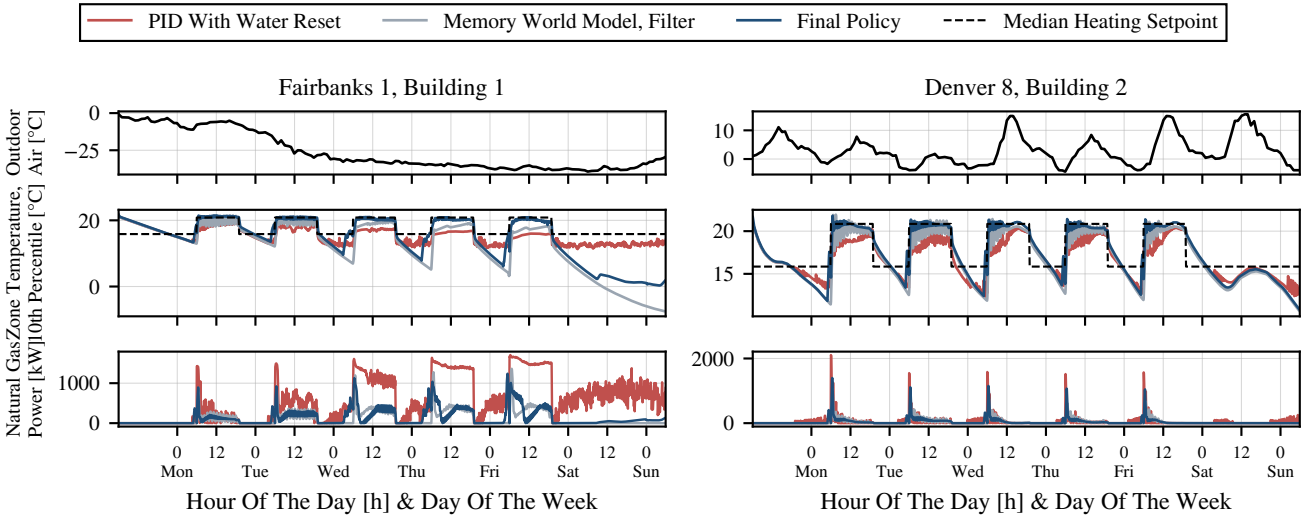

PID With Water Reset
Memory World Model, Filter
Final Policy
Median Heating Setpoint
Fairbanks 1, Building 1
Denver 8, Building 2
Natural GasZone Temperature, Outdoor Power [kW]10th Percentile [°C] Air [°C]
0
−25
20
0
1000
0
10
0
20
15
2000
0
0 12 0 12 0 12 0 12 0 12 0 12 0
Mon Tue Wed Thu Fri Sat Sun
Hour Of The Day [h] & Day Of The Week