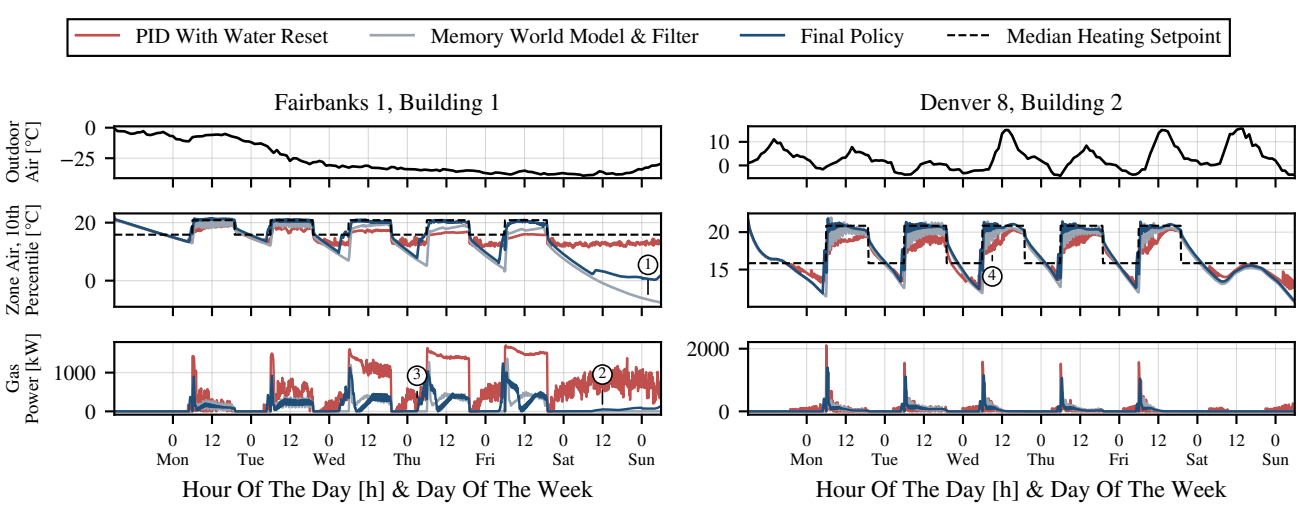

PID With Water Reset
Memory World Model & Filter
Final Policy
Median Heating Setpoint
Fairbanks 1, Building 1
Denver 8, Building 2
Outdoor Air [°C]
Zone Air, 10th Percentile [°C]
Gas Power [kW]
0
−25
10
20
15
1000
2000
1
2
3
4
0 12 0 12 0 12 0 12 0 12 0 12 0 12 0
Mon Tue Wed Thu Fri Sat Sun
Hour Of The Day [h] & Day Of The Week