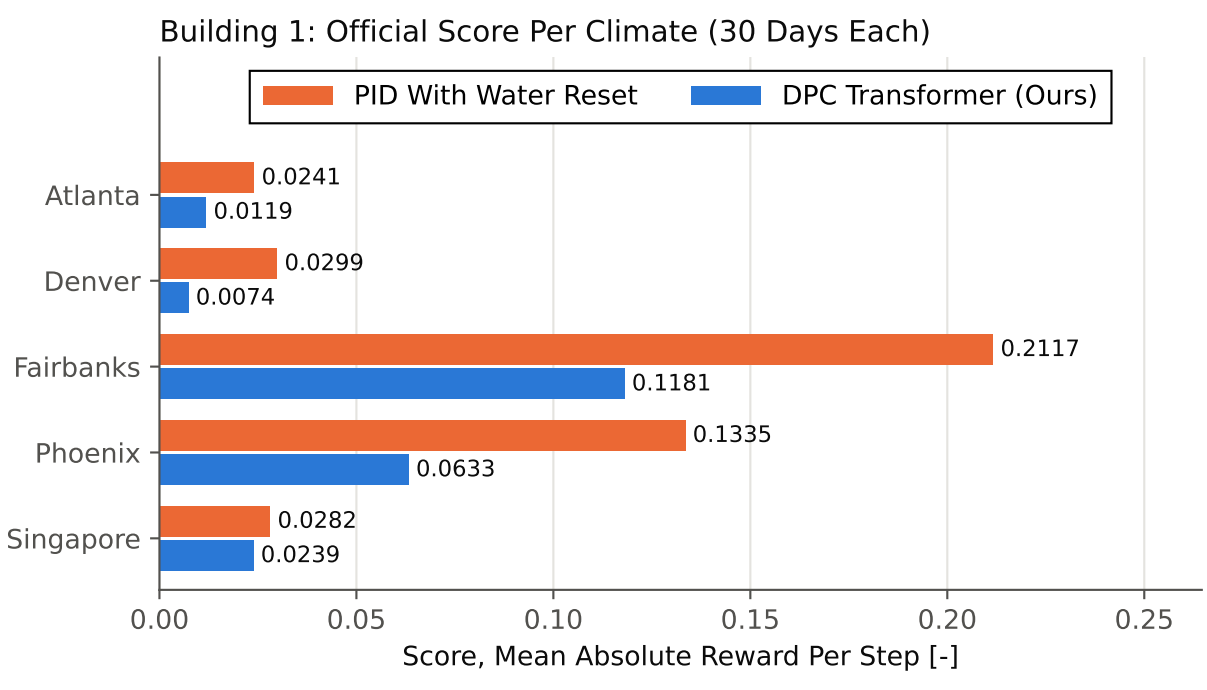
Building 1: Official Score Per Climate (30 Days Each)
PID With Water Reset
DPC Transformer (Ours)
Atlanta
0.0241
0.0119
Denver
0.0299
0.0074
Fairbanks
0.2117
0.1181
Phoenix
0.1335
0.0633
Singapore
0.0282
0.0239
0.00
0.05
0.10
0.15
0.20
0.25
Score, Mean Absolute Reward Per Step [-]