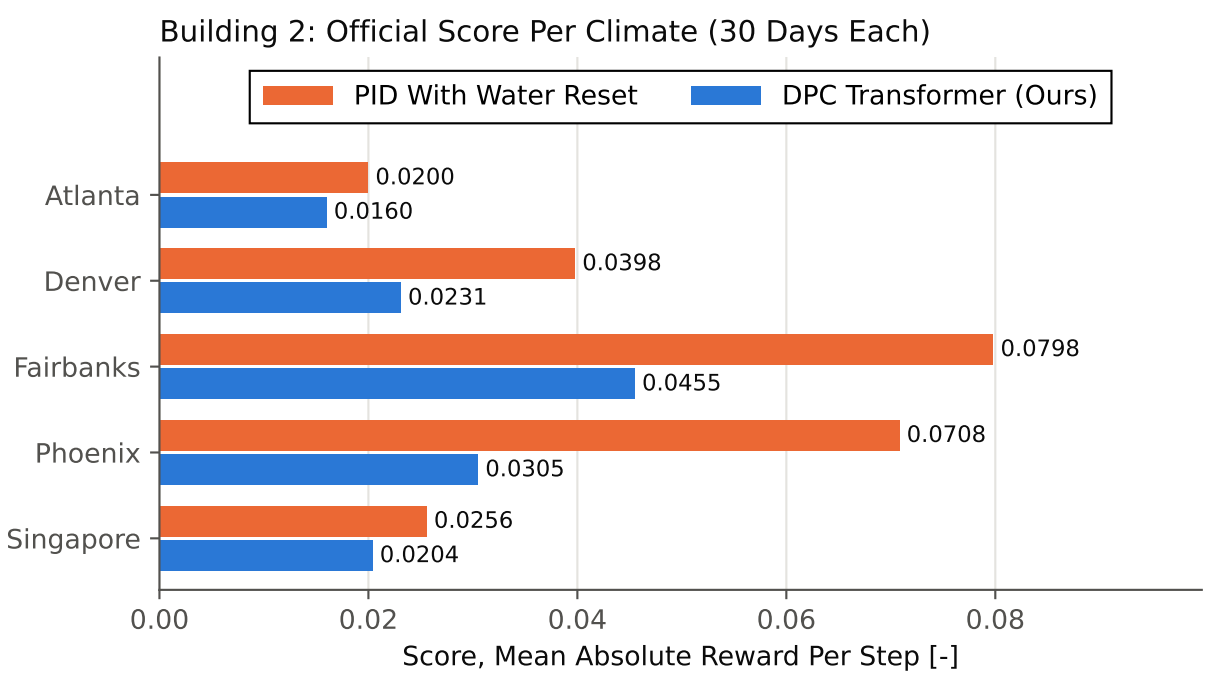
Building 2: Official Score Per Climate (30 Days Each)
PID With Water Reset
DPC Transformer (Ours)
Atlanta
Denver
Fairbanks
Phoenix
Singapore
0.0200
0.0160
0.0398
0.0231
0.0798
0.0455
0.0708
0.0305
0.0256
0.0204
0.00
0.02
0.04
0.06
0.08
Score, Mean Absolute Reward Per Step [-]