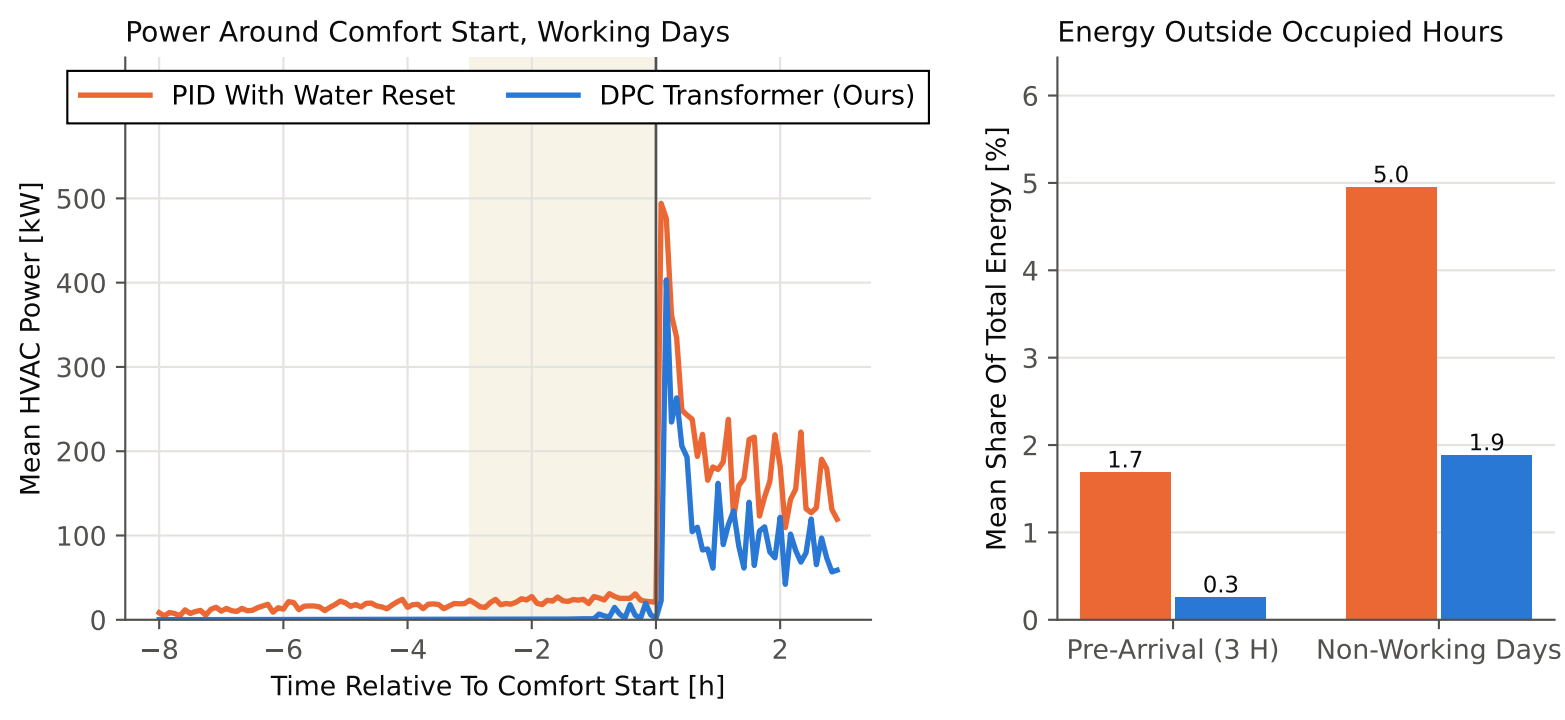
Power Around Comfort Start, Working Days
PID With Water Reset
DPC Transformer (Ours)
Mean HVAC Power [kW]
0
100
200
300
400
500
−8
−6
−4
−2
0
2
Time Relative To Comfort Start [h]
Energy Outside Occupied Hours
Mean Share Of Total Energy [%]
0
1
2
3
4
5
6
1.7
0.3
5.0
1.9
Pre-Arrival (3 H)
Non-Working Days