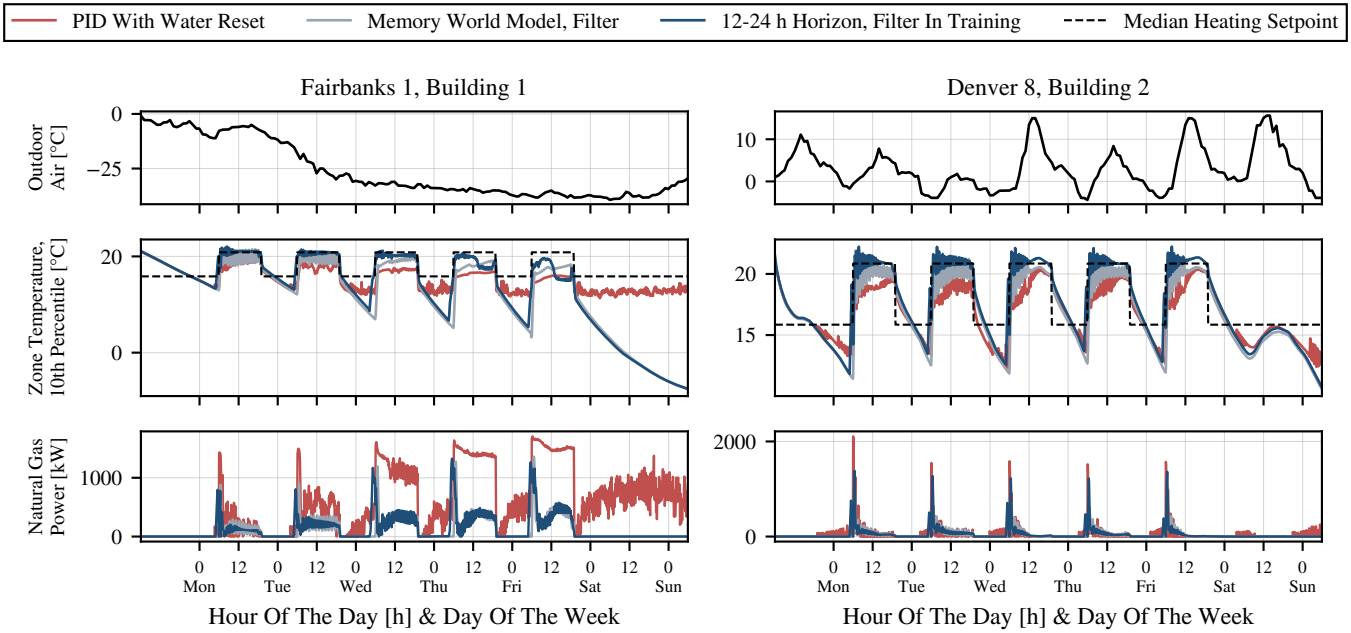

PID With Water Reset
Memory World Model, Filter
12-24 h Horizon, Filter In Training
Median Heating Setpoint
Fairbanks 1, Building 1
Denver 8, Building 2
Outdoor Air [°C]
Zone Temperature, 10th Percentile [°C]
Natural Gas Power [kW]
0
−25
10
20
15
1000
2000
Mon
Tue
Wed
Thu
Fri
Sat
Sun
Hour Of The Day [h] & Day Of The Week