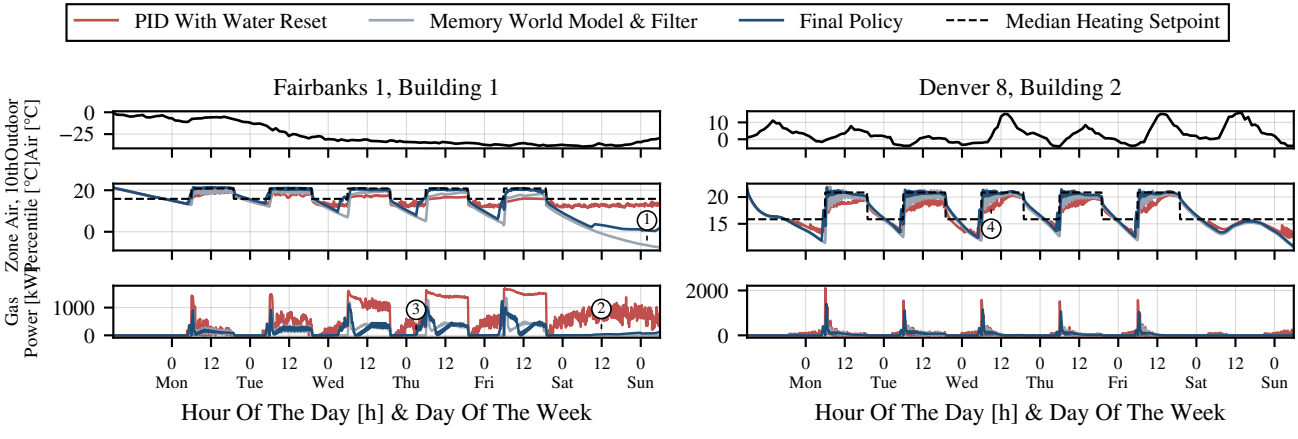

PID With Water Reset
Memory World Model & Filter
Final Policy
Median Heating Setpoint
Fairbanks 1, Building 1
Denver 8, Building 2
Outdoor Air, 10th Percentile [°C]
Zone Air [°C]
Gas Power [kW]
0
−25
20
0
1000
10
15
2000
1
2
3
4
0 12 0 12 0 12 0 12 0 12 0 12 0
Mon
Tue
Wed
Thu
Fri
Sat
Sun
Hour Of The Day [h] & Day Of The Week