




A. Calibrated RMSE

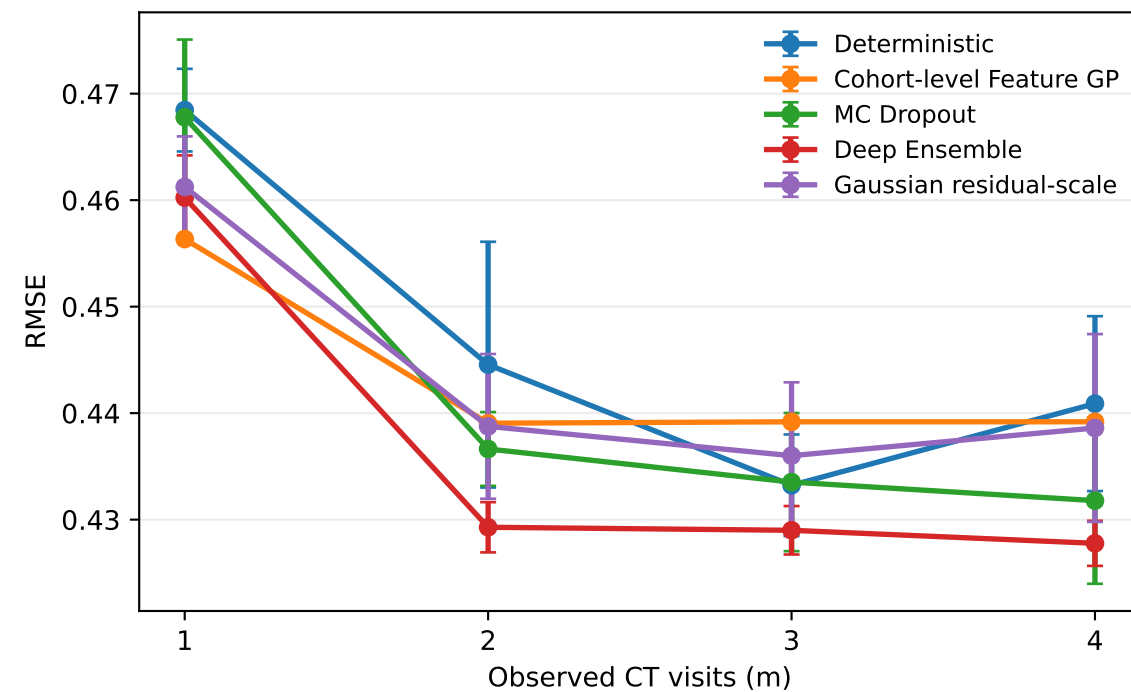

B. m=4 PICP

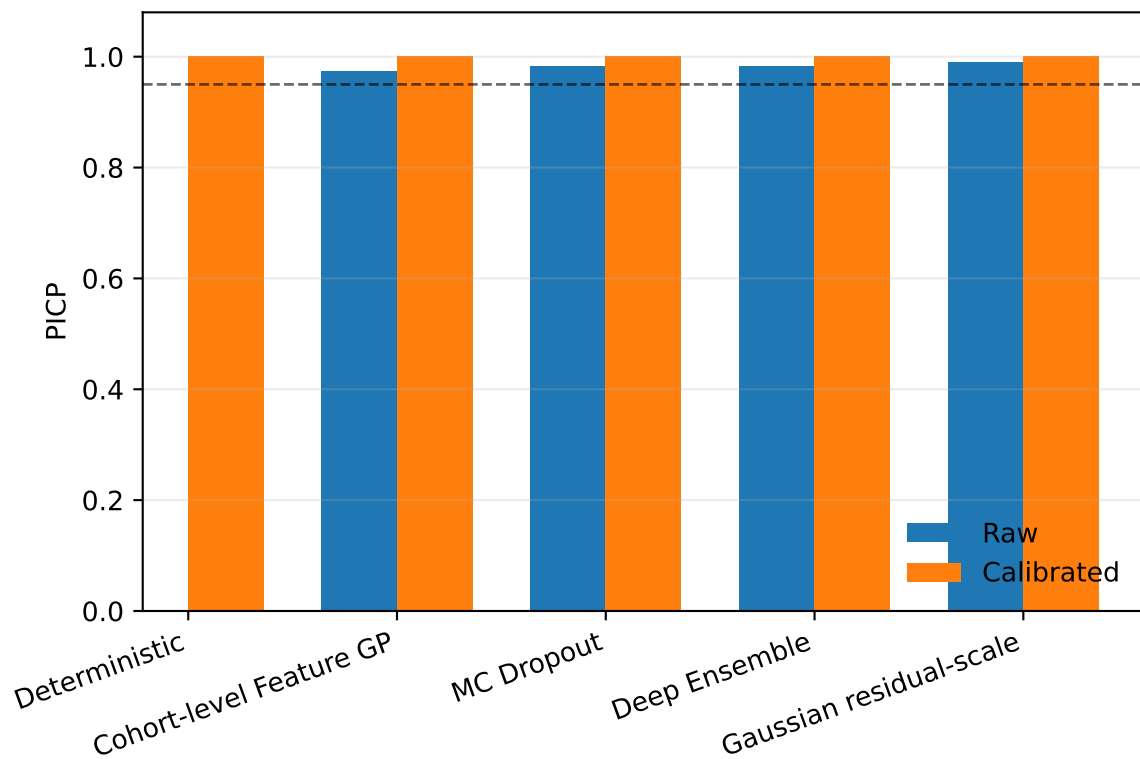

C. m=4 MPIW

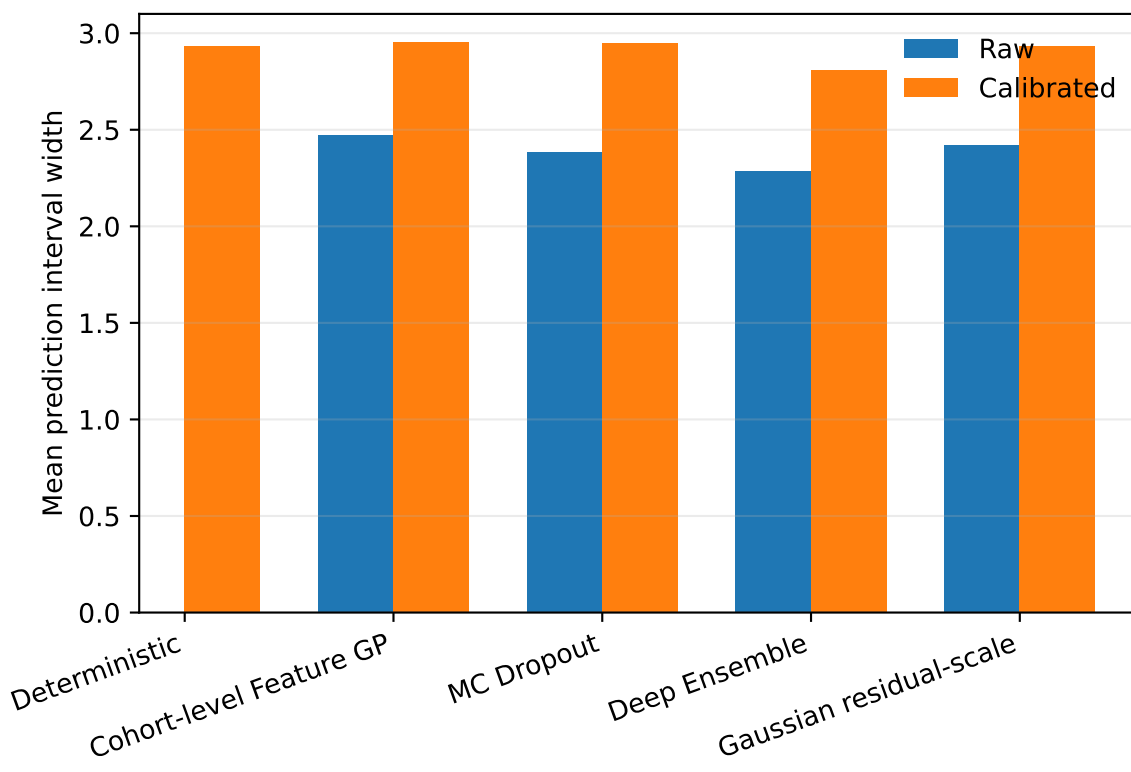

D. MC Dropout sensitivity, m=4

