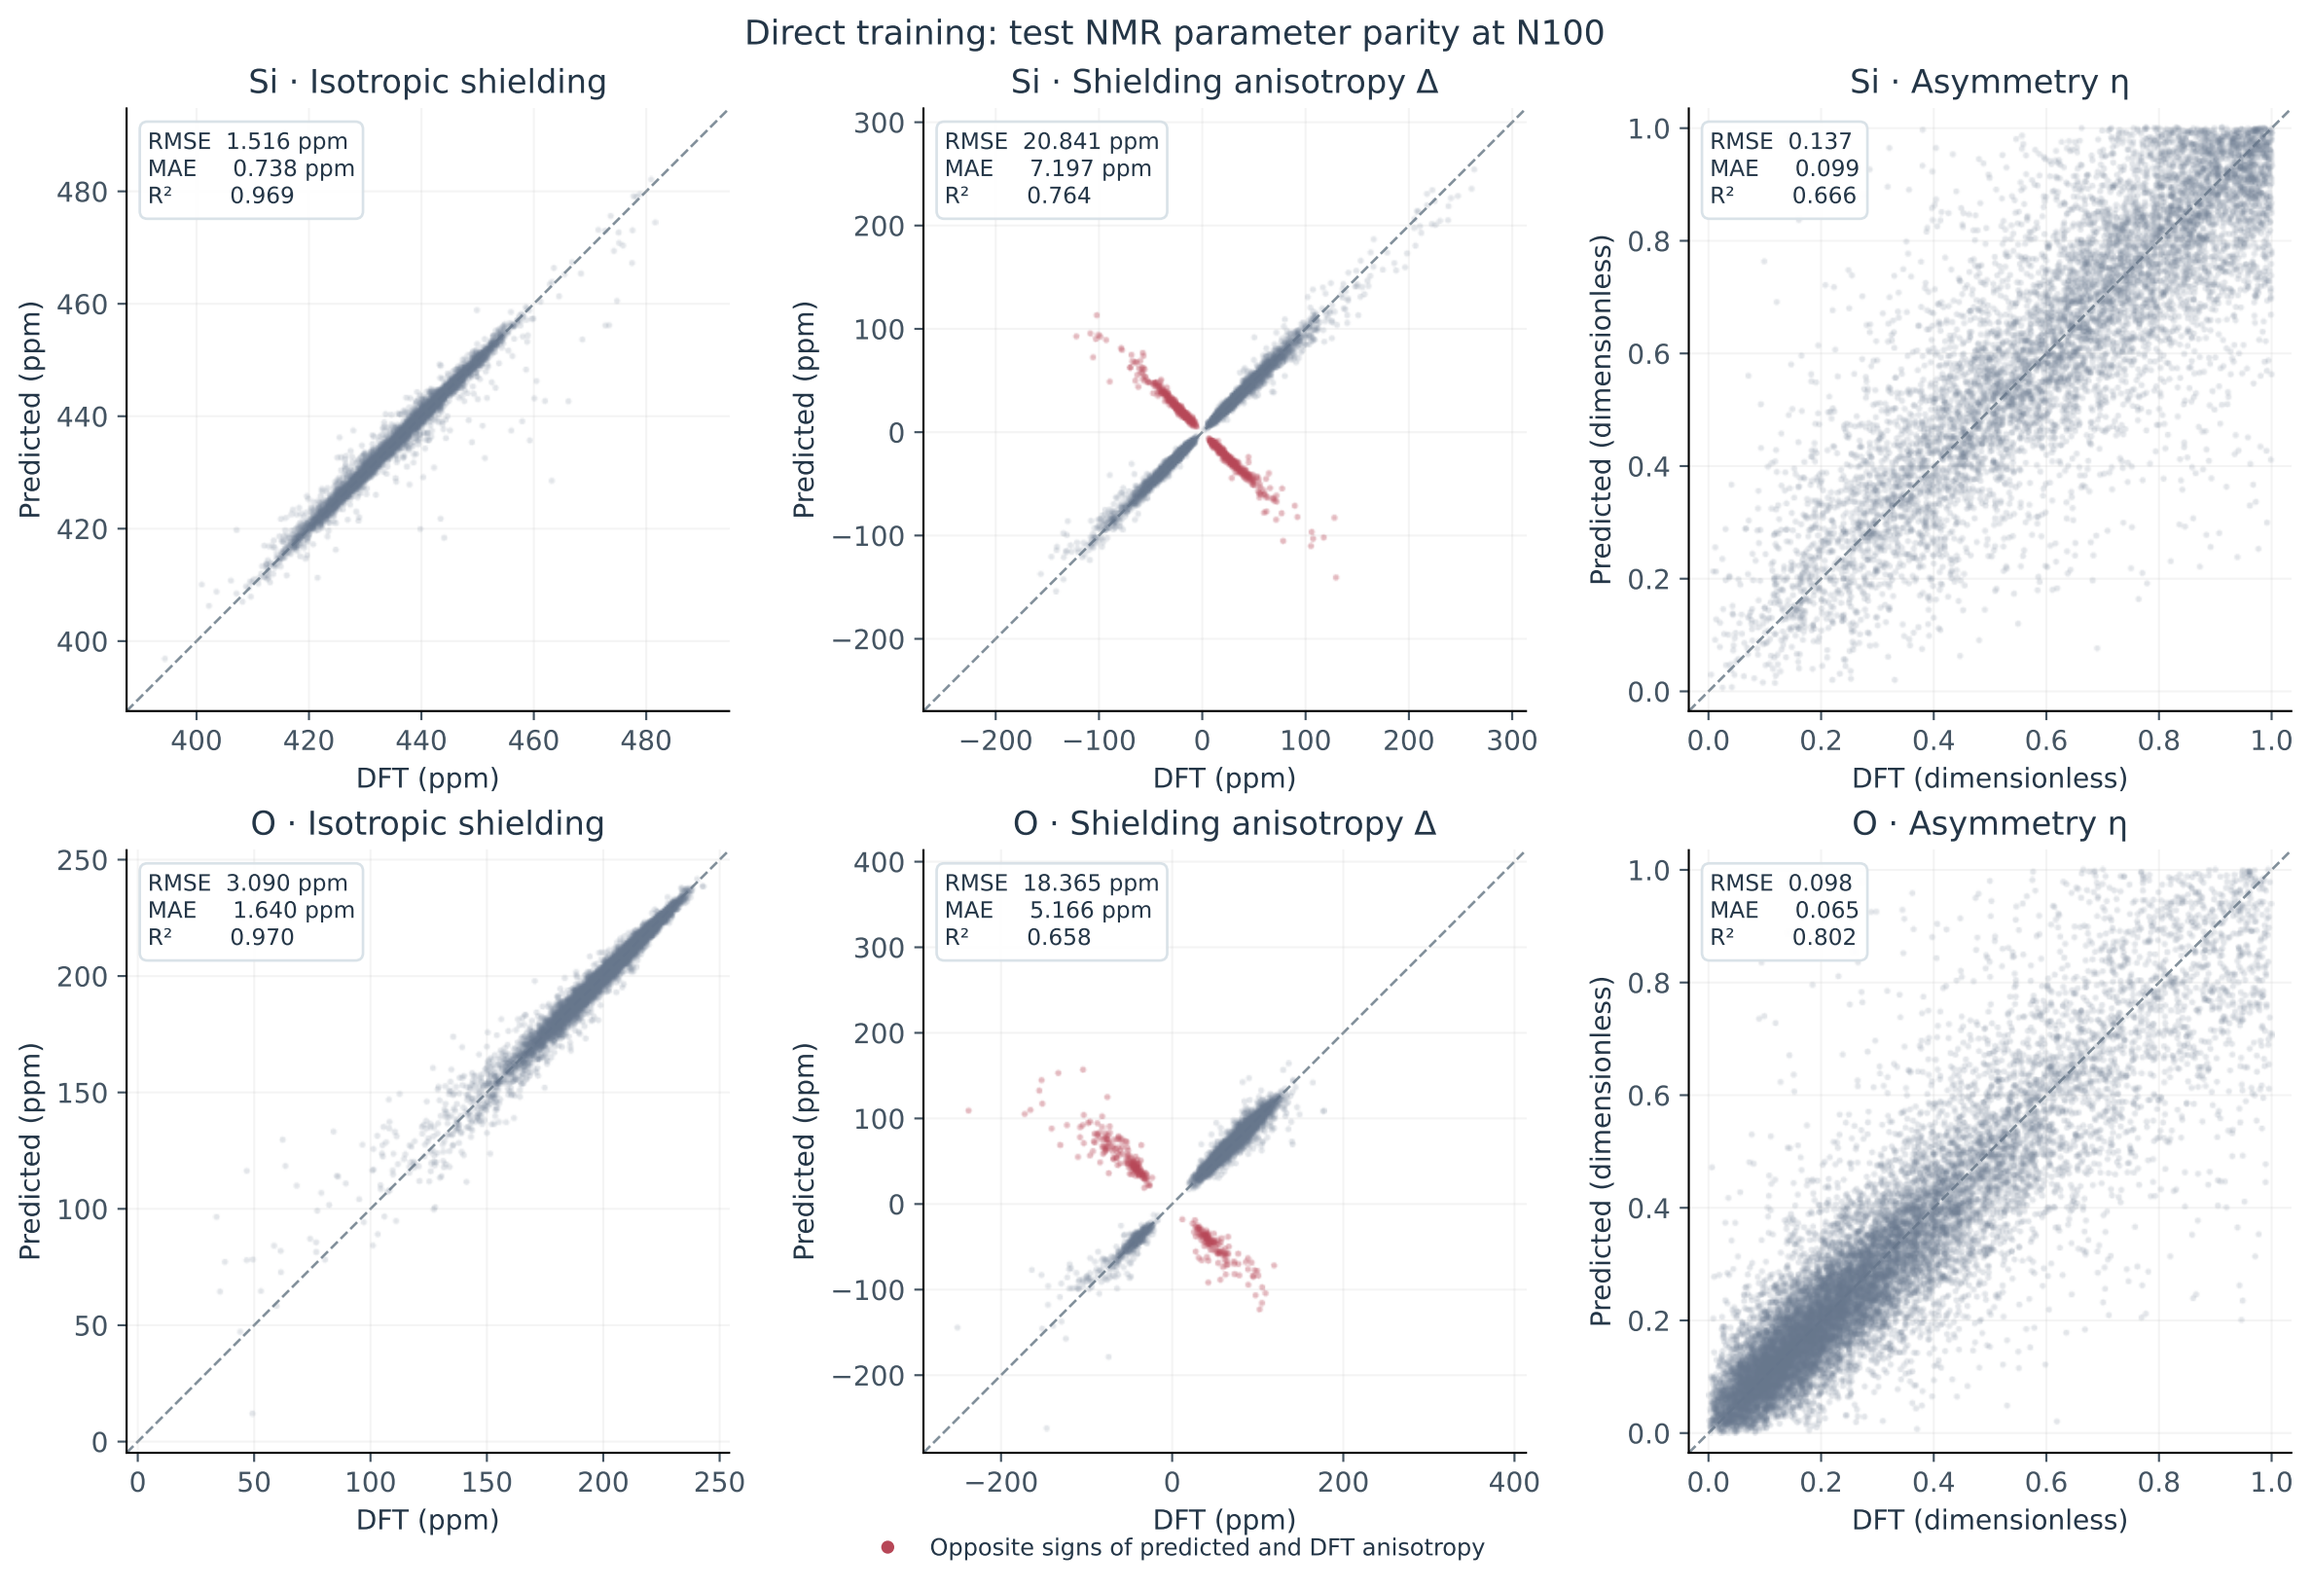

Direct training: test NMR parameter parity at N100
Si · Isotropic shielding
RMSE 1.516 ppm
MAE 0.738 ppm
R² 0.969
Predicted (ppm)
DFT (ppm)
Si · Shielding anisotropy Δ
RMSE 20.841 ppm
MAE 7.197 ppm
R² 0.764
Predicted (ppm)
DFT (ppm)
Si · Asymmetry η
RMSE 0.137
MAE 0.099
R² 0.666
Predicted (dimensionless)
DFT (dimensionless)
O · Isotropic shielding
RMSE 3.090 ppm
MAE 1.640 ppm
R² 0.970
Predicted (ppm)
DFT (ppm)
O · Shielding anisotropy Δ
RMSE 18.365 ppm
MAE 5.166 ppm
R² 0.658
Predicted (ppm)
DFT (ppm)
O · Asymmetry η
RMSE 0.098
MAE 0.065
R² 0.802
Predicted (dimensionless)
DFT (dimensionless)
Opposite signs of predicted and DFT anisotropy