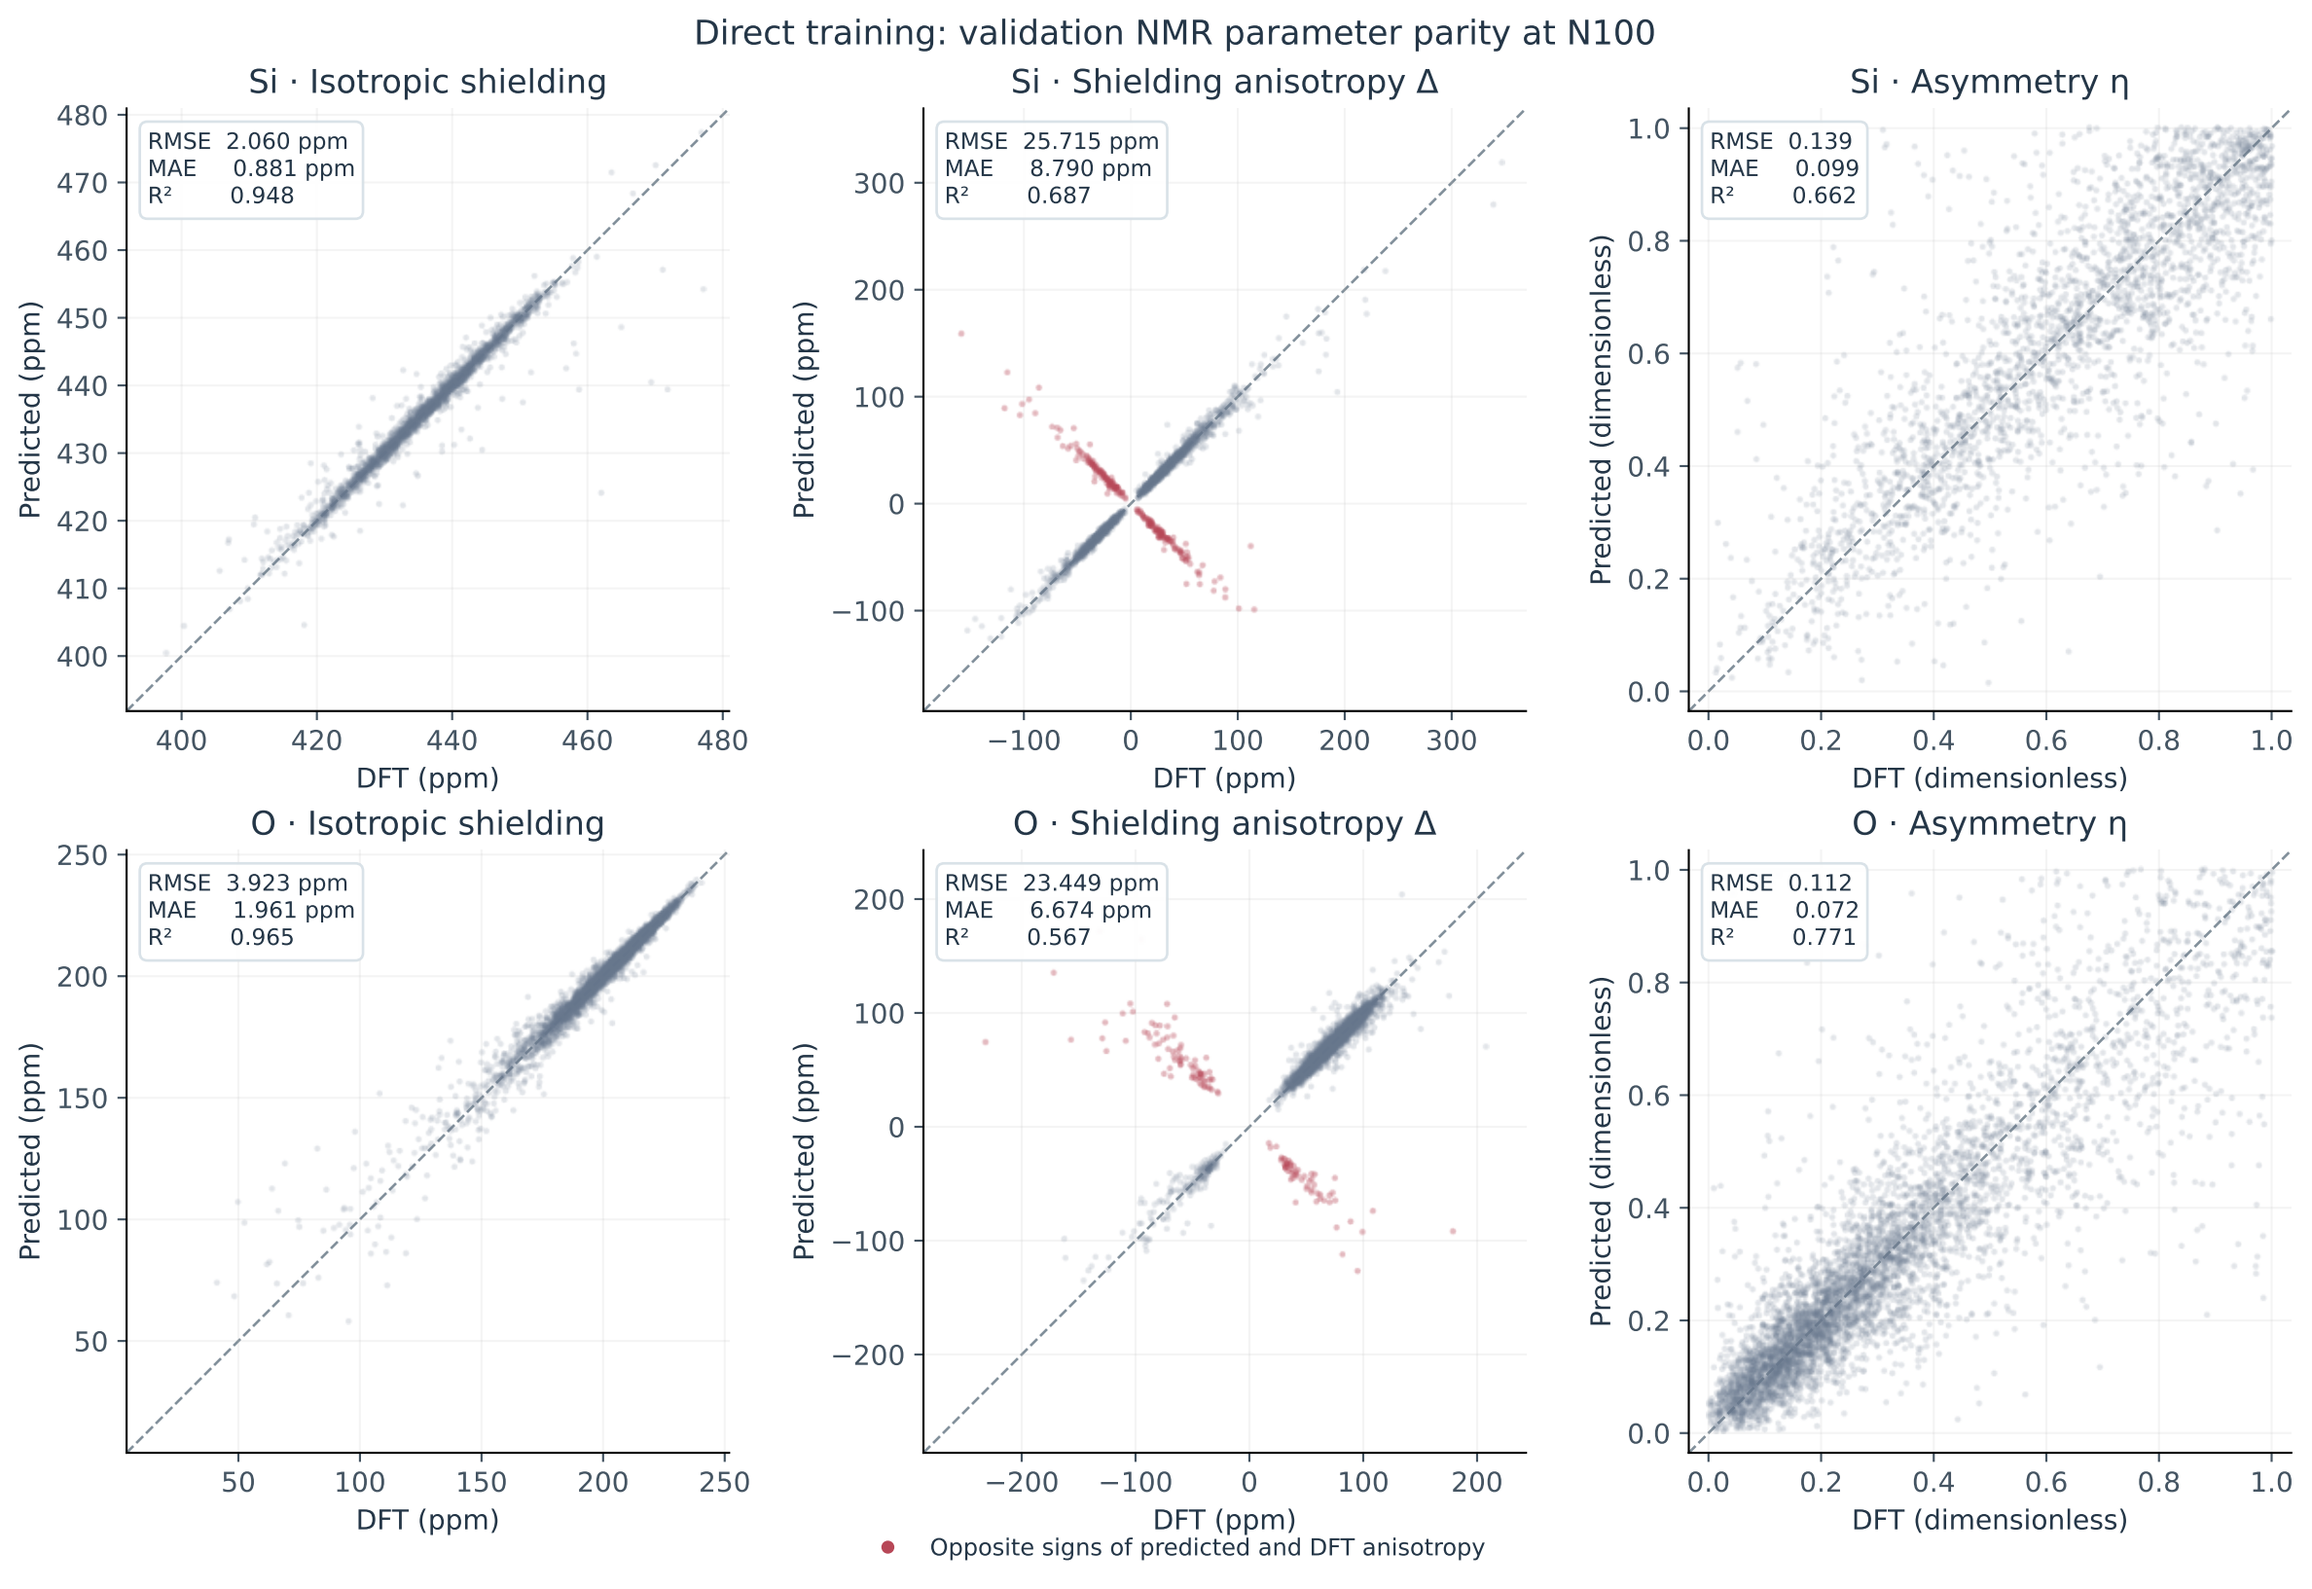

Direct training: validation NMR parameter parity at N100
Si · Isotropic shielding
RMSE 2.060 ppm
MAE 0.881 ppm
R² 0.948
Predicted (ppm)
DFT (ppm)
Si · Shielding anisotropy Δ
RMSE 25.715 ppm
MAE 8.790 ppm
R² 0.687
Predicted (ppm)
DFT (ppm)
Si · Asymmetry η
RMSE 0.139
MAE 0.099
R² 0.662
Predicted (dimensionless)
DFT (dimensionless)
O · Isotropic shielding
RMSE 3.923 ppm
MAE 1.961 ppm
R² 0.965
Predicted (ppm)
DFT (ppm)
O · Shielding anisotropy Δ
RMSE 23.449 ppm
MAE 6.674 ppm
R² 0.567
Predicted (ppm)
DFT (ppm)
O · Asymmetry η
RMSE 0.112
MAE 0.072
R² 0.771
Predicted (dimensionless)
DFT (dimensionless)
Opposite signs of predicted and DFT anisotropy