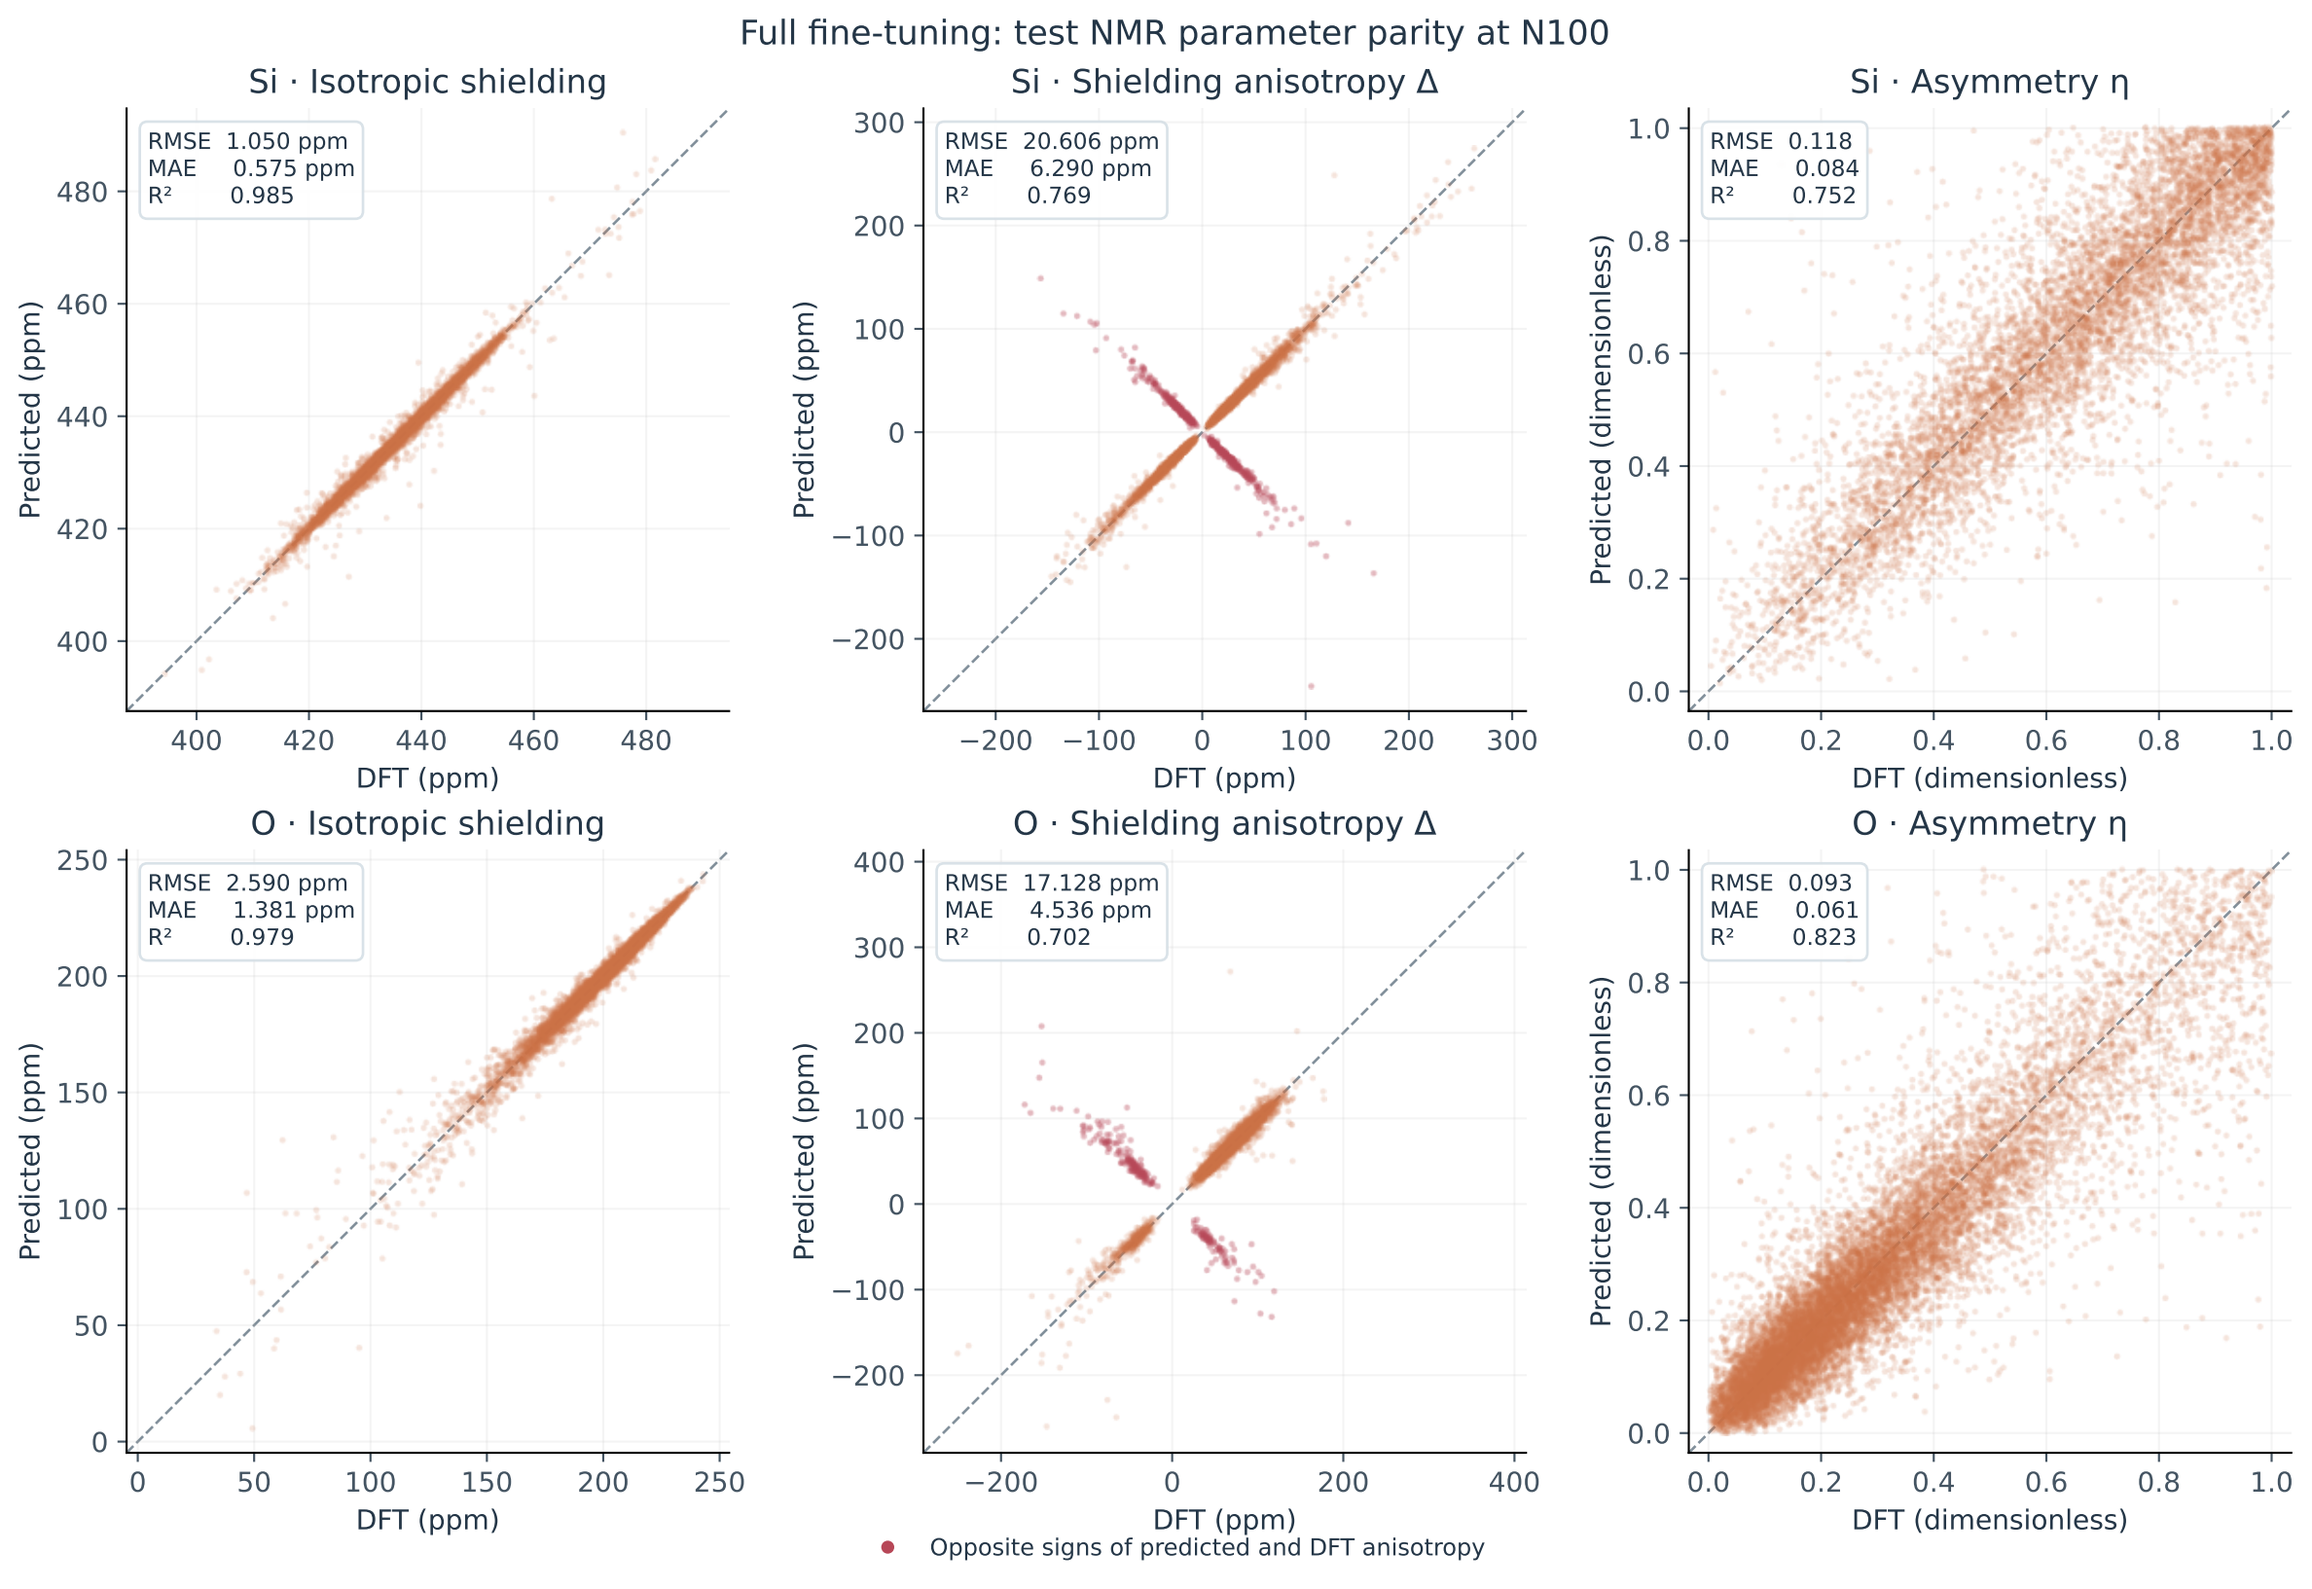

Full fine-tuning: test NMR parameter parity at N100
Si · Isotropic shielding
RMSE 1.050 ppm
MAE 0.575 ppm
R² 0.985
Predicted (ppm)
DFT (ppm)
Si · Shielding anisotropy Δ
RMSE 20.606 ppm
MAE 6.290 ppm
R² 0.769
Predicted (ppm)
DFT (ppm)
Si · Asymmetry η
RMSE 0.118
MAE 0.084
R² 0.752
Predicted (dimensionless)
DFT (dimensionless)
O · Isotropic shielding
RMSE 2.590 ppm
MAE 1.381 ppm
R² 0.979
Predicted (ppm)
DFT (ppm)
O · Shielding anisotropy Δ
RMSE 17.128 ppm
MAE 4.536 ppm
R² 0.702
Predicted (ppm)
DFT (ppm)
O · Asymmetry η
RMSE 0.093
MAE 0.061
R² 0.823
Predicted (dimensionless)
DFT (dimensionless)
Opposite signs of predicted and DFT anisotropy