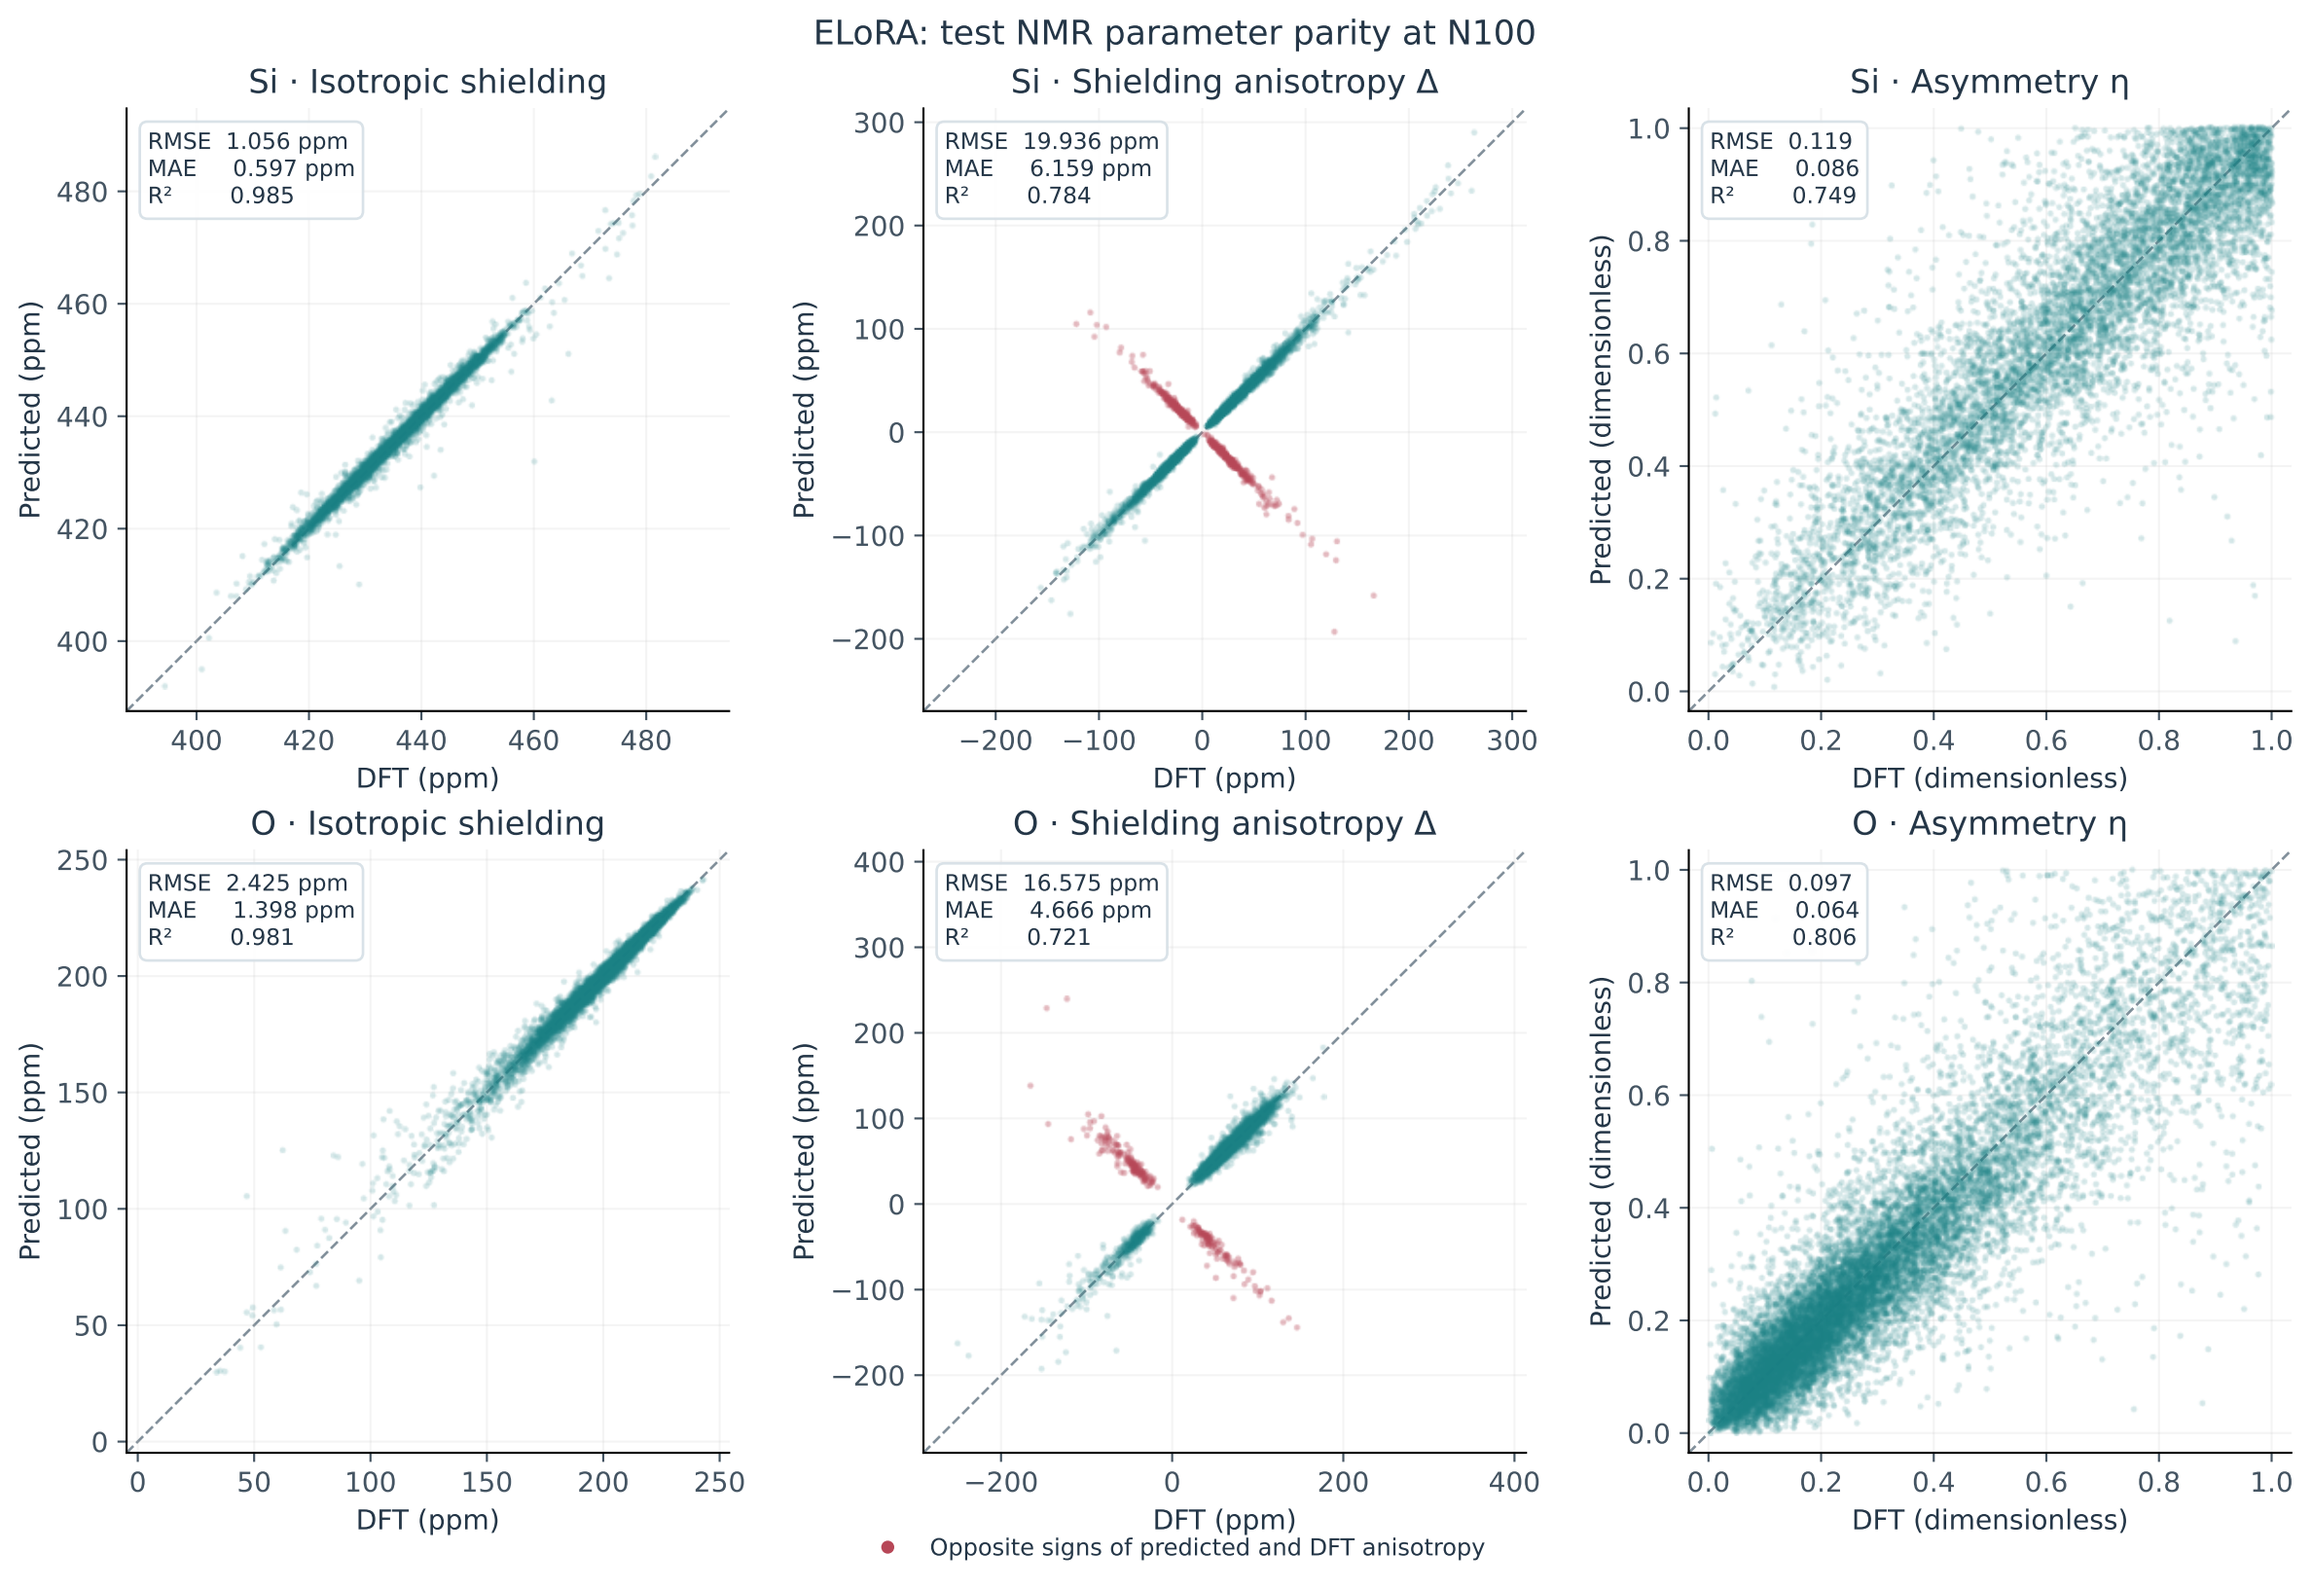

ELoRA: test NMR parameter parity at N100
Si · Isotropic shielding
RMSE 1.056 ppm
MAE 0.597 ppm
R² 0.985
Predicted (ppm)
DFT (ppm)
Si · Shielding anisotropy Δ
RMSE 19.936 ppm
MAE 6.159 ppm
R² 0.784
Predicted (ppm)
DFT (ppm)
Si · Asymmetry η
RMSE 0.119
MAE 0.086
R² 0.749
Predicted (dimensionless)
DFT (dimensionless)
O · Isotropic shielding
RMSE 2.425 ppm
MAE 1.398 ppm
R² 0.981
Predicted (ppm)
DFT (ppm)
O · Shielding anisotropy Δ
RMSE 16.575 ppm
MAE 4.666 ppm
R² 0.721
Predicted (ppm)
DFT (ppm)
O · Asymmetry η
RMSE 0.097
MAE 0.064
R² 0.806
Predicted (dimensionless)
DFT (dimensionless)
Opposite signs of predicted and DFT anisotropy