
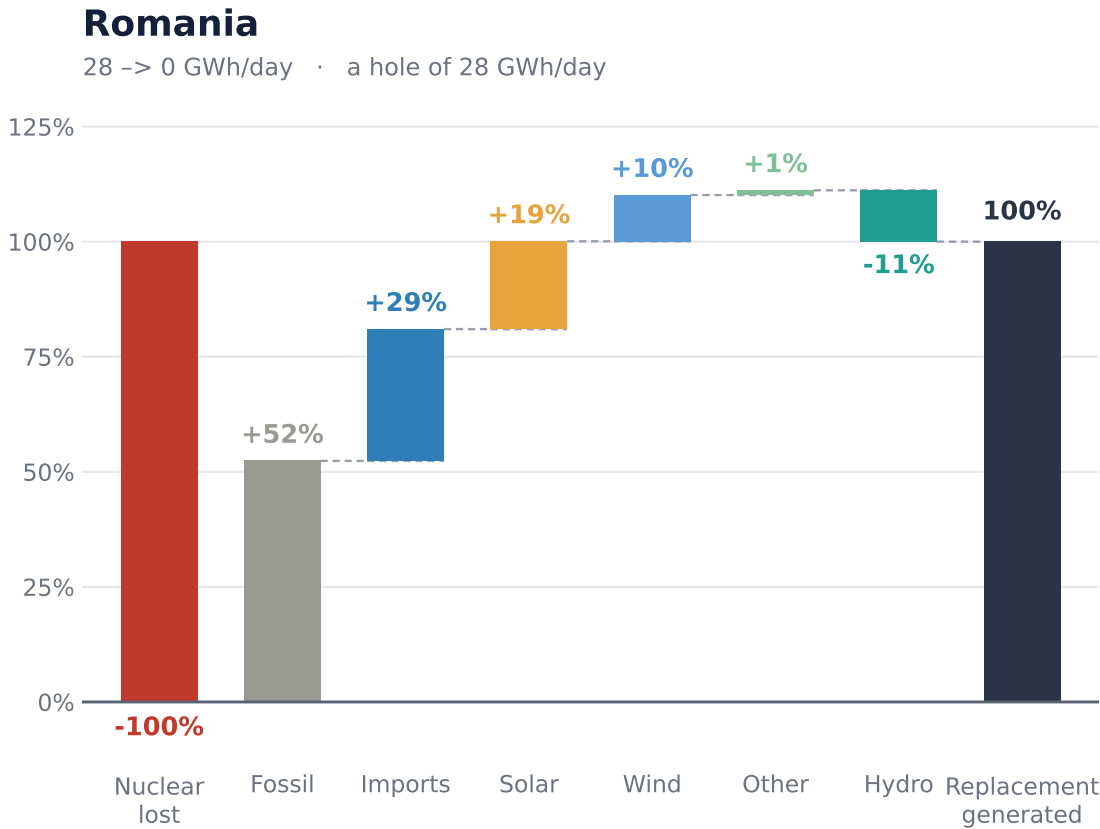


Hungary bought its way through the outage; Romania burned through it

What replaced the lost nuclear output, as a share of the reduction. Each country is measured against its own pre-outage plateau.

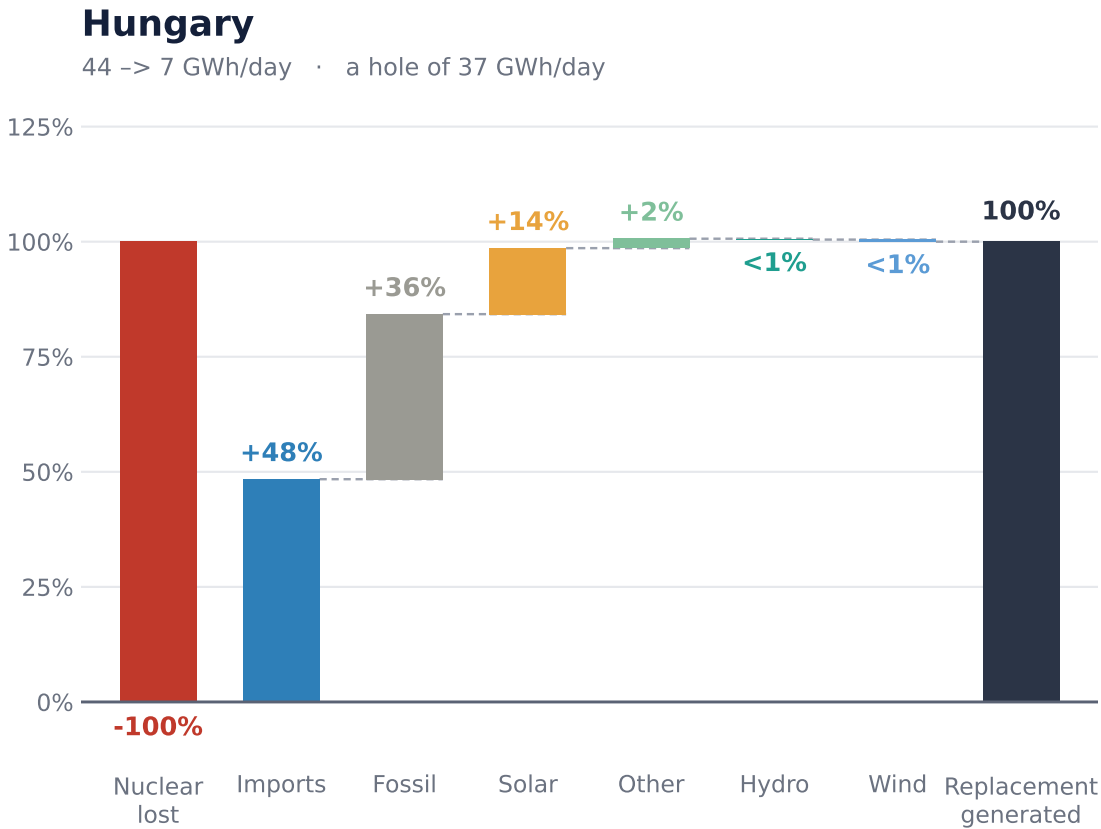

Hungary covered 84% of its shortfall with imports and fossil generation and only 14% with solar.

Romania leaned hardest on fossil (52%), with solar and wind together adding 29% and hydro falling a further 11%.

Periods are taken from the daily series, not assumed. Hungary: 5-27 July against 2-20 August. Romania: 7-27 July against 14-20 August, the days its output read zero.

Bars are shares of each country's own nuclear reduction, so the two panels are comparable despite Hungary losing 37 GWh/day and Romania 28.

The closing bar is generation and trade, not metered demand: the measured components come to 90% of Hungary's nuclear loss and 99% of Romania's before scaling, and are scaled to 100%.

The shortfall is a metering artefact rather than a missing fuel · distributed solar counts as generation but never crosses the transmission load meter, and small units sit below ENTSO-E's reporting threshold.

Source: ENTSO-E Transparency Platform (generation per production type, cross-border physical flows)