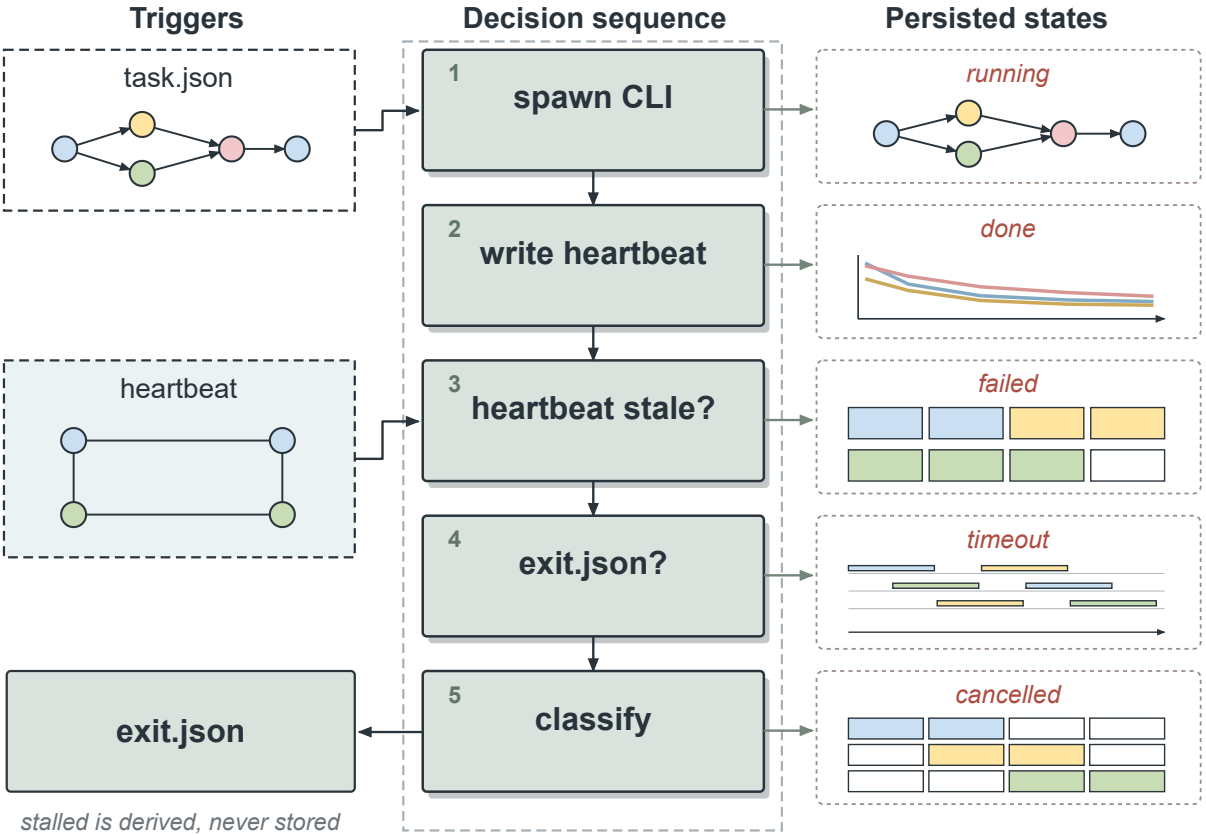


criteria: structured result -> done; exit without result -> failed
wall-clock expiry -> timeout; cancellation observed -> cancelled
stalled is derived at read time from heartbeat age >= 90 s