


Gougra Cascade Water Balance

Annual water routing, 2025 inflows (hm³ = million m³) under current residual-flow rules · theoretical model, Val d'Anniviers

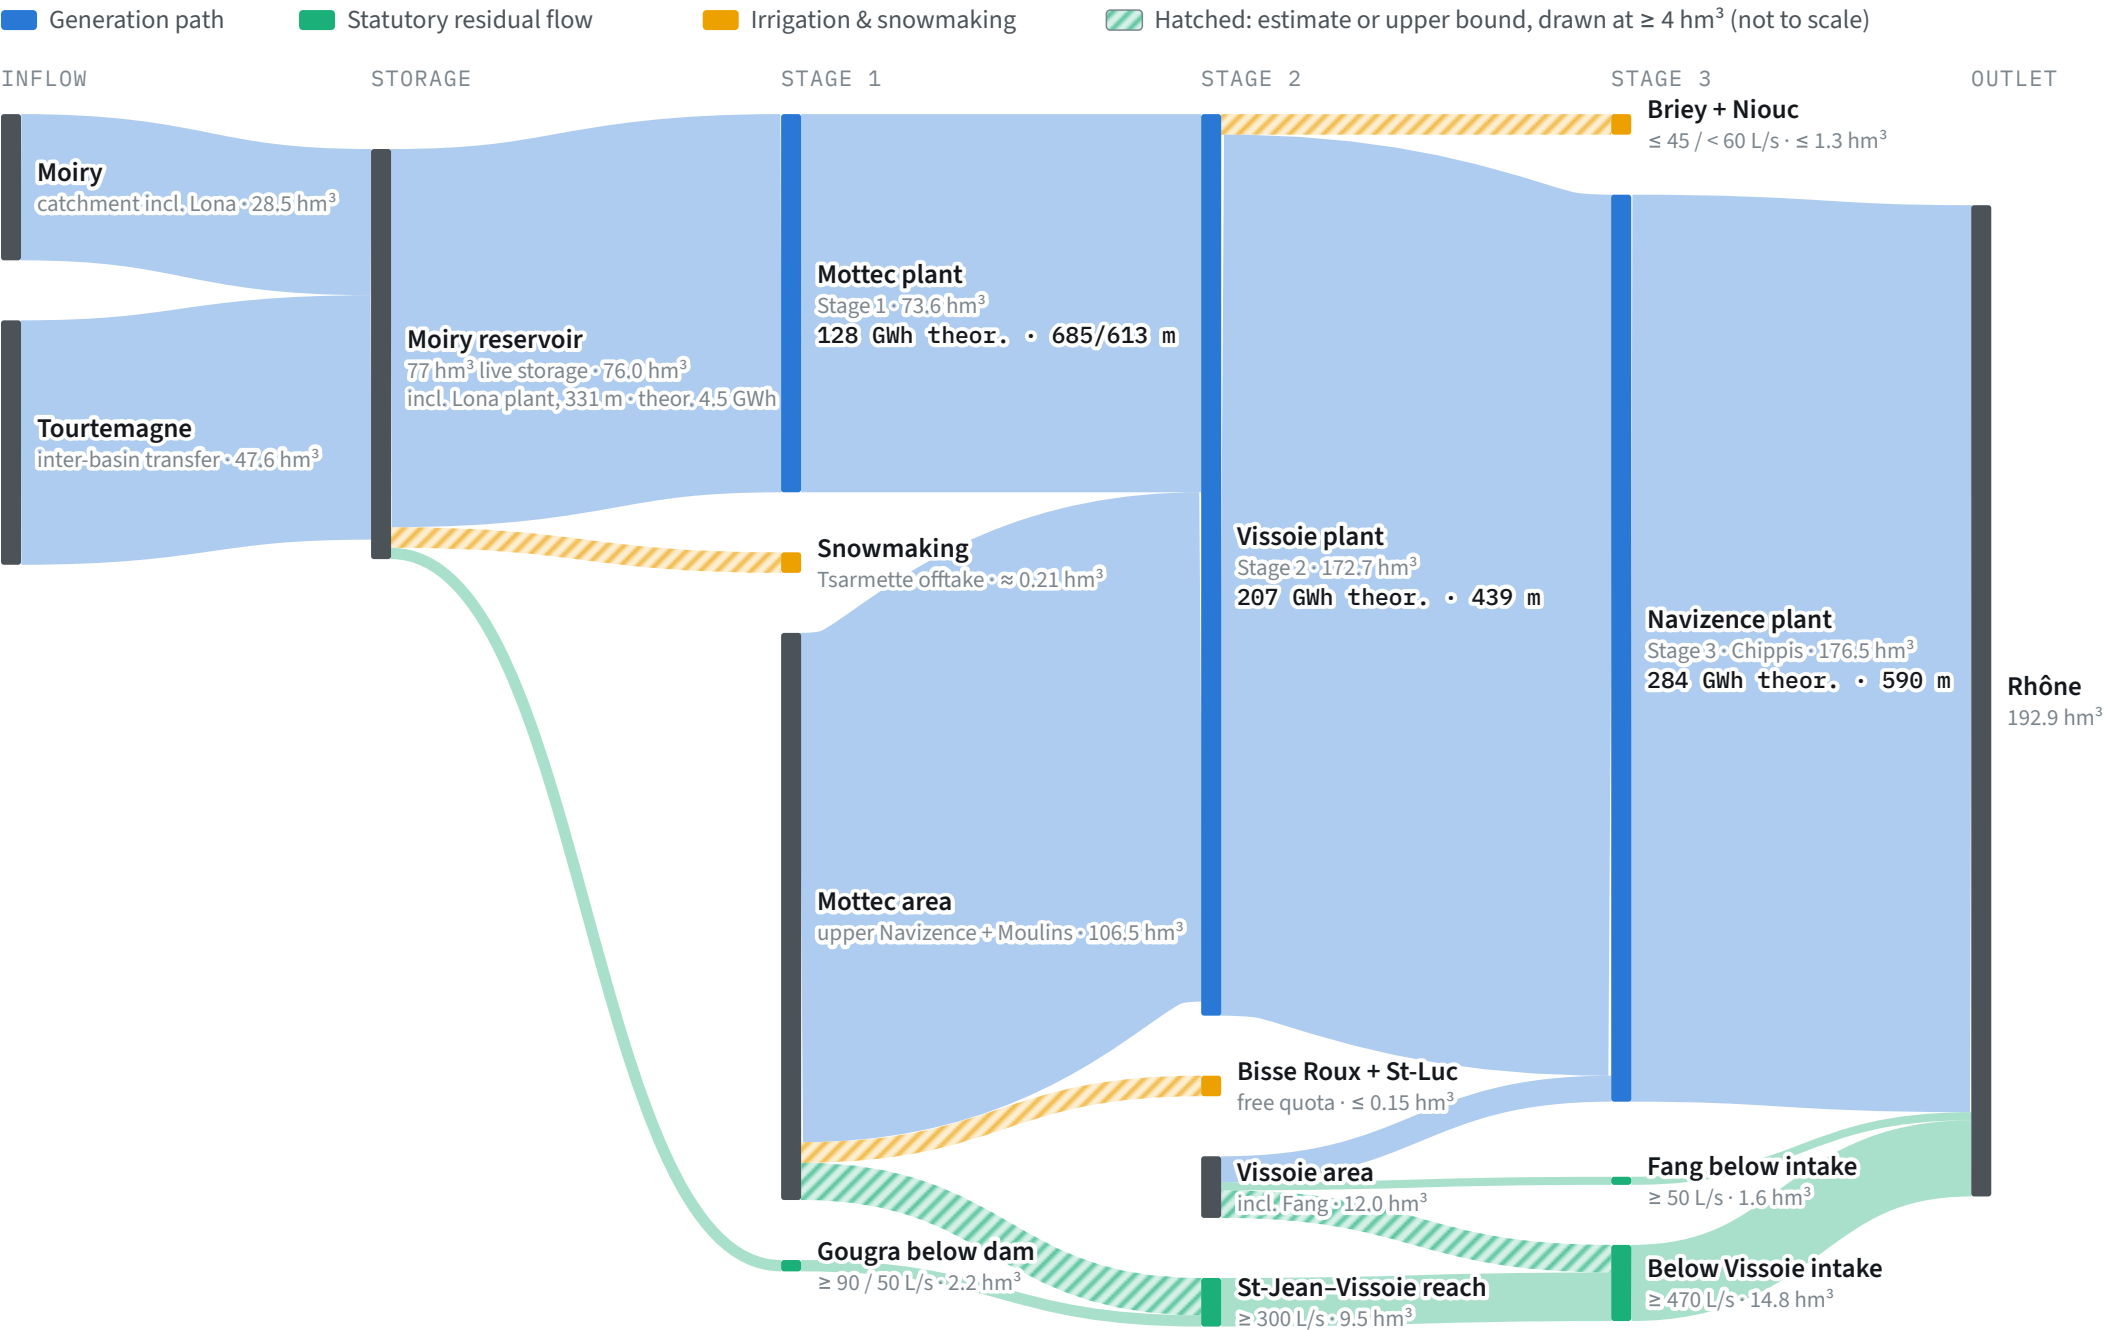

Stage volumes are the same water reused in series and cannot be summed. Each tributary joins at the stage where it is captured.

Residual flows annualised assuming year-round compliance and deducted from generating water (upper bound). Irrigation at allocation ceilings; snowmaking ≈ 0.11 % of inflow.

Theoretical gross energy = 9.81 × volume × gross head ÷ 3600; total 622.8 GWh (η = 1), ≈ 529 GWh at η = 0.85; 2025 actual 453.9 GWh.

Sources: FMG Rapport de gestion 2025; Robert 1962 (Tables 1–2); Mottier 1959; Savoy 2025 WP6 (PDF 79–81, 90, 95, 100–101); Alpiq 2025 (Mottec; Vissoie–Niouc tunnel).