


Gougtra Cascade Water Balance

Mean-year water routing (hm³/yr = million m³): 2016–2025 mean inflow, plant volumes calibrated to BFE WASTA · Val d’Anniviers · v2, 6 Oct 2026

Generation path Statutory residual flow Irrigation & snowmaking Spilled or not captured Hatched: estimate or calibration term (min. 4 hm³ drawn)

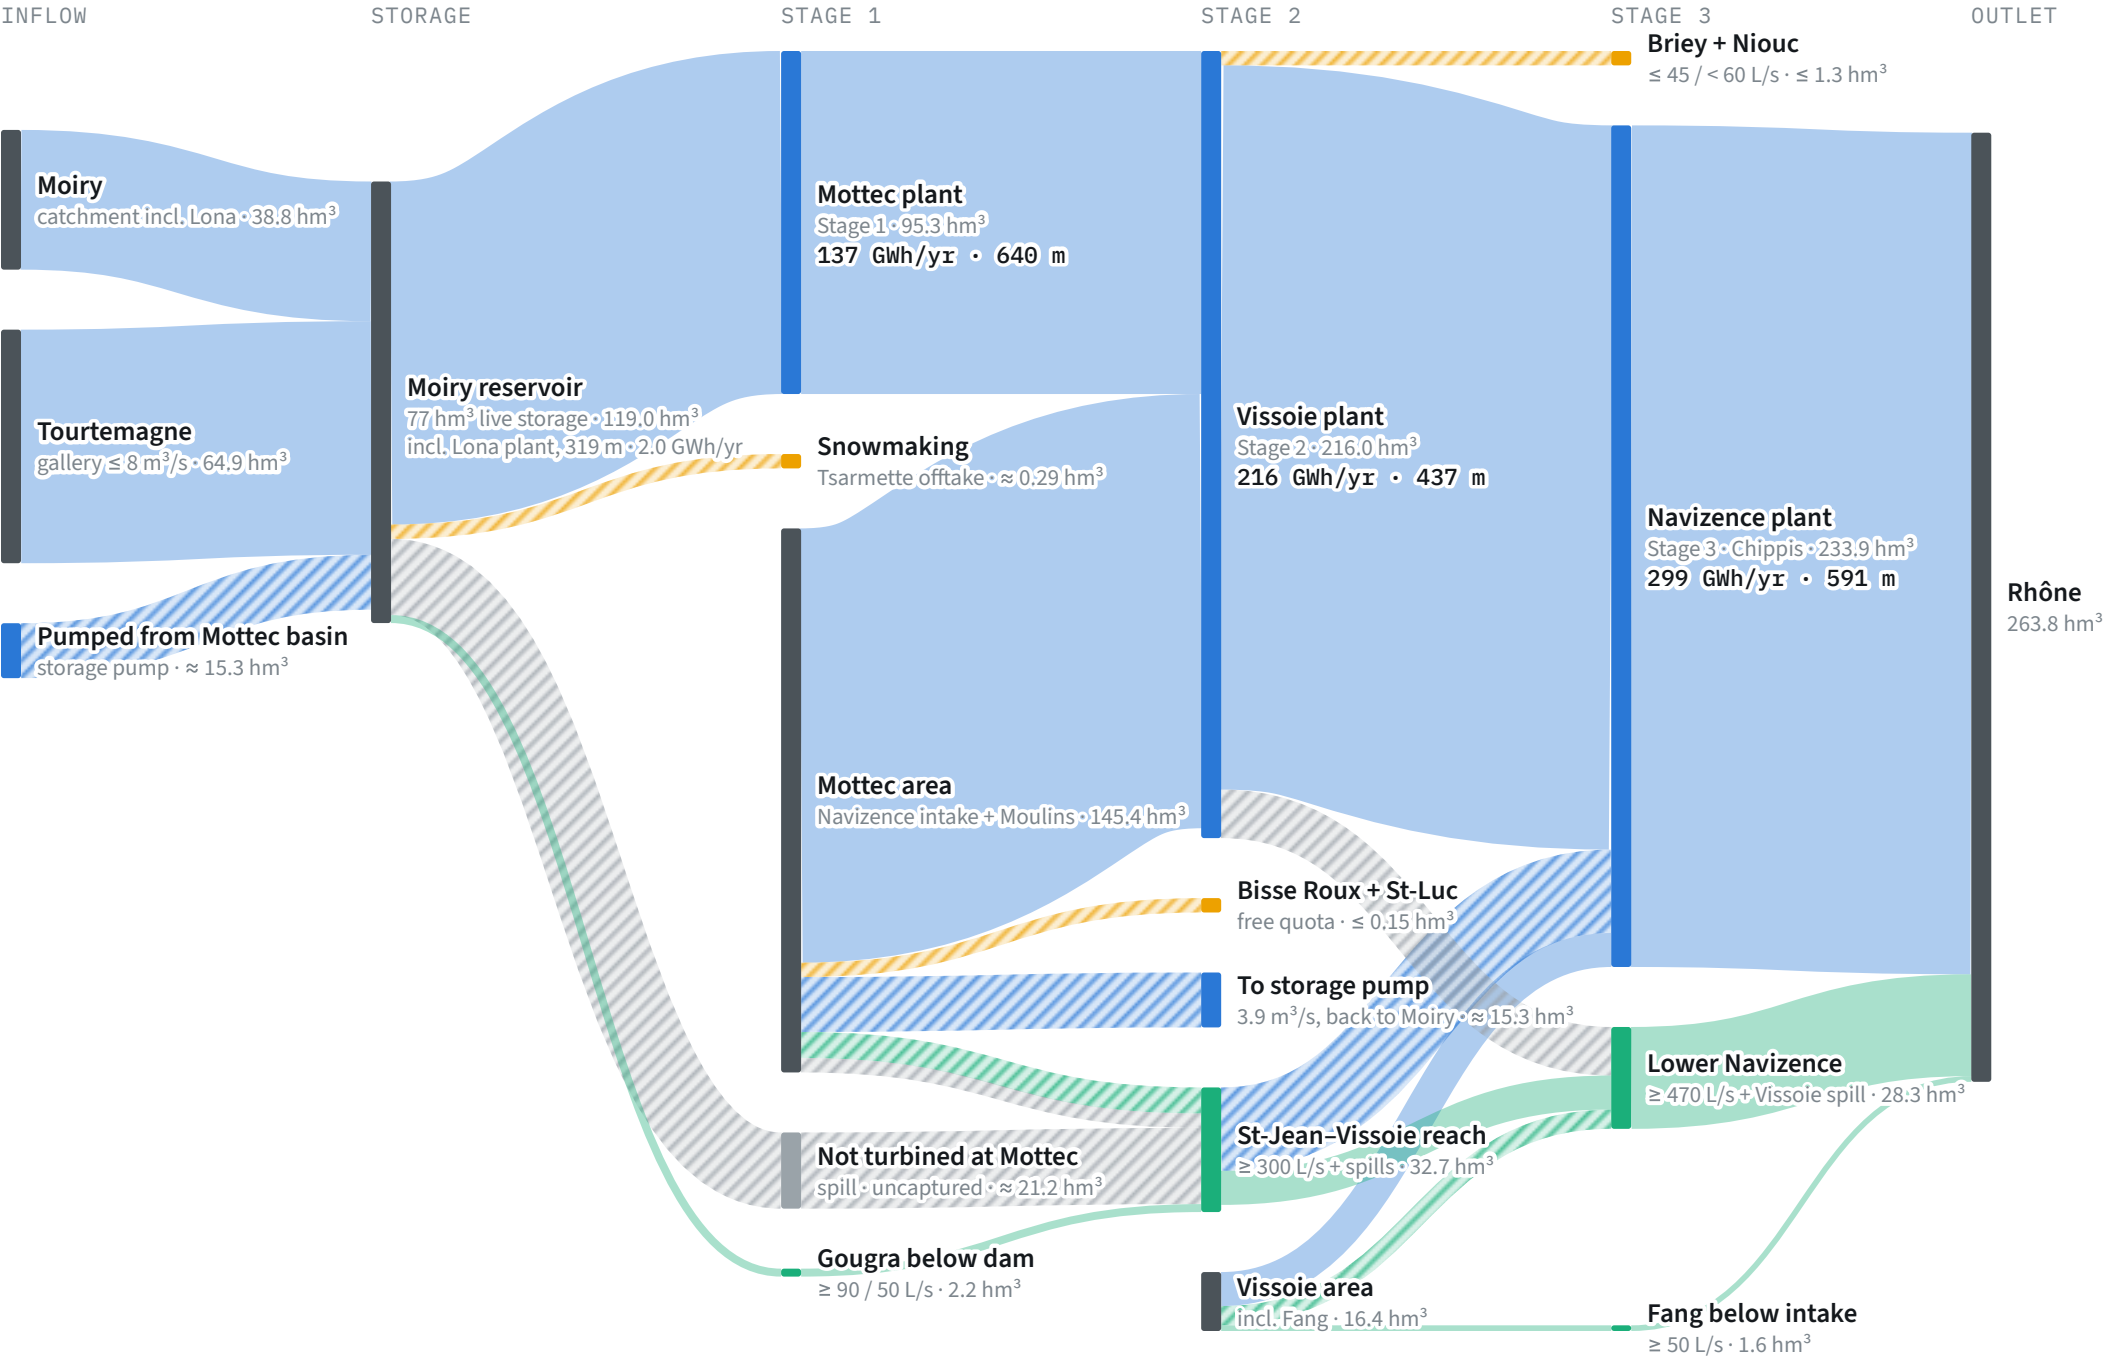

Plant volumes = BFE WASTA expected generation ÷ FMG leaflet energy coefficient; WASTA expected generation per plant shown at each stage (653.9 GWh/yr in total).
Grey bands balance the inflow against those volumes: surplus above Mottec assumed to spill and be recaptured at Vissoie; Vissoie spill due to the ≈10.8 m³/s tunnel (≈20 hm³ in 2001, BGE 150 II 83).
Residual flows annualised and deducted in full (upper bound); irrigation at allocation ceilings; pumping ≈ 15 hm³ = 30.2 GWh at the storage pump. Stage volumes are reused water and cannot be summed.
Sources: BFE WASTA 31.12.2025; BAFU MQN; FMG leaflet 2014 and Rapport de gestion 2025; BGE 150 II 83; VS message Convention 2022; Savoy 2025 WP6; Alpiq 2025.