


Top 10 Downtime Analysis

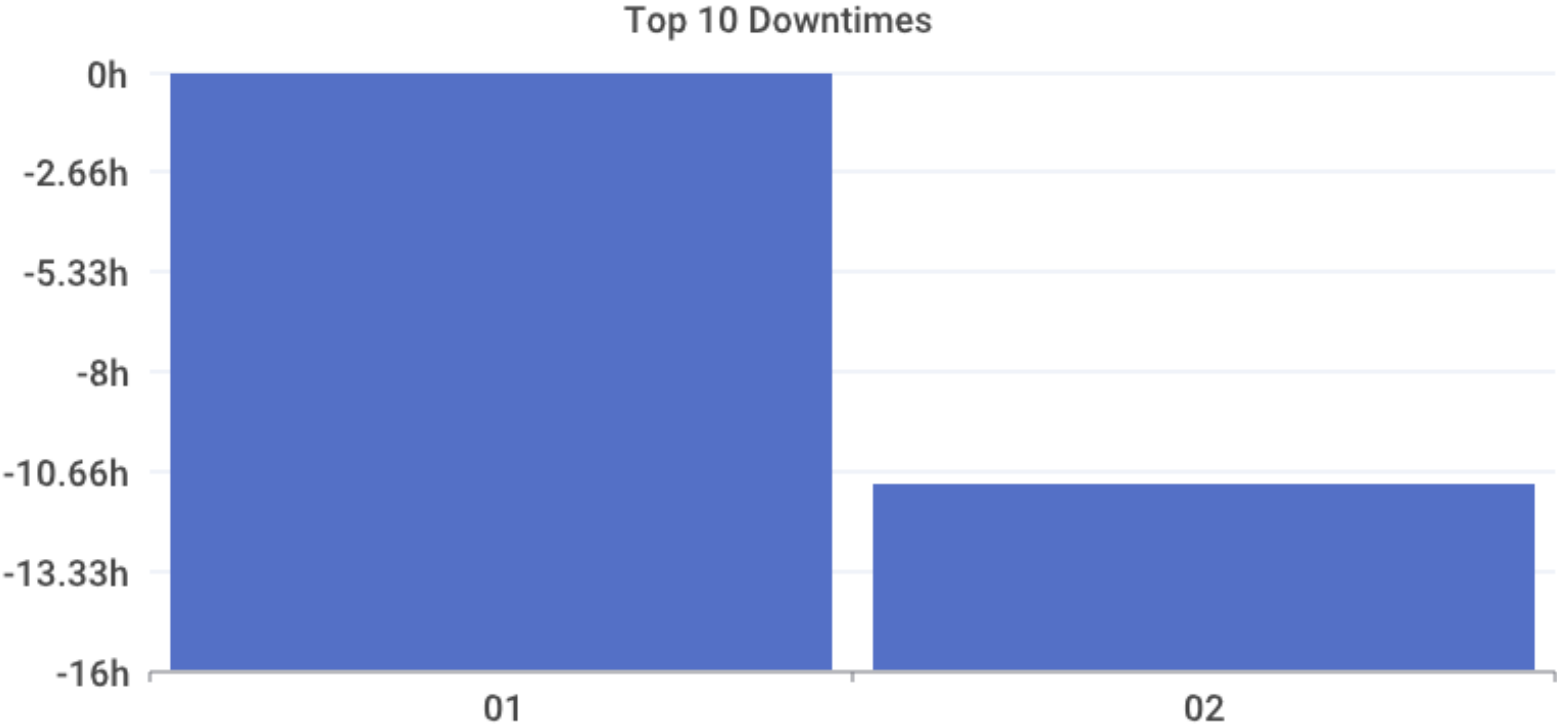

Rank	Plant Area	Category	Equipment	Problem	Cause	Freq.	Hours	Cost
01	Steam FST	ELECTRICAL	Air Compressor 1	COMMUNICATION	LUBRICATION	1	0.00	100.00
02	Steam FST	ELECTRICAL	Valve 2	BURNT OUT	BAD CONNECTION	1	-10.95	10000.00