


Technical agreement with the scenario-specific baseline

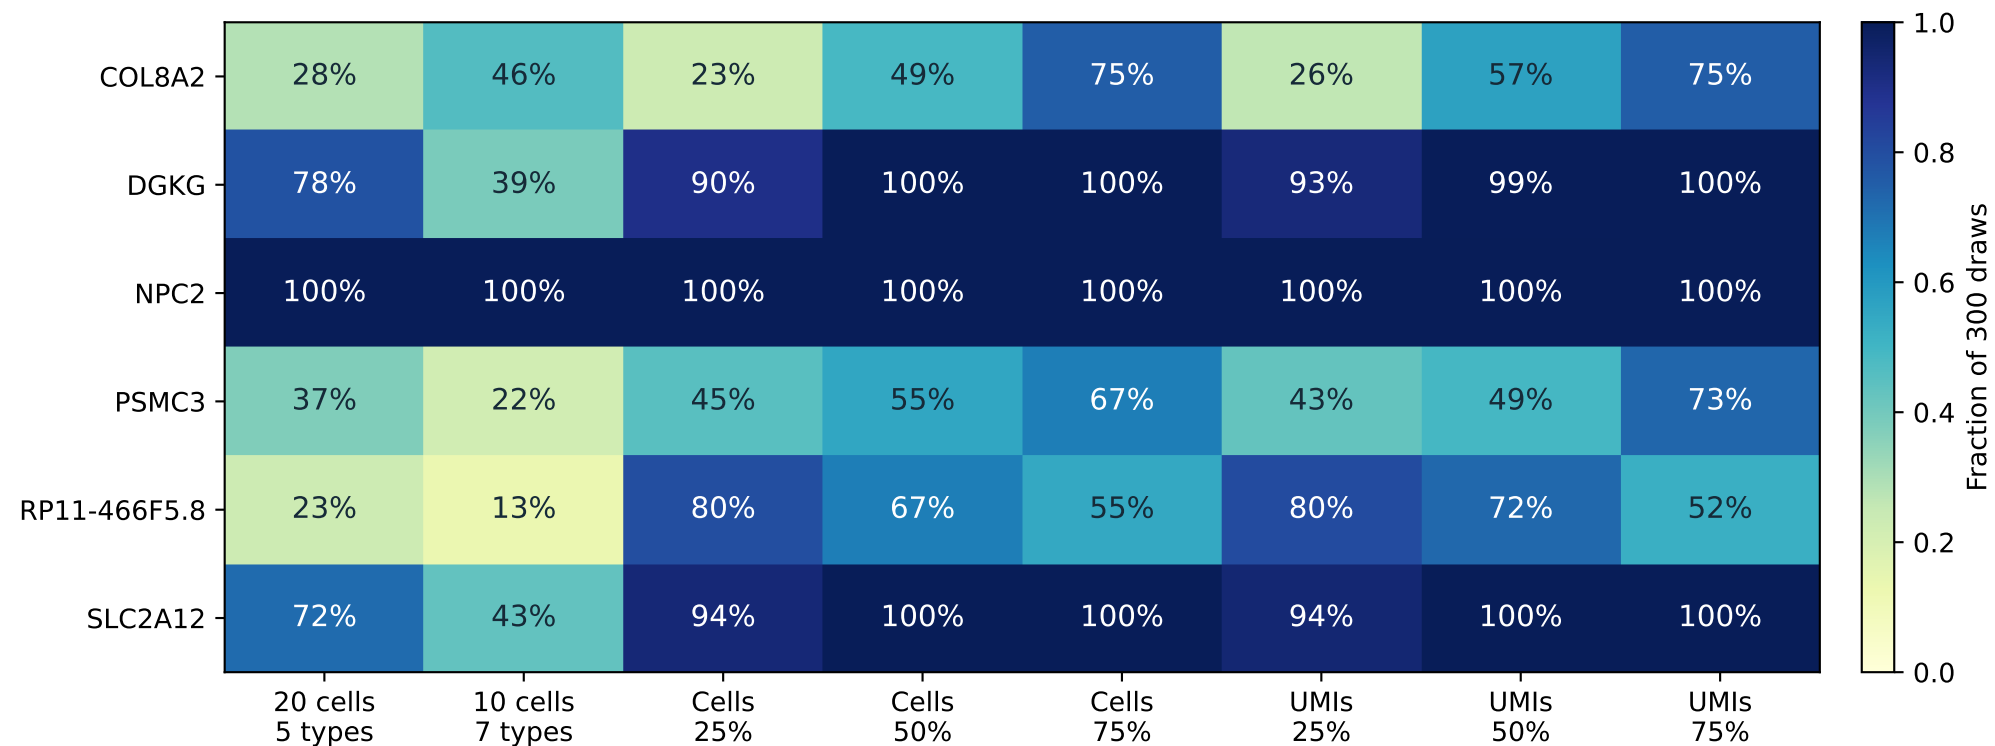

Cell resampling within donor/type; fixed types in every draw. Technical uncertainty, not population confidence intervals.