Majority correctness differences | GSM−Hard

Five−repeat question summaries | A minus B | Unadjusted pointwise 95% intervals

Comparison: A − B	Estimate [95% interval]	Holm p	Holm decision
RQ11 Cascade − Large	2.000 [−2.236, 6.214]	1.000	Do not reject
RQ11 Cascade − Medium	5.000 [−0.032, 9.964]	0.680	Do not reject
RQ11 Cascade − Small	3.500 [−0.611, 7.573]	1.000	Do not reject
RQ11 MF − Large	−3.500 [−8.006, 1.050]	1.000	Do not reject
RQ11 MF − Medium	−0.500 [−5.987, 4.994]	1.000	Do not reject
RQ11 MF − Small	−2.000 [−4.891, 0.907]	1.000	Do not reject
RQ2 MF − Cascade	−5.500 [−9.744, −1.192]	0.038	Reject

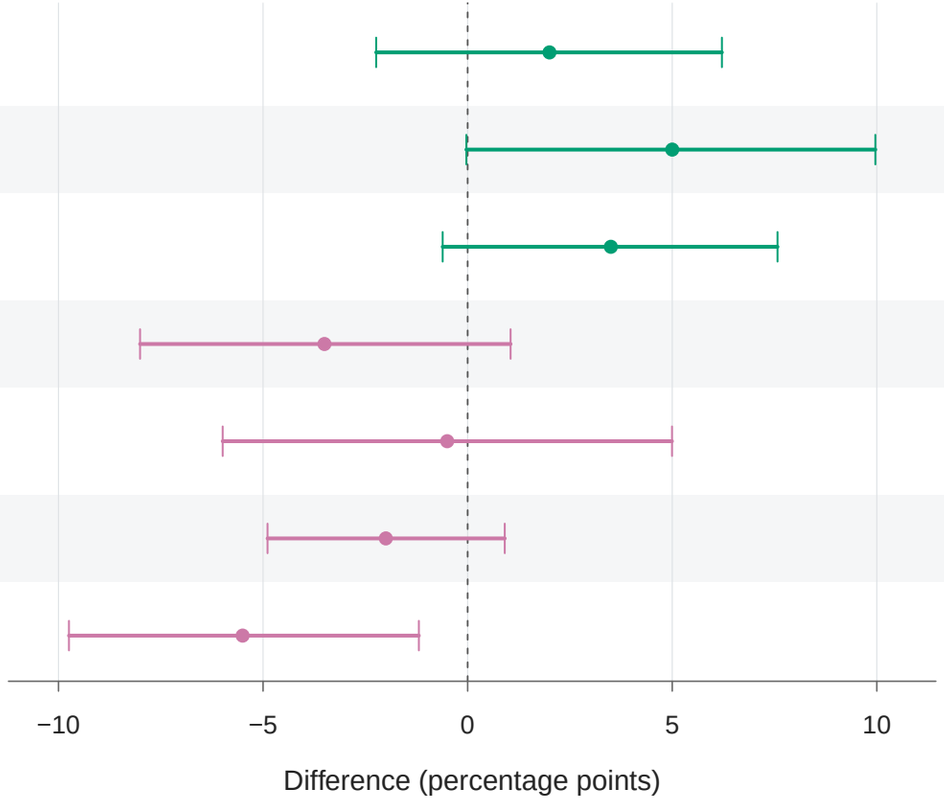

Intervals are unadjusted pointwise 95% intervals, not simultaneous intervals. Holm decisions use the original RQ families at alpha = 0.05.
Newcombe method 10 intervals are approximate; p values use two−sided exact McNemar. Majority correctness is not answer−text voting.