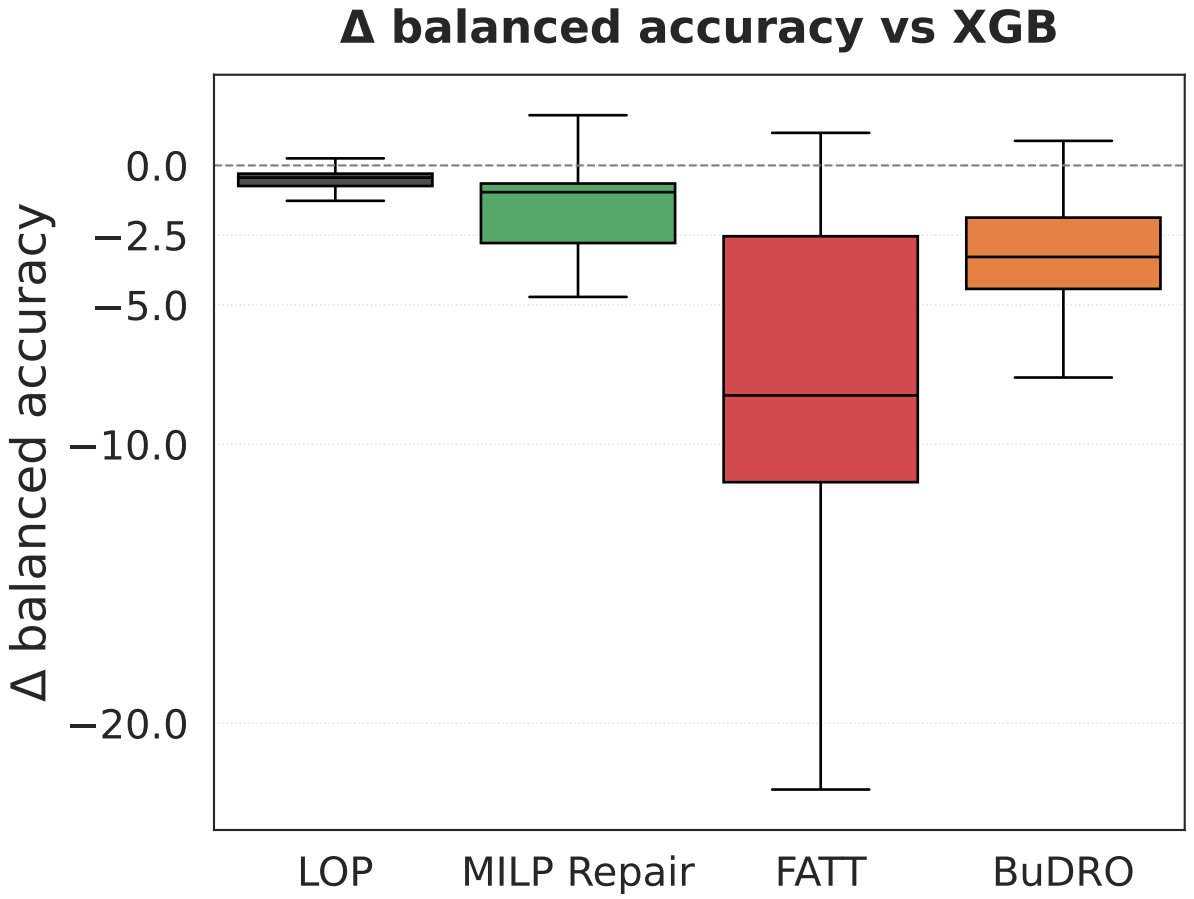
Δ balanced accuracy vs XGB
Δ balanced accuracy
0.0
−2.5
−5.0
−10.0
−20.0
LOP
MILP Repair
FATT
BuDRO