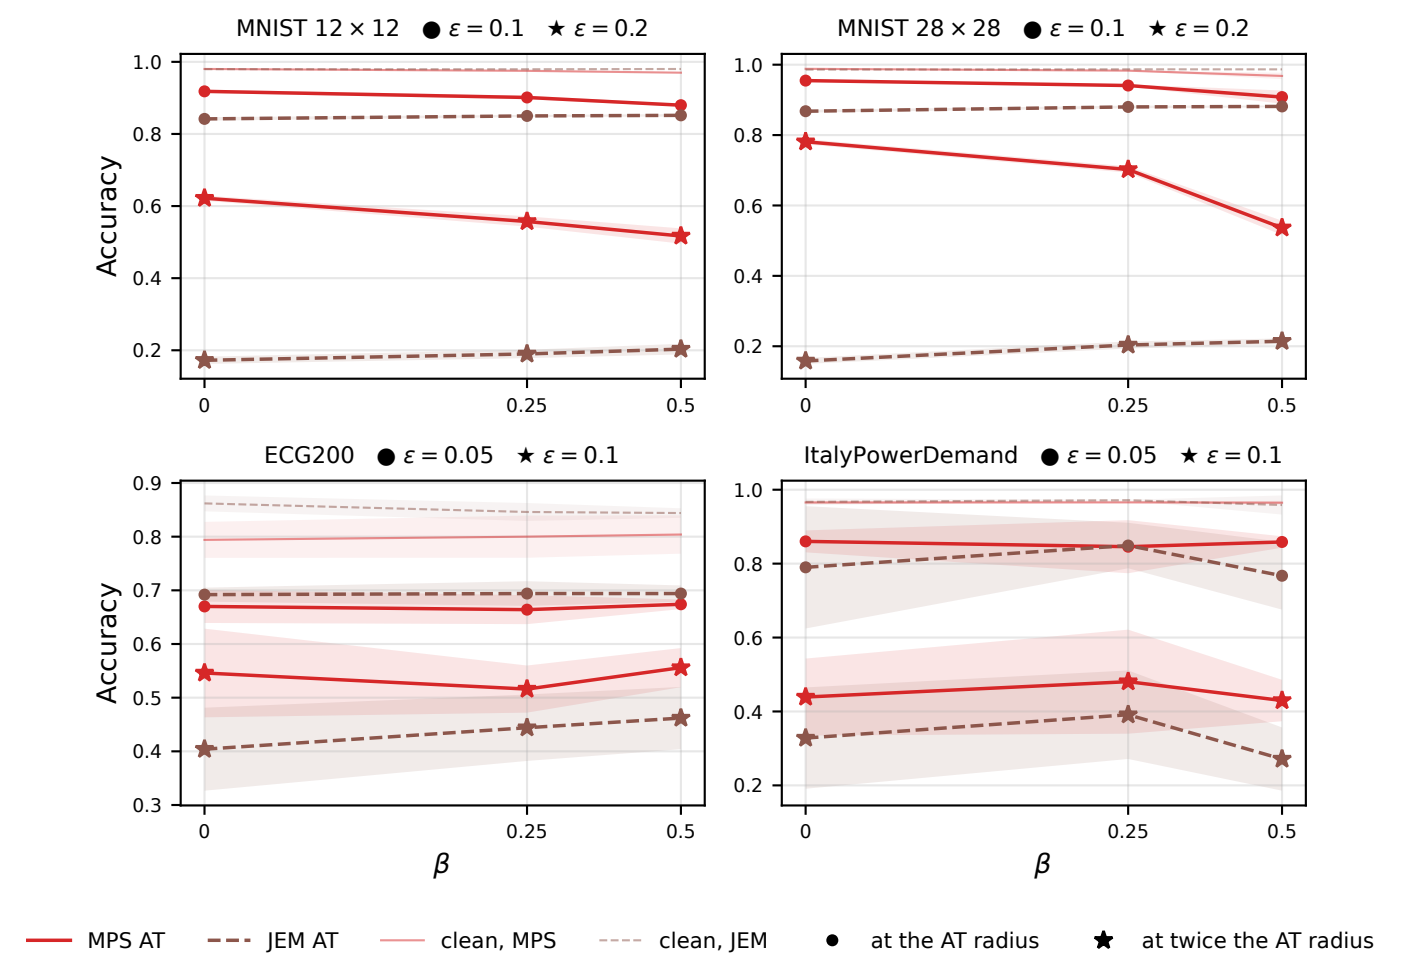
MNIST 12 × 12 ● ε = 0.1 ★ ε = 0.2
MNIST 28 × 28 ● ε = 0.1 ★ ε = 0.2
ECG200 ● ε = 0.05 ★ ε = 0.1
ItalyPowerDemand ● ε = 0.05 ★ ε = 0.1
Accuracy
β
MPS AT
JEM AT
clean, MPS
clean, JEM
at the AT radius
at twice the AT radius