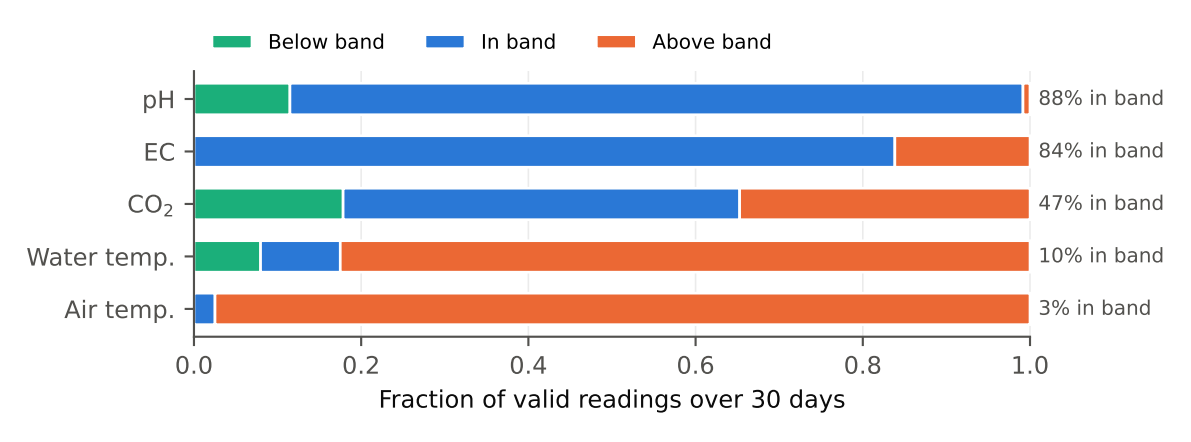
Below band
In band
Above band
pH
EC
CO_2
Water temp.
Air temp.
88% in band
84% in band
47% in band
10% in band
3% in band
0.0
0.2
0.4
0.6
0.8
1.0
Fraction of valid readings over 30 days