

# Service Manual

Room Air Conditioner

**CS-A28BKP5/CU-A28BKP5**



## ⚠ WARNING

This service information is designed for experienced repair technicians only and is not designed for use by the general public. It does not contain warnings or cautions to advise non-technical individuals of potential dangers in attempting to service a product. Products powered by electricity should be serviced or repaired only by experienced professional technicians. Any attempt to service or repair the product or products dealt with in this service information by anyone else could result in serious injury or death.

## CONTENTS

Page	Page		
1 Features .....	2	11 3-way Valve .....	51
2 Functions .....	3	12 Servicing Information .....	58
3 Product Specifications .....	6	13 Troubleshooting Guide .....	62
4 Dimensions .....	8	14 Technical Data .....	64
5 Refrigeration Cycle Diagram .....	9	15 Exploded View .....	67
6 Block Diagram .....	10	16 Replacement Parts List .....	68
7 Wiring Diagram .....	11	17 Exploded View .....	69
8 Operation Details .....	12	18 Replacement Parts List .....	70
9 Operating Instructions .....	22	19 Electronic Parts List .....	71
10 Installation Instructions .....	42	20 Electronic Circuit Diagram .....	72

**Panasonic**


© 2002 Matsushita Air-Conditioning Corp. Sdn. Bhd.  
(183914D) All rights reserved. Unauthorized copying  
and distribution is a violation of law.

# 1 Features

- High Efficiency
- High Efficiency Airflow Circuit
- Compact Design
- Auto Restart after Power Failure
- Long Piping up to 30m
- Catechin Deodorizing Air Filter
- Deodorizing Control during operation
- Cold draught Control

## 2 Functions

### Remote Control

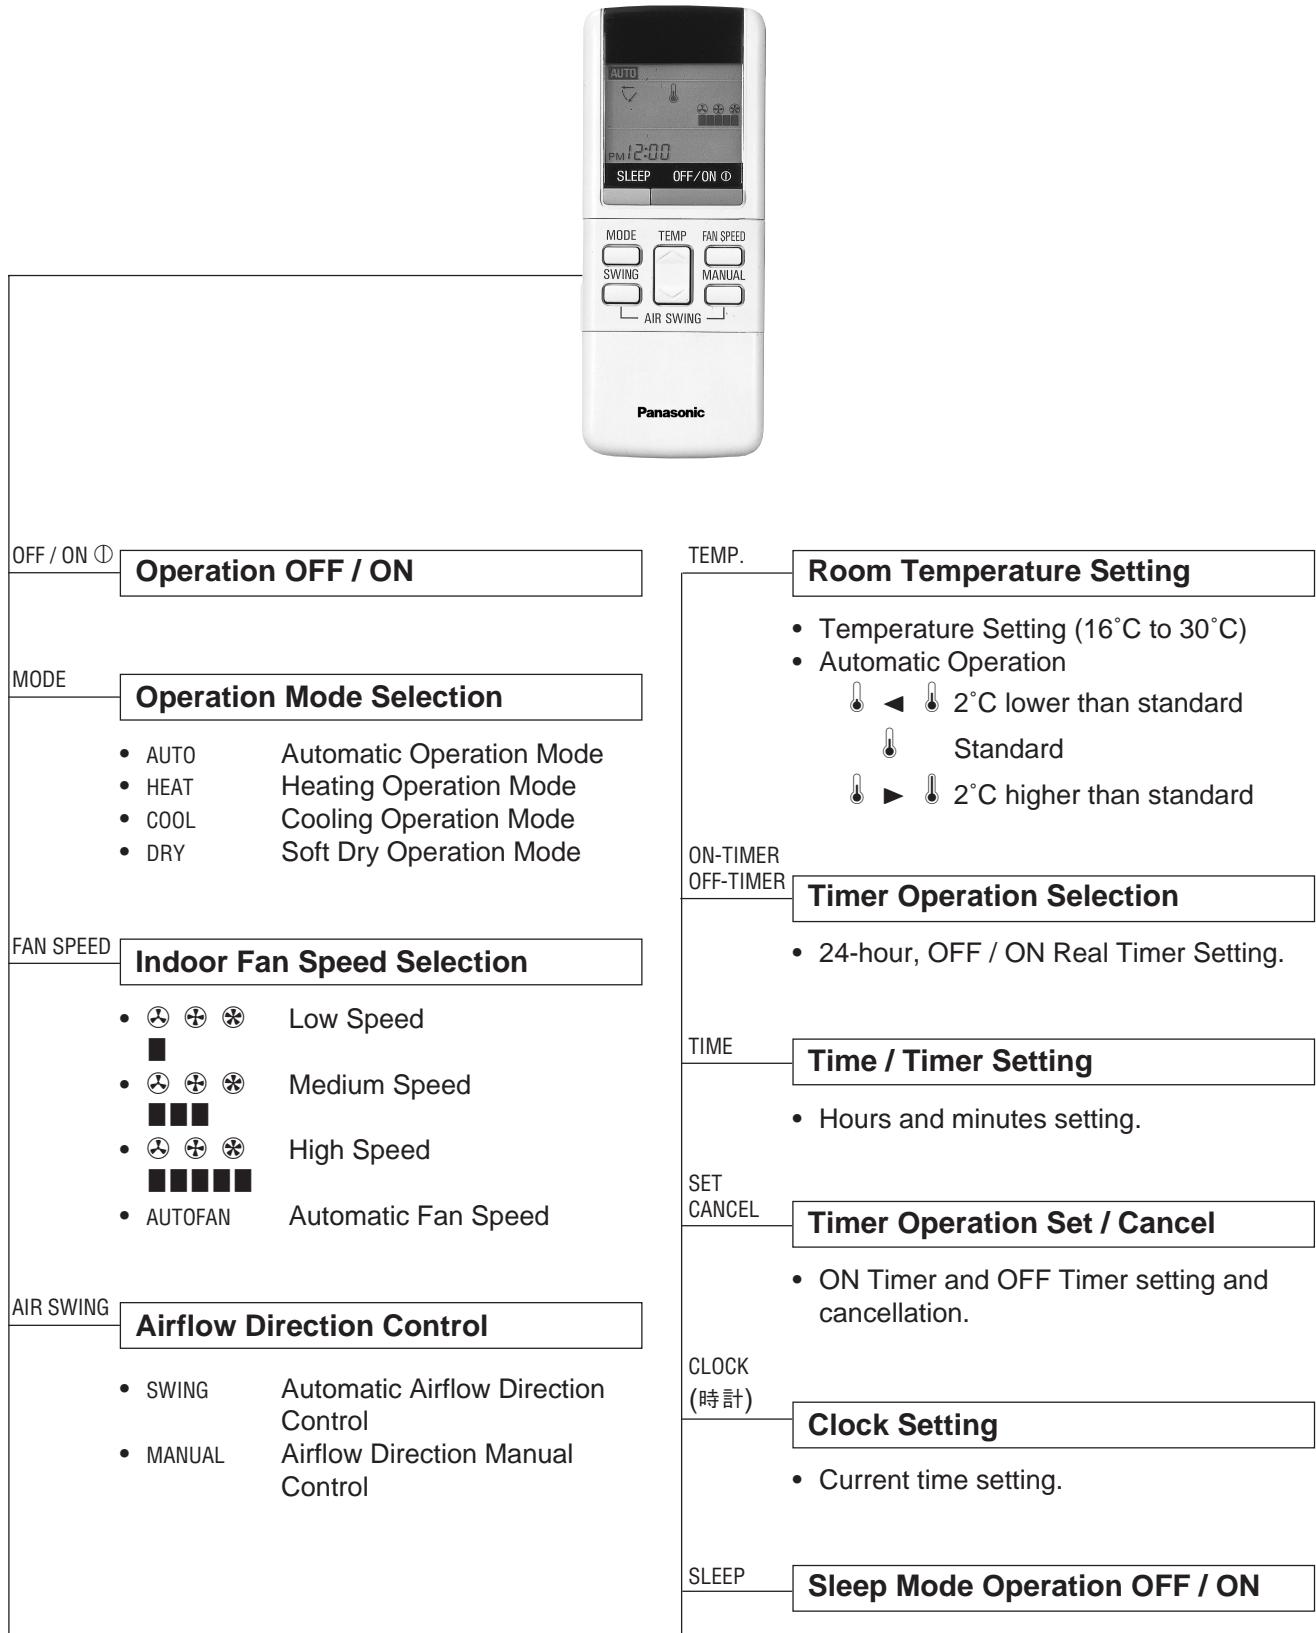

## Indoor Unit

AUTO  
OFF / ON

### Auto Operation Switch

- Used when the remote control cannot be used.

TEST RUN  
OFF / ON

### Operation Test Running / Pump Down Switch

- Used when test running or servicing.

### Operation Indication Lamps (LED)

- POWER (Red)..... Lights up in operation, blinks in Automatic Operation Mode judging and Hot Start operation.
- SLEEP (Orange).... Lights up in Sleep Mode Operation.
- TIMER (Orange).... Lights up in Timer Setting.

### Operation Mode

- Heating, Cooling, Soft Dry, and Automatic Mode.

### Time Delay Safety Control

- Restarting is inhibited for approx. 3 minutes.

### 7 Minutes Time Save Control

- Cooling Operation only.

### Auto Restart Control

- Operation is restarted after power failure at previous setting mode.

### Anti-Freezing Control

- Anti-Freezing control for indoor heat exchanger. (Cooling and Soft Dry)

### Sleep Mode Auto Control

- Indoor Fan operates at Low fan speed.
- Operation stops after 8 hours.

### Indoor Fan Speed Control

- High, Medium and Low.
- Automatic Fan Speed Mode
  - Heating : Fan speed varies from Hi → SLo in accordance with indoor heat exchanger.
  - Cooling : Fan rotates at Hi and Me speed. Deodorizing control is available.
  - Soft Dry: Fan rotates at Lo speed.

### Airflow Direction Control

- Automatic air swing and manual adjusted by remote control for vertical airflow.
- Manually adjusted by hand for horizontal airflow.

### Hot-Start Control

- The indoor fan stops until the indoor heat exchanger temperature over 30°C.
- The indoor fan operates at SLo and Lo when indoor heat exchanger temperature reaches 30°C ~ 42°C.
- Hot start is completed when indoor heat exchanger reaches 42°C.

## Outdoor Unit



### 4-Way Valve Control

- When the unit is switched to “OFF” during Heating operation, 4-way valve stays at Heating Position for 5 minutes.

### Overload Protector

- Inner protector (Compressor, Fan Motor).

### 60 Secs. Forced Operation Control

- Once the compressor is activated, it does not stop for 60 secs. (Stops immediately with remote control stop signal.)




### Outdoor Fan Operation Control

- 4-pole induction motor (2-speed)
- For Cooling or Soft Dry Operation
  - Hi-speed ... when outdoor temperature reaches to 31°C
  - Lo-speed ... when outdoor temperature reaches to 29°C
- For Heating Operation
  - Hi-speed ... when outdoor temperature reaches to 13.5°C.
  - Lo-speed ... when outdoor temperature reaches to 15.5°C.
- For Over-heating Protection, the Fan is switched ON or OFF depending on the piping temperature and the outdoor temperature.

### Deice Control

- To prevent frosting at outdoor heat exchanger during Heating Operation.

### 3 Product Specifications


	Unit	CS-A28BKP5	CU-A28BKP5
Cooling Capacity	kW Btu/h	7.92 - 7.80 27,000 - 26,600	
Heating Capacity	kW Btu/h	8.35 - 8.25 28,500 - 28,200	
Moisture Removal	l/h Pint/h	4.6 9.7	
Power Source	Phase V Cycle	Single 230 - 220 50	
Airflow Method	OUTLET  INTAKE 	SIDE VIEW  TOP VIEW 	
Air Volume	Indoor Air (Lo)	m³/min (cfm)	Cooling; 14.2 (501) Heating; 15.6 (551)
	Indoor Air (Me)	m³/min (cfm)	Cooling; 15.0 (530) Heating; 16.4 (579)
	Indoor Air (Hi)	m³/min (cfm)	Cooling; 16.3 (575) Heating; 17.7 (625)
	Outdoor Air	m³/min (cfm)	— Cooling; 59.0 (2,083) Heating; 59.2 (2,090)
Noise Level		dB (A)	Cooling; 48/46/44 Heating; 48/44
Electrical Data	Input	kW	Cooling; 2.62 - 2.60 Heating; 2.88 - 2.85
	Running Current	A	Cooling; 12.2 - 12.5 Heating; 13.2 - 13.5
	COP	W/W	Cooling; 3.0 - 3.0 Heating; 2.9 - 2.9
	Starting Current	A	76
Piping Connection Port (Flare piping)		inch inch	G ; Half Union 5/8" L ; Half Union 1/4"
Pipe Size (Flare piping)		inch inch	G (gas side); 5/8" L (liquid side); 1/4"
Drain Hose	Inner diameter	mm	14
	Length	m	0.73

Power Cord Length Number of core-wire		m	2.1 3 (2.5 mm <sup>2</sup> )	— —
Dimensions	Height	inch (mm)	14 - 9/16 (370)	26 - 31 3/32 (685)
	Width	inch (mm)	48 - 1/32 (1,220)	34 - 21 3/32 (880)
	Depth	inch (mm)	8 - 21/32 (220)	13 - 19 3/32 (345)
Net Weight		lb (kg)	40 (18)	150 (68)
Compressor	Type		—	Scroll type
	Motor Type		—	Induction (2-poles)
	Rated Output	kW	—	2.11
Air Circulation	Type		Cross-flow Fan	Propeller Fan
	Material		AS + Glass Fiber 30%	AS + Glass Fiber 20%
	Motor Type		Induction (4-poles)	Induction (4-poles)
	Input	W	—	—
	Rated Output	W	40	100
	Fan Speed	Low rpm	Cooling; 1,262 Heating; 1,250	920 - 880
		Medium rpm	Cooling; 1,322 Heating; 1,328	—
		High rpm	Cooling; 1,418 Heating; 1,420	1,200 - 1,170
Heat Exchanger	Description		Evaporator	Condenser
	Tube material		Copper	Copper
	Fin material		Aluminium	Aluminium
	Fin Type		Louver	Louver
	Row / Stage		(Plate fin configuration, forced draft) 2 × 10	2 × 26
	FPI		18	18
	Size (W × H × L)	mm	966.5 × 254 × 44	826 × 663.9 × 44
Refrigerant Control Device			—	Capillary Tube
Refrigeration Oil		(cm <sup>3</sup> )	—	SONTEX 200 LT (1,242)
Refrigerant (R-22)		g (oz)	—	1,800 (63.5)
Thermostat			Electronic Control	Electronic Control
Protection Device			Inner Protector	Inner Protector
Capillary Tube	Length	mm	—	Cooling; 850, Heating; 1,200
	Flow Rate	l/min	—	Cooling; 21.8, Heating; 23 (1/2 ATM)
	Inner Diameter	mm	—	Cooling; 2.0, Heating; 2.4
Air Filter	Material Style		A.B.S Honeycomb	—
Compressor Capacitor		μF, VAC	—	50 μF, 370VAC
Fan Motor Capacitor		μF, VAC	2.0 μF, 450VAC	3.0 μF, 450VAC


- Specifications are subject to change without notice for further improvement.

## 4 Dimensions

### CS-A28BKP5/ CU-A28BKP5

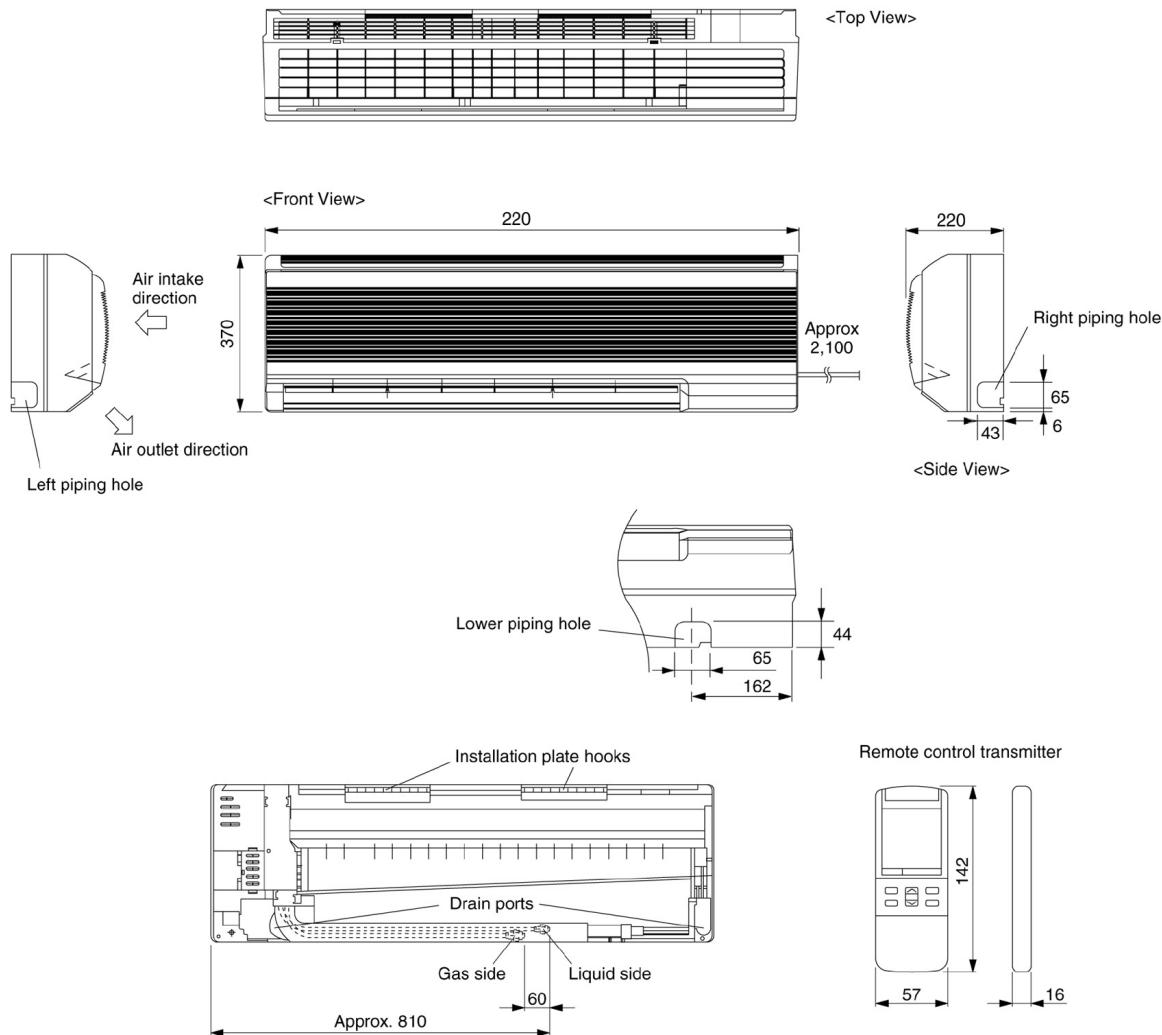


Relative position between the indoor unit and the installation plate <Front View>

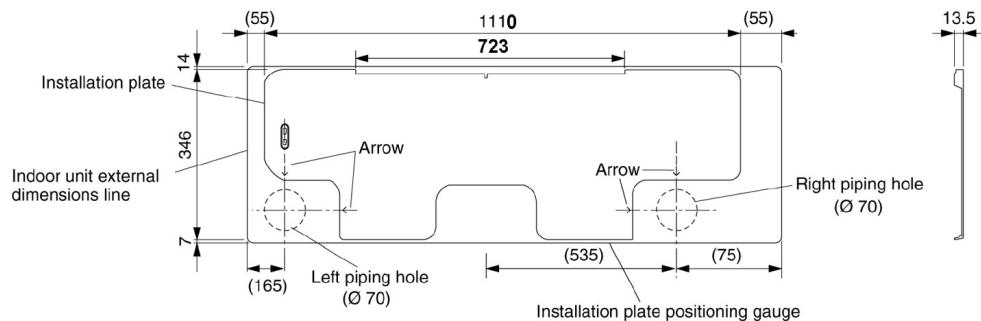


# Dimensions

## CS-A28BKP5/CU-A28BKP5

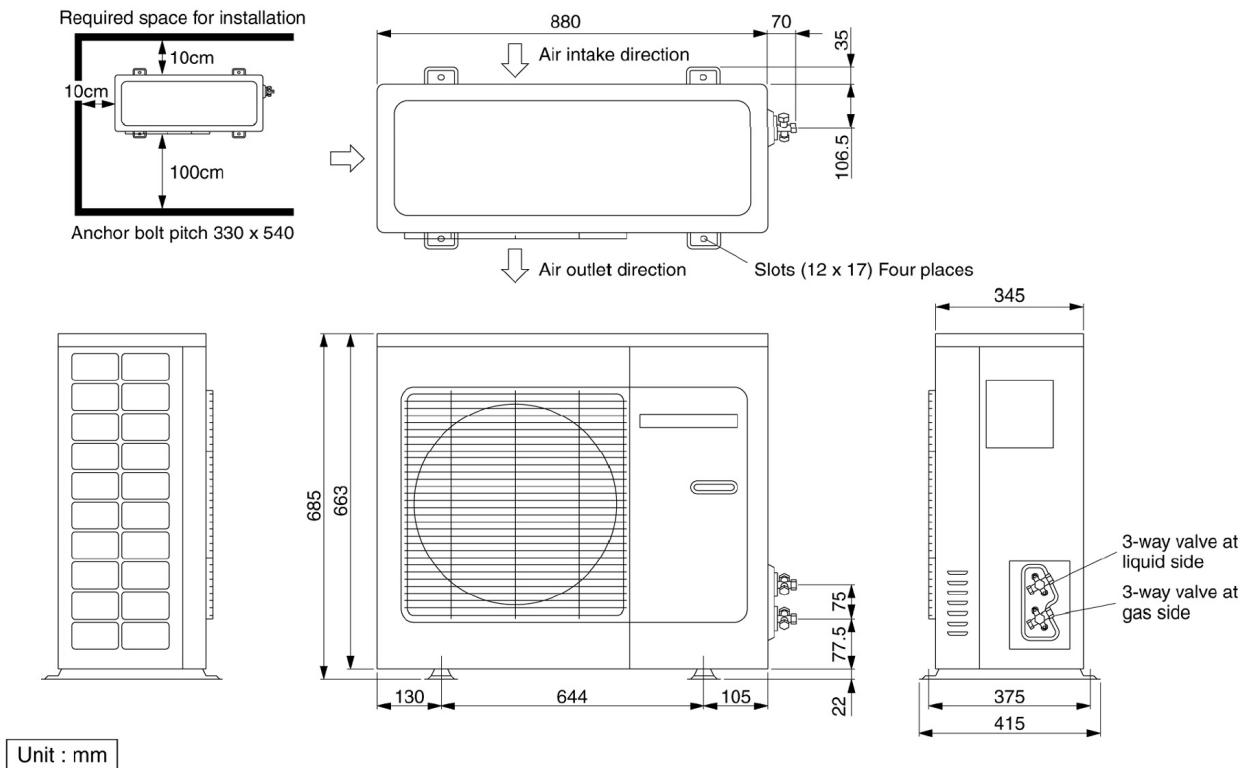


## 5 Refrigeration Cycle Diagram

### CS-A28BKP5/CU-A28BKP5

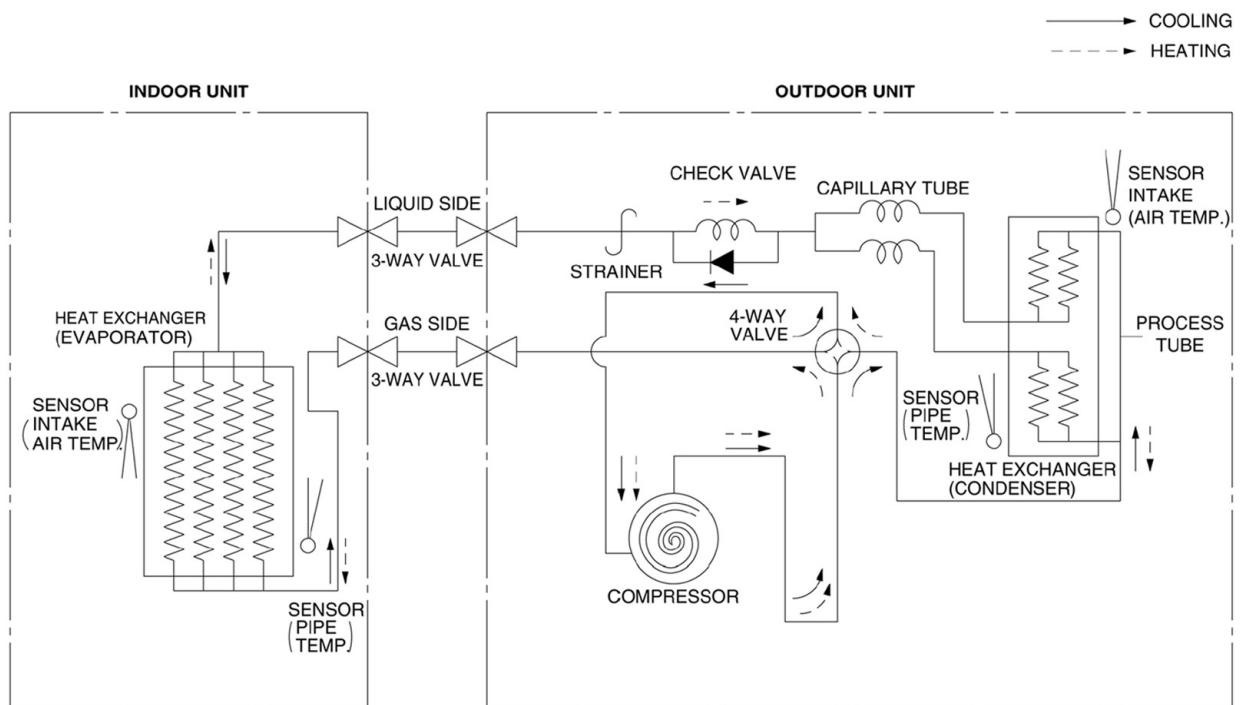


## 6 Block Diagram

### CS-A28BKP5/CU-A28BKP5

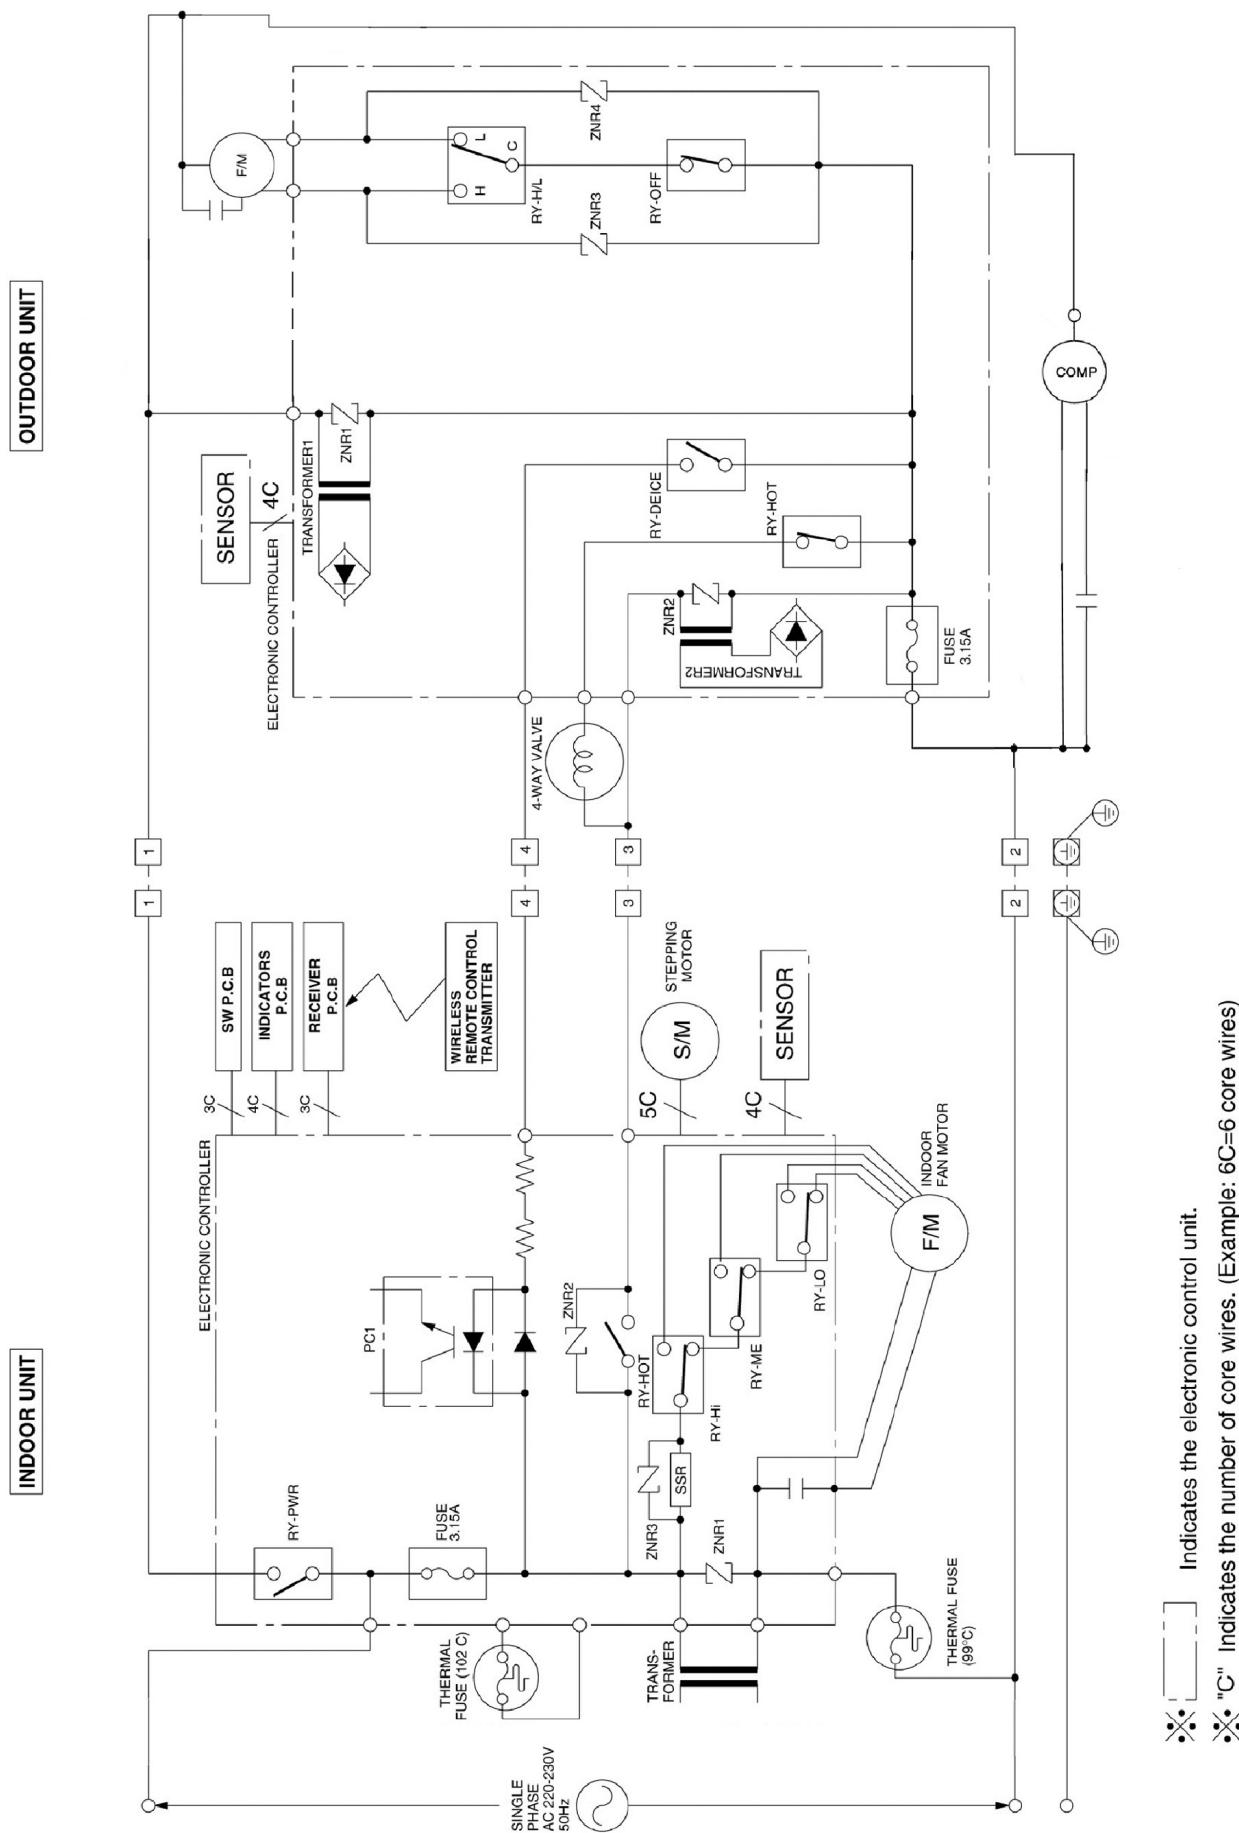

# 7 Wiring Diagram

## CS-A28BKP5 / CU-A28BKP5

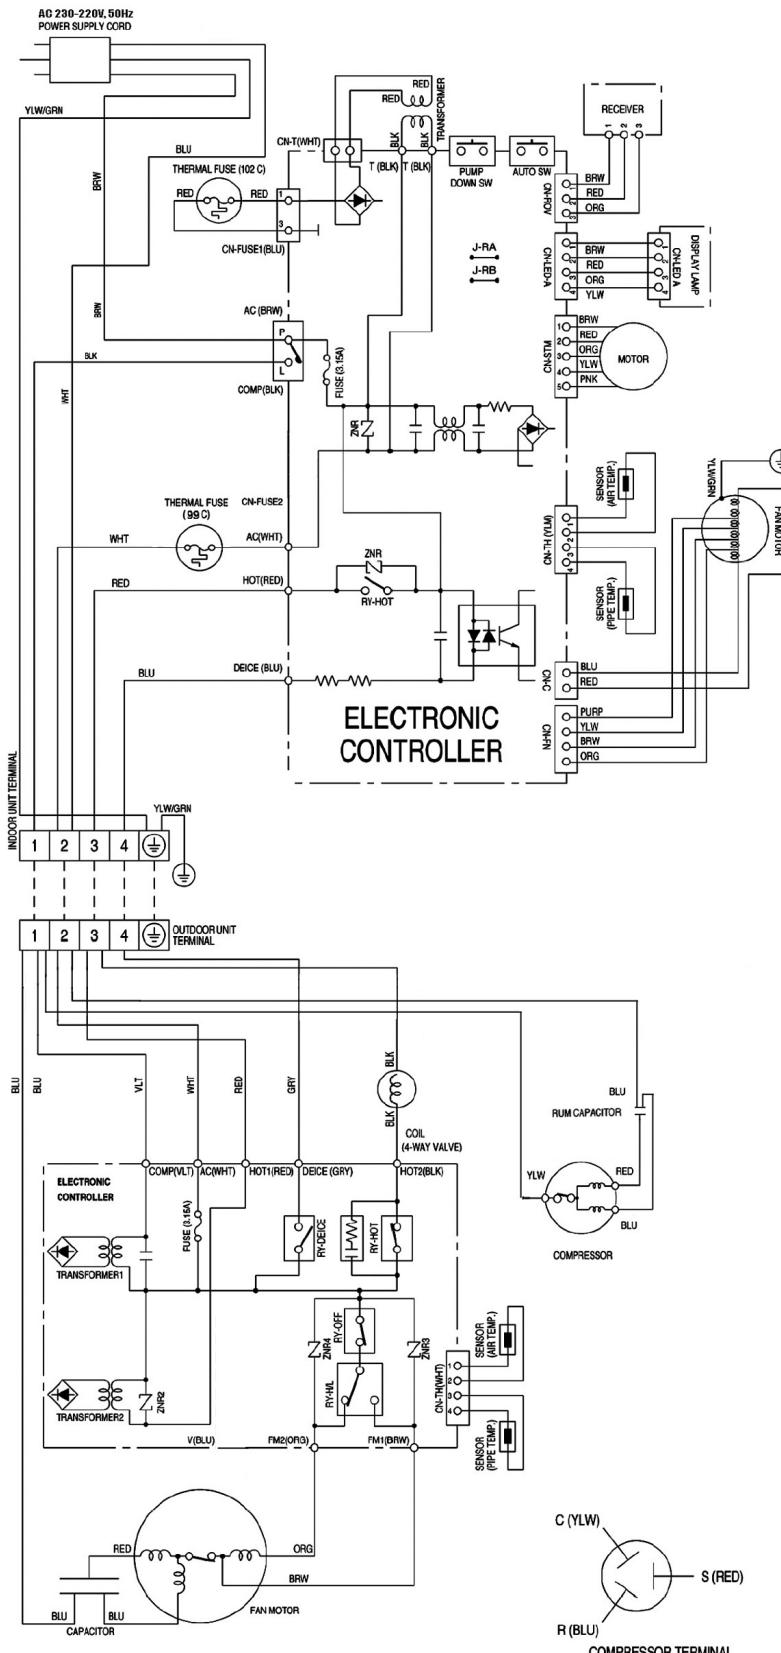

### Remarks:

BLU	: BLUE
BRW	: BROWN
BLK	: BLACK
WHT	: WHITE
RED	: RED
ORG	: ORANGE
PNK	: PINK
YLW	: YELLOW
GRN	: GREEN
GRY	: GRAY
VLT	: VIOLET
PURP	: PURPLE

### Resistance of Indoor Fan Motor Windings

CONNECTION	CWC4301-370
BLUE - PURP	126.2
PURP - YLW	104.5
YLW - BRW	48.1
BRW - ORG	48.5
RED - PURP	131.0

### Resistance of Outdoor Fan Motor Windings

CONNECTION	CWC4301-380
BLUE - BROWN	50.81
BROWN - ORANGE	34.3
RED - BROWN	92.4

### Resistance of Compressor Windings

CONNECTION	ZR34K3PFJ512
C - R	0.937 Ω
C - S	2.07 Ω

## 8 Operation Details

### 8.1. Cooling Mode Operation

Cooling in operation according to Remote Control setting.

#### Time Delay Safety Control (3 minutes)


- When the compressor is stopped by Power Switch, Remote Control or there is a power failure, it restarts after 3 minutes when the Power Switch, Remote Control is turned ON or the power supply is resumed.
- When the setting temperature is reached during cooling operation, the compressor stops and it will not start for 3 minutes.

#### 7 minutes Time Saved Control

- The compressor will start automatically if it has stopped for 7 minutes even if the room temperature is below the compressor ON temperature.

#### Anti-Freezing Control


- If the temperature of the indoor heat exchanger falls continuously below 2°C for 4 minutes, the compressor turns off to protect the indoor heat exchanger from freezing. The fan speed setting remains the same.
  - Compressor recommences when the indoor heat exchanger temperature rises to 10°C (Recovery).
-  3 minutes waiting of Time Delay Safety Control is valid for Cooling Operation.

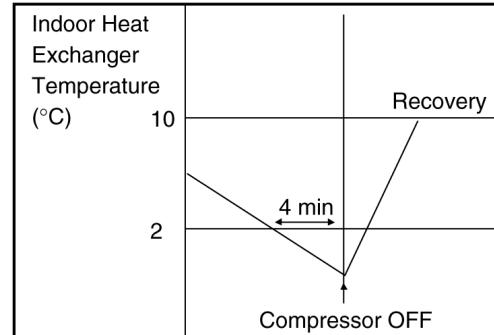

### Automatic Fan Speed Mode

When Automatic Fan Speed is selected at Remote Control during cooling operation.


- Fan speed rotates in the range of Hi to Me.
- Deodorizing Control.

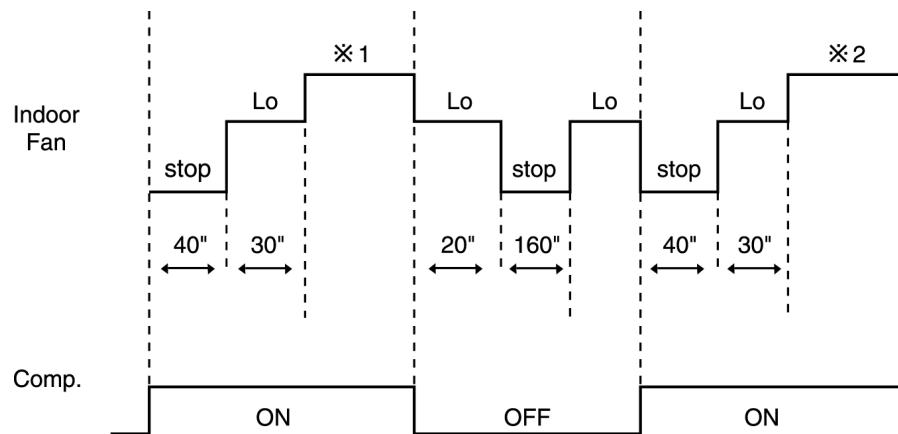

※ 1 Fan Speed is Hi until the compressor stops (when the room temperature reaches setting temperature).

※ 2 Fan Speed is Me after the compressor restarts.

### Cooling Operation Time Diagram

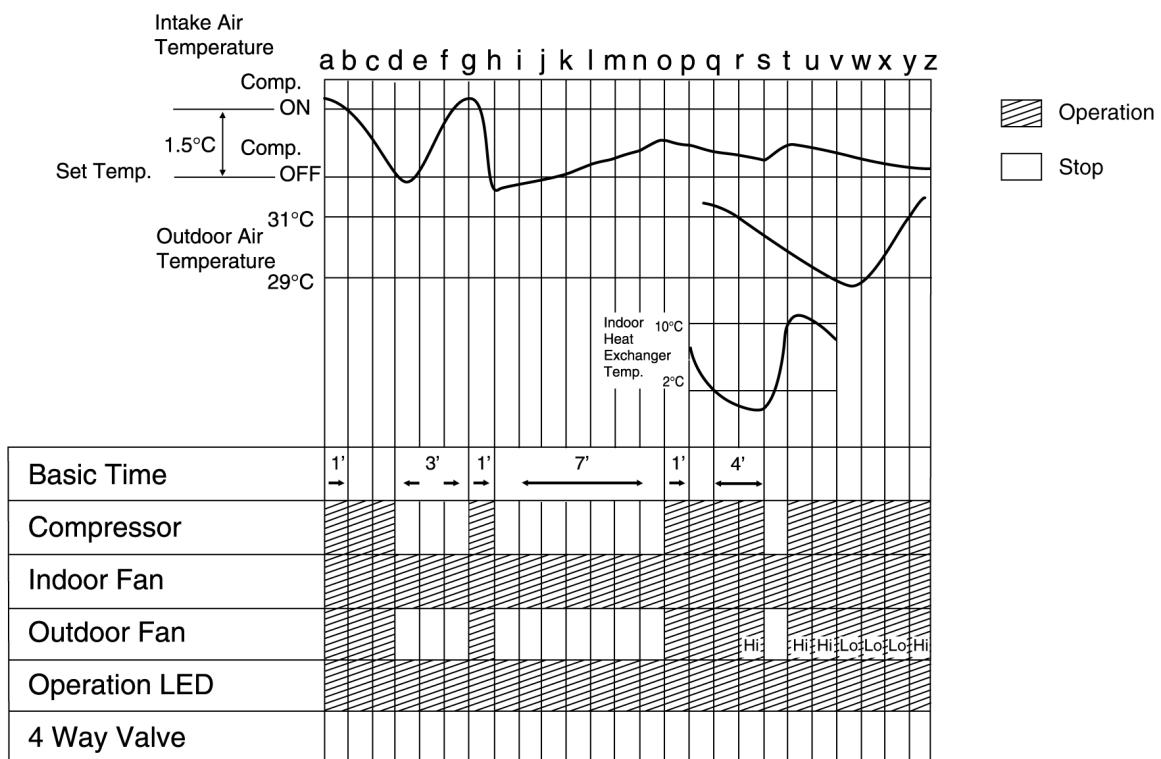

#### <Description of operation>

d - g : Time Delay Safety Control (waiting for 3 minutes)

g - h : 60 sec. Forced Operation

h - o : 7 min. Time Saved Control

q - t : Anti Freezing Control

v - y : Outdoor Fan Control

## 8.2. Soft Dry Mode Operation

- The unit starts cooling operation until the room temperature reaches the setting temperature set on the Remote Control, and then Soft Dry operation will start.
- During Soft Dry operation, the Indoor Fan operates with Lo speed.
- Once room temperature reaches below Soft Dry OFF temperature, Indoor Fan, Compressor and Outdoor Fan Stop for 6 minutes.

### Time Delay Safety Control

- Once the compressor stops, it will not start for 3 minutes during Cooling operation.


### Anti-Freezing Control

- Same as Anti-Freezing Control for Cooling Mode operation. (For Soft Dry region, 6 minutes waiting is valid during compressor stops.)


### Automatic Fan Speed Mode

When Automatic Fan Speed is selected at Remote Control during Soft Dry operation.

- Fan speed rotates at Lo speed.
- Deodorizing Control.

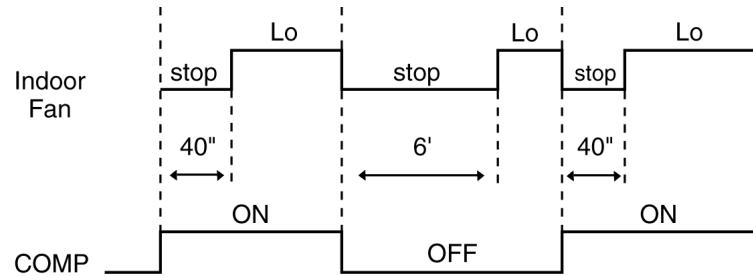

Soft Dry Operation Time Diagram

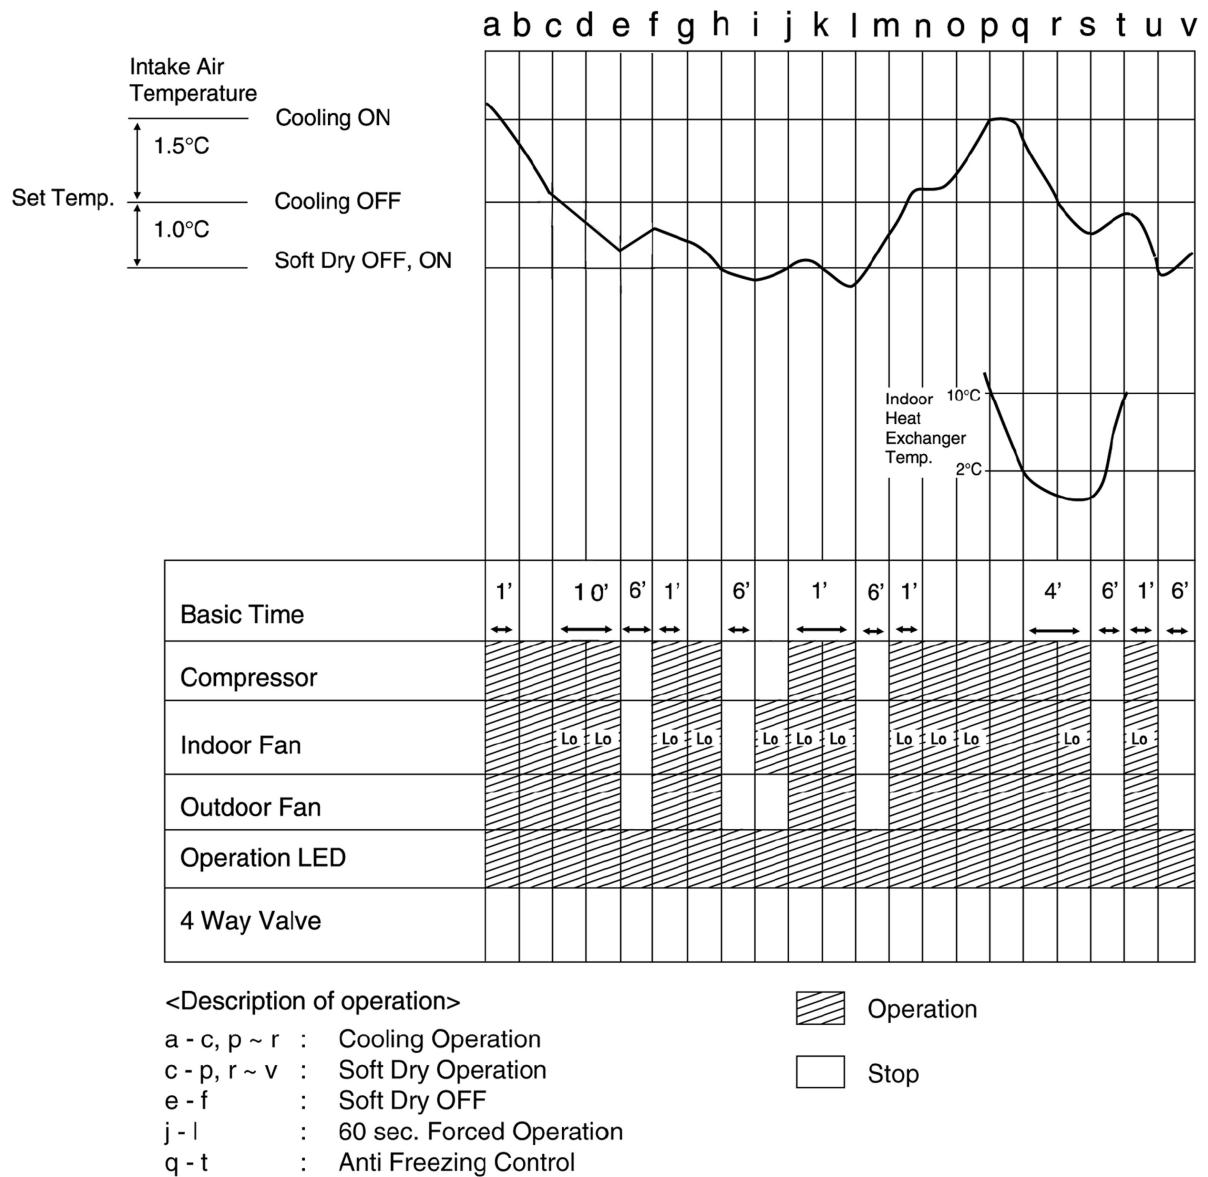

## 8.3. Heating Mode Operation

- Heating in operation according to Remote Control setting.

### Time Delay Safety Control

- When the compressor is stopped by Power Switch, Remote Control or there is a power failure, it restarts after 3 minutes when the Power Switch, Remote Control is turned ON or the power supply is resumed.
- When the setting temperature is reached during heating operation, the compressor stops and it will not start for 4 minutes.

### 30 minutes Time Saved Control

- The compressor will start automatically if it has stopped for 30 minutes even if the room temperature is below the compressor OFF temperature.

### Overload Protection Control

- If the temperature of the Outdoor Heat Exchanger less than -3°C, Outdoor Fan is ON. The Outdoor Fan stop, when Outdoor Heat Exchanger temperature is  $T_b$  or more according to Outdoor Air Temperature region as table below:

Outdoor Air Temperature	<10°C	≥10°C~15°C	≥15°C~<20°C	≥20°C~<25°C	≥25°C	Outdoor Fan OFF
$T_b$	≥5°C	≥4°C	≥3°C	≥2°C	≥1°C	

During starting of Heating mode and after deice, Outdoor Fan ON for 90 sec. (Hi).

- If the Indoor heat exchanger becomes 68°C or more, the compressor will stop and restart automatically.  
(Time Delay Safety Control - 4 minutes waiting)




### 4-way Valve Control

- 4-way valve ON during Heating operation, except deicing operation.
- When the unit is switched to "OFF" during Heating operation, 4-way valve stay at Heating position for 5 minutes.

### Hot Start Control

When Heating operation starts, Indoor Fan will not start until the indoor heat exchanger reaches 30°C as diagram shown.

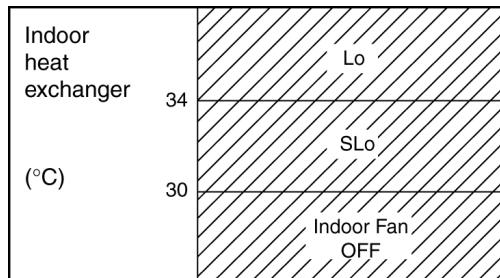


Hot Start is completed when indoor heat exchanger reaches 42°C.

Maximum Hot start duration = 4 minutes. After 4 minutes, Hot start operation will be shifted to normal Heating operation.


### Automatic Fan Speed Mode

When Automatic Fan Speed is selected at Remote Control during heating operation.

- Fan speed rotates in the range of Hi → SLo according to the heat exchanger temperature.

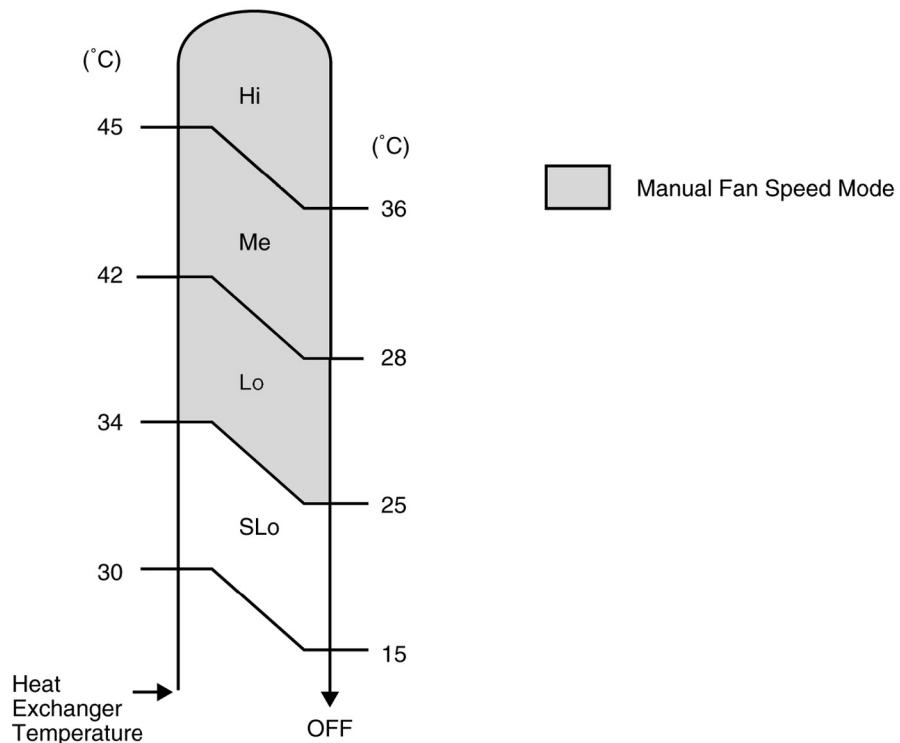

### Heating Operating Time Diagram

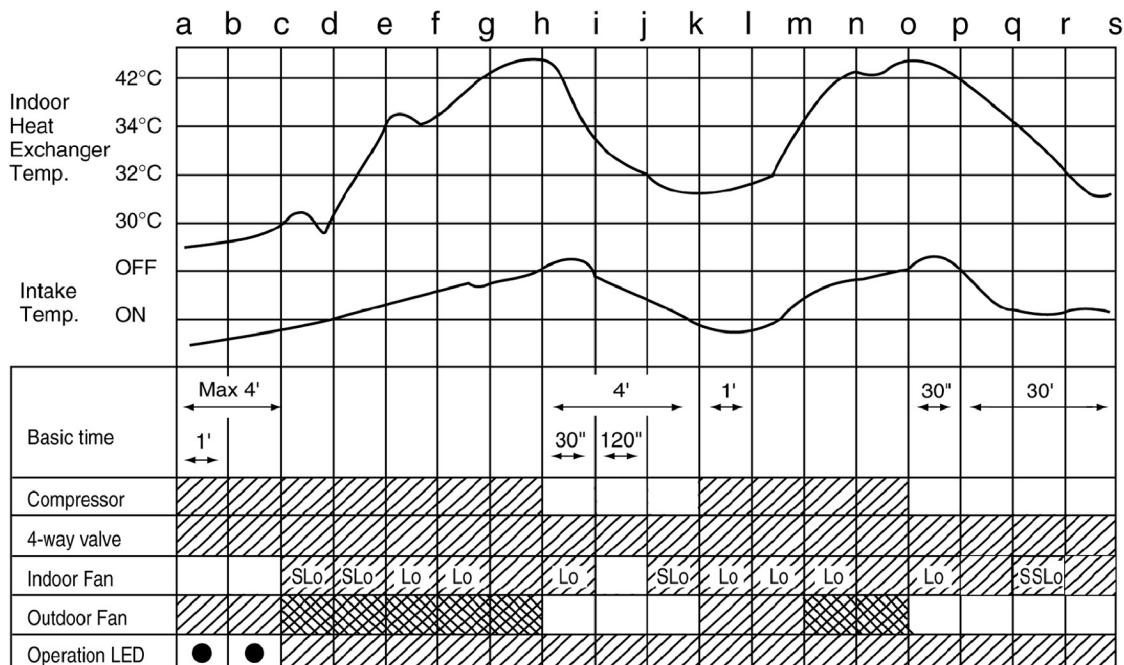

#### <Description of operation>

- a - c : Hot start (Indoor fan = OFF)
- c - d : Hot start (Indoor fan = SLo)
- h - k, o - s : Indoor fan control (controlled during thermostat OFF)

- : Blinking
- : Operation
- : Stop
- ▨ : Operation or Stop

## Deicing Control

Deice starts to prevent frosting at outdoor heat exchanger.

- Normal Deicing

Deice operations detection commences in Heating operation starts or 60 minutes after previous deice operation. If the outdoor piping temperature drops to -4°C for 50 sec. continuously during compressor is in operation, deice will start.  
(There is no detection during Outdoor Fan stops.)

- Overload Deicing


During heating operation, if the outdoor Fan OFF duration (due to overload control) is accumulated up to 60 minutes and after compressor starts for 1 minute, deicing starts.

- Deicing ends when

- 12 minutes after deicing operation starts;
- The outdoor piping temperature rises to about 12°C.

- After deicing operation, compressor stops for 30 seconds and 4-way valve stays at cooling position for 10 seconds.

### a) Normal Deicing Time Diagram

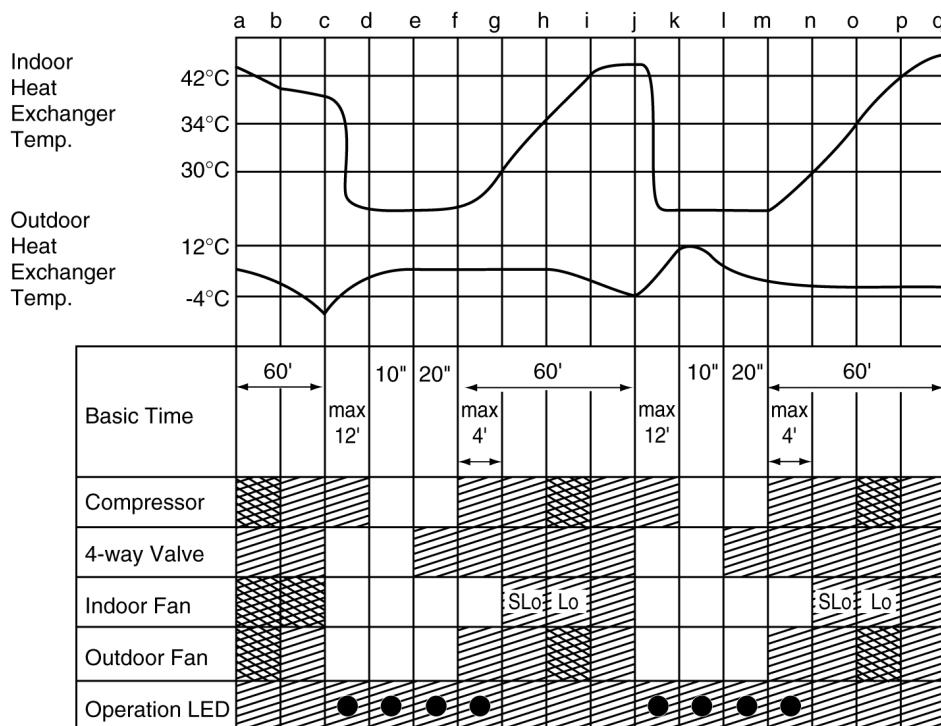


#### <Description of operation>

- a - c : Deicing operation judging condition established.  
c - f : Deicing operation.  
f - g : Hot start (add 4 minute delay timing)

- : Blinking
- ▨ : Operation
- : Stop
- ▨▨ : Operation or Stop

### b) Overload Deicing Time Diagram

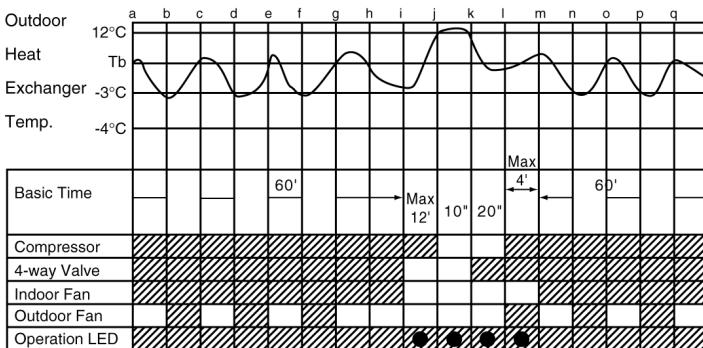

&lt;Description of operation&gt;


- a - i : Overload control.
- i - l : Overload deicing.
- l - m : Hot start (add 4 minutes delay timing).
- m - r : Overload control.

- : Blinking
- ▨ : Operation
- : Stop

## 8.4. Automatic Mode Operation

- When the Automatic Mode Operation is selected, the indoor fan operates at SLo fan speed for 20 seconds to sense intake air temperature and determine the 1st operation mode.

### Standard for Determining Operation Mode 1st Judgement

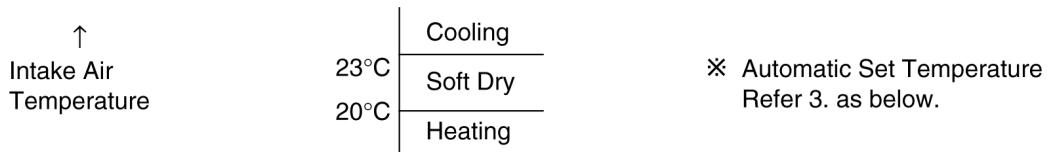

- Operation mode will be determined again after 1 hour of operation, if the room temperature reaches to set temperature and compressor off time is over 7 minutes 30 seconds continuously.

- ☒ Indoor intake air is less than 16°C, Heating mode will immediately operate. (only in the first time judgement)
- ☒ The present operation mode will be continued, if the room temperature does not reach to set temperature (Compressor keeps running) even though after 1 hour from automatic operation mode started.

For 2nd judgement onwards, indoor fan will operate for 20 seconds to sense the intake air temperature for determining operation mode.

### Standard for Determining Operation Mode 2nd Judgement onwards

Present Mode	Judgement	Next Mode		
		Cooling	Soft Dry	Heating
Cooling	23°C   Cooling Heating	O (Judgement: 23°C & Above)	Not Applicable	O (Judgement: Below 23°C)
Soft Dry	20°C   Soft Dry Heating	Not Applicable	O (Judgement: 20°C & Above)	O (Judgement: Below 20°C)
Heating	25°C   Cooling Heating	O (Judgement: 25°C & Above)	Not Applicable	O (Judgement: Below 25°C)

☒ Automatic Set Temperature Refer 3. as below.

### 3. Automatic Set Temperature

For each operation, set temperature will automatically set as shown below.

However it can be selected 2°C higher or 2°C lower from standard set temperature by pressing the "Room Temperature Setting button".


Operation Mode	Higher	Standard	Lower
	(+2°C)	(±0°C)	(-2°C)
Cooling	27°C	25°C	23°C
Soft Dry	24°C	22°C	20°C
Heating	23°C	21°C	19°C

## 8.5. Sleep Mode Auto Operation

### Cooling or Soft Dry Operation

When you press the SLEEP Mode, the following movement will start to avoid overcooling.


- The fan speed refer to Indoor Fan Motor Control.
- The setting temperature will be risen by **0.5°C** at the start of operation and by **0.5°C** one hour later.
- The operation will stop after **8 hours**.
- When using together with the Timer, the ON-Timer has priority.

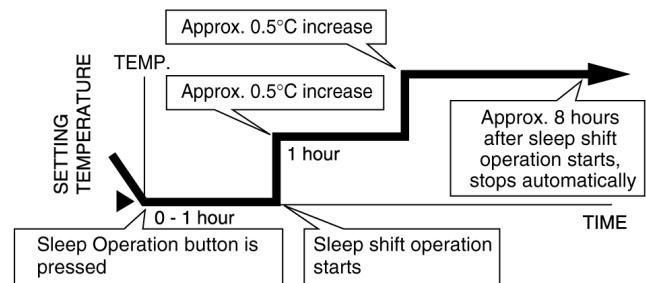

### Heating Operation

When you press the SLEEP Mode, the following movement will start to avoid overheating.

- The fan speed refer to Indoor Fan Motor Control.
- The setting temperature will be descended by **2°C** at the start of operation and by **3°C** one hour later.
- The operation will stop after **8 hours**.
- When using together with the Timer, the ON-Timer has priority.

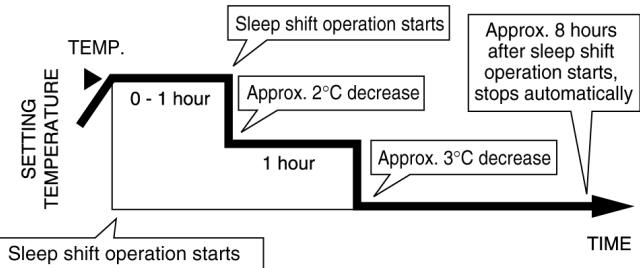

## 8.6. Auto Restart Control

- If there is a power failure, operation will be automatically restarted when the power is resumed.  
It will start with previous operation mode and airflow direction.  
(Time Delay Safety Control is valid)
- Auto Restart Control is not available when Timer or Sleep Mode is set.
- This control can be omitted by cutting the jumper wire J2. (Refer Circuit Diagram)

## 8.7. Indoor Fan Speed Control

- Auto Fan Speed Control

When set to Auto Fan Speed, the fan speed is adjusted between maximum and minimum setting as shown in the table.

- Manual Fan Speed Control


Basic fan speed adjustment (3 settings, from Lo to Hi) can be carried out by using the Fan Speed selection button.

Fan Speed		High Speed ↔ Low Speed						
Cooling	Manual	O	O	O				
	Auto	O	O	O				O
	Sleep			O				
Soft Dry	Manual, Auto			O				O
	Sleep			O				
Heating	Manual	O	O	O				
	Auto	O	O	O	O			O
	Sleep			O	O	O		
		Hi	Me	Lo	SLo	SSLo		STOP

## 8.8. Airflow Direction Control

### Airflow Direction Auto-Control


- When set a Airflow Direction Auto-Control with remote control, the louver swings up and down as shown in the diagram.
- The louver does not swing when the Indoor Fan stops during operation.
- When stopped with remote control, the discharge vent is closed with the louver.

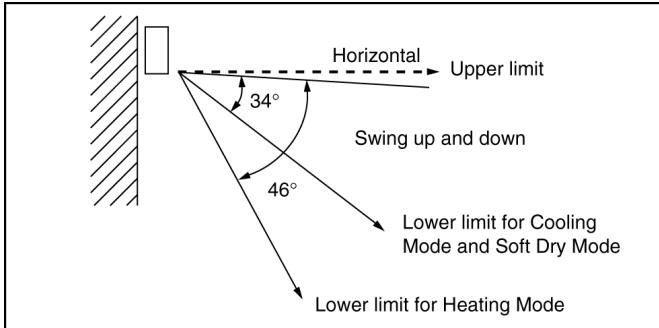

- ※ The left and right airflow direction louvers can be adjusted manually.
- ※ 1 There is no swinging while indoor fan is stopped during Cooling and Soft Dry operation.
- ※ 2 In Heating operation, when the indoor heat exchanger temperature rises to 38°C, the airflow direction is changed from upper limit to lower limit. When the indoor heat exchanger temperature falls to 35°C, the air flow direction is changed from lower limit to upper limit.

### Airflow Direction Manual Control

- When the airflow direction set button is pressed, the automatic airflow is released and the airflow direction louver move up and down in the range shown in the diagram. The louver can be stopped by releasing the button at the desired louver position.
- When the remote control is used to stop the operation, the discharge vent is closed with airflow direction louver.

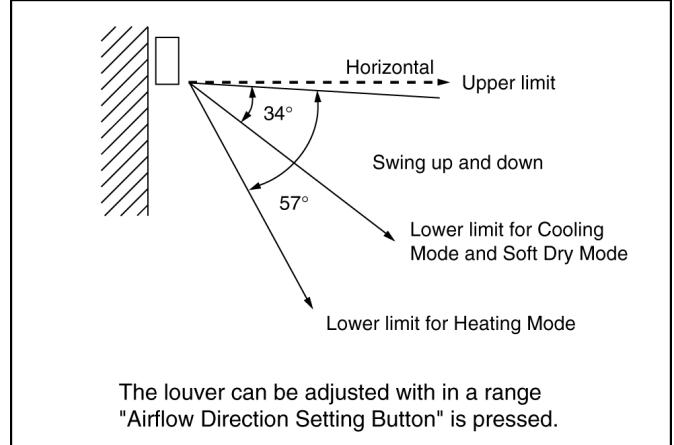


- ※ The left and right airflow direction louvers can be adjusted manually.


## 8.9. Delay ON Timer Control

- When the Delayed ON Timer is set by using the remote control, the unit will start operate slightly before the set time, so that the room will reach nearly to the set temperature by the desired time.
- For Cooling and Soft Dry mode, the operation will start 15 minutes before the set time.
- For Heating mode, the operation will start 30 minutes before the set time.
- For Automatic mode, the indoor fan will operate at SLo speed for 20 seconds, 30 minutes before the set time to detect the intake air temperature to determine the operation mode. The operation indication lamp will blink at this time.

## 8.10. Cold Draught Control

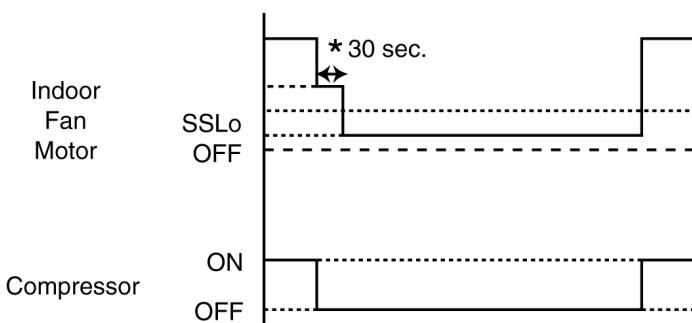

\* For the first 30 sec from thermo off, fan speed will follow piping temp. as below.

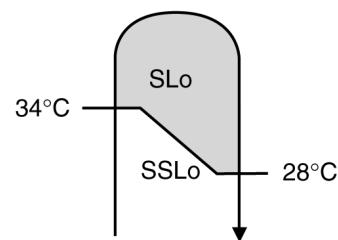

- When COMP = Thermal OFF, indoor fan speed immediately changed to SLo for 30 sec., followed by SSLo speed until COMP = ON.
- During cold draft c/m operation, fan speed will be SSLo only.
- SSLo: Fan will be running at Lo speed with SSR ON for 0.6 sec. and OFF for 5.0 sec.

## 9 Operating Instructions

### Safety Precautions

#### Before operating, please read the following "Safety Precautions" carefully.

To prevent personal injury, injury to others and property damage, the following instructions must be followed.

- Incorrect operation due to ignoring of instructions will cause harm or damage, the seriousness of which is classified as follows :



**Warning** : This sign warns of death or serious injury.



**Caution** : This sign warns of injury or damage to property only.

- The instructions to be followed are classified by the following symbols :



This symbol (with a white background) denotes an action that is PROHIBITED.



These symbols (with a black background) denote an action that is COMPULSORY.

### Installation precautions



**Warning**

- **Do not install, remove and reinstall the unit yourself.**

Improper installation will cause leakage, electric shock or fire. Please consult an authorized dealer or specialist for the installation work.



**Caution**

- **This room air conditioner must be earthed.**



Improper grounding could cause electric shock.

- **Ensure that drainage piping is connected properly.**



Otherwise, water will leak out.

- **Do not install the unit in a place where there may be explosive gas leaks.**



Gas leaks near the unit could cause fires.

## Operation precautions



### Warning

**■ Insert the power plug properly.**

Heat generated by a loose power plug could cause electric shock or fire.  
Electrical outlet and power plug shall be easily accessible.




**■ Do not modify the length of the power cord or use an extension cord.**

It could cause electric shock or fire.




**■ Do not be directly exposed to the cold airstream for too long.**

It could lead to health problems.



**■ Do not operate or stop the unit by inserting or pulling out the power plug.**

It could cause electric shock or fire.




**■ Do not operate the unit with wet hands.**

It could cause an electric shock.




**■ Do not damage or use an unspecified power cord.**

It will cause electrical shock or fire.




**■ Do not insert finger, sticks or other objects into the units.**

It could lead to physical injury and cause damage to the units.

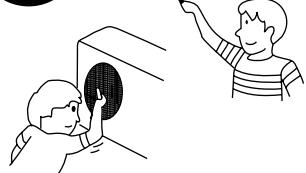


**■ Do not try to repair the unit yourself.**

It could lead to fire or cause an electric shock. Please call an authorized dealer or service centre.



Switch off the breaker. Disconnect the power plug.




**Caution**


**■ Do not remove the power plug by pulling the cord.**

Hold the plug when disconnecting the plug from the wall outlet.



**■ Do not use for other purposes.**

Do not use for preservation purposes. It will affect food quality, animals or plants.

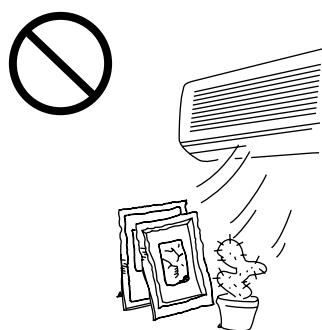


**■ Do not wash the unit with water.**

It could cause an electric shock.




**■ Switch off the power supply if the unit is not going to be used for a long period of time.**

If dust accumulates on the plug, it will generate heat and this could cause a fire.

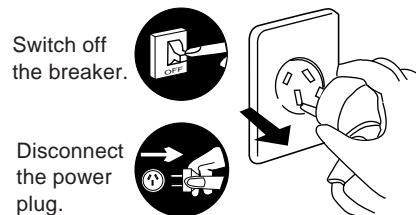


**■ When cleaning the unit, remove the plug.**

This is to prevent injury due to the rotating fan in the unit.

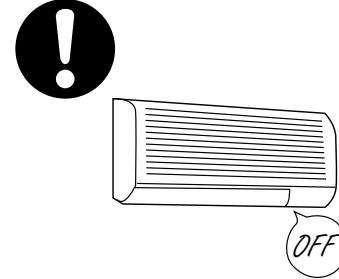

**■ Do not place combustor in the path of the airflow from the unit.**

Incomplete combustion could cause toxic gas (CO) poisoning.

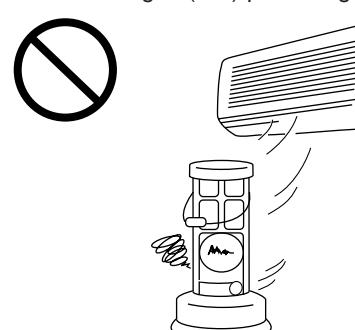


**■ Ventilate the room regularly.**

If not ventilated regularly, the lack of oxygen could cause headaches.




**■ Inspect the unit for any damage.**

Ensure that the necessary repairs are carried out.


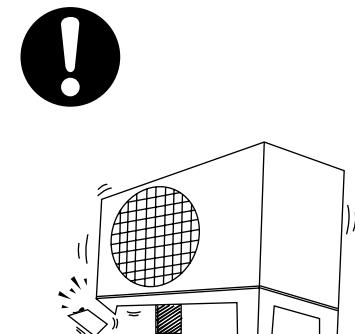


**■ Do not sit or place anything on the outdoor unit.**

You might fall off or the unit might collapse.

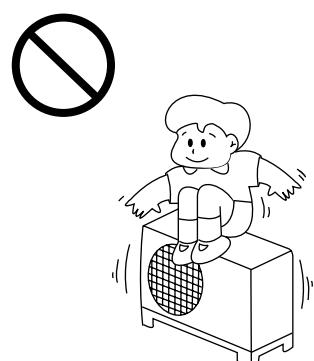


## Name of Each Part

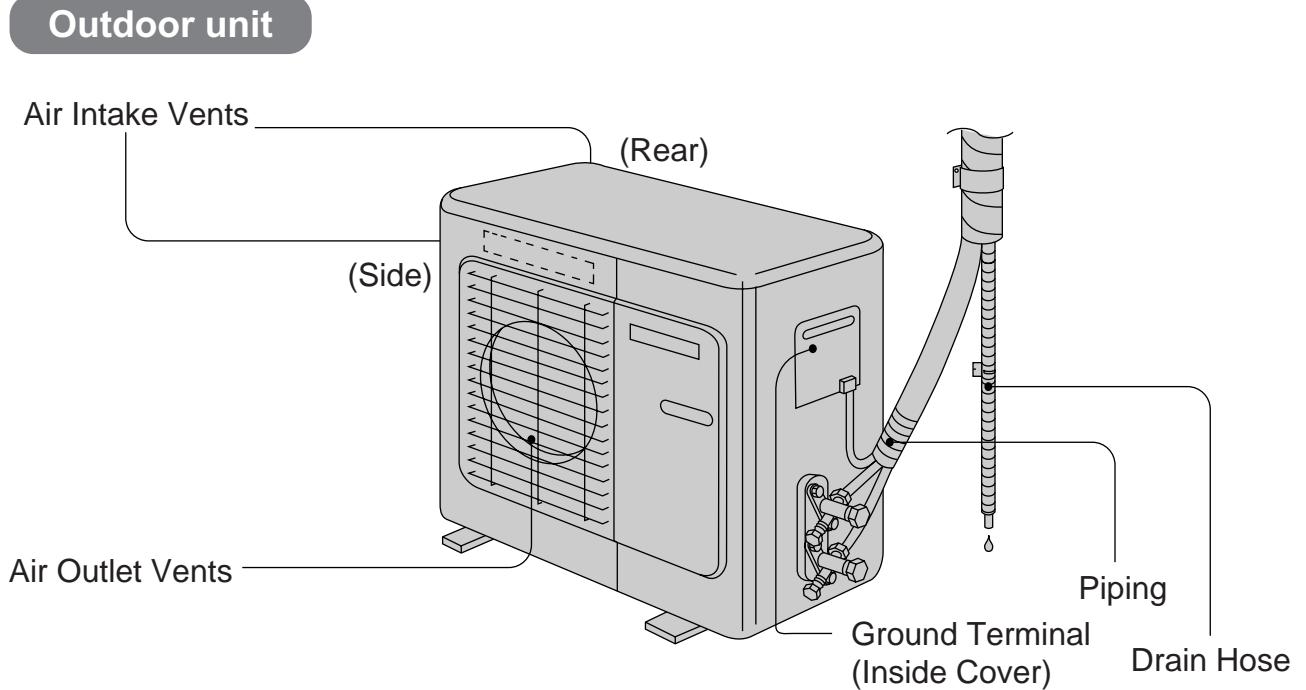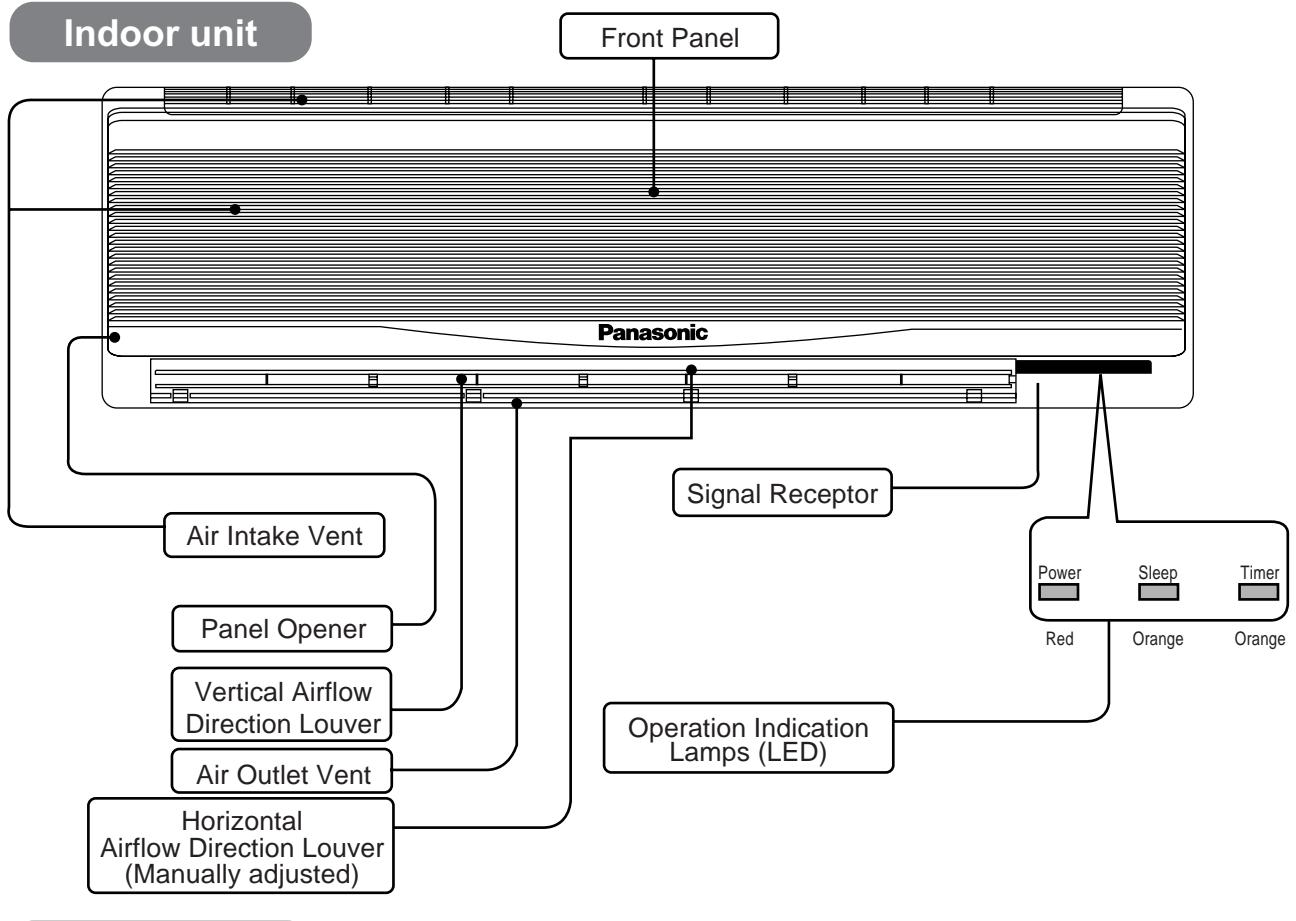


## Remote control

### Accessories




Remote Control





Two R03 dry-cell batteries or equivalent



Air Purifying Filters (with deodorizing function)

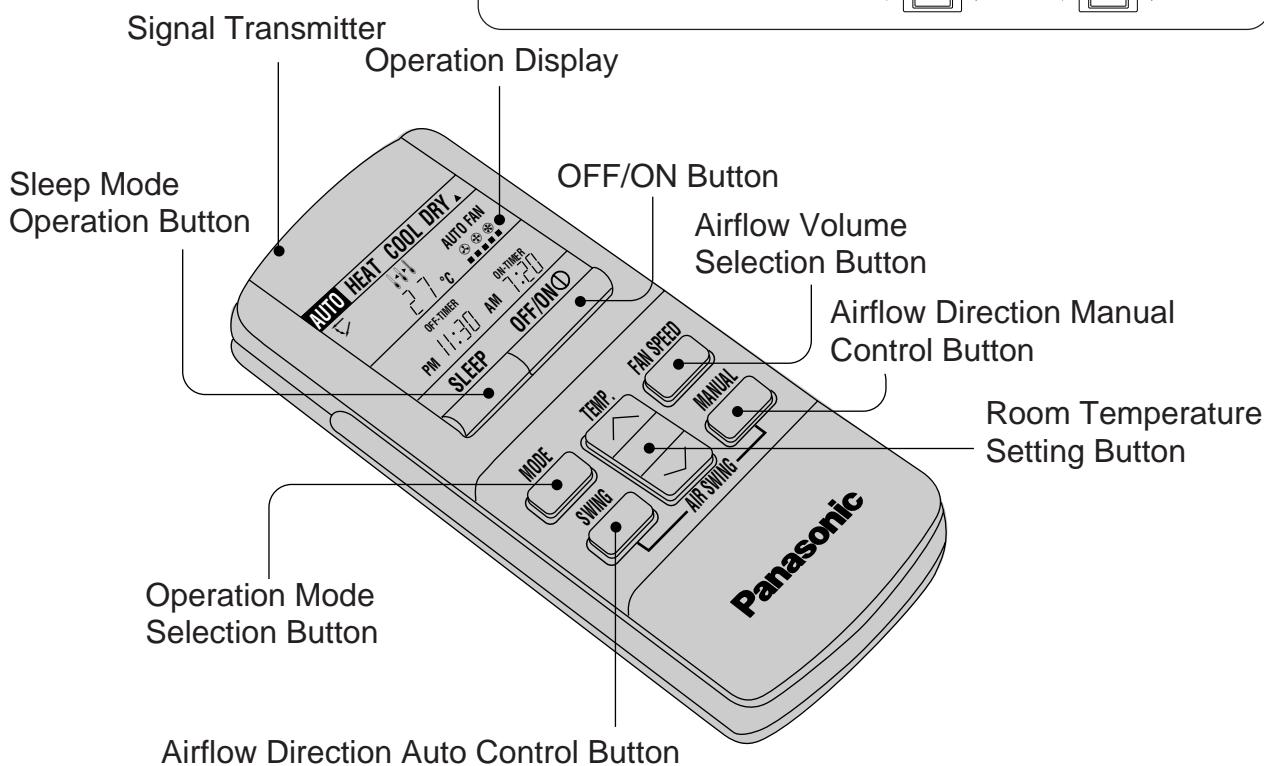


**Separate displays and functions are available when the door is opened.**

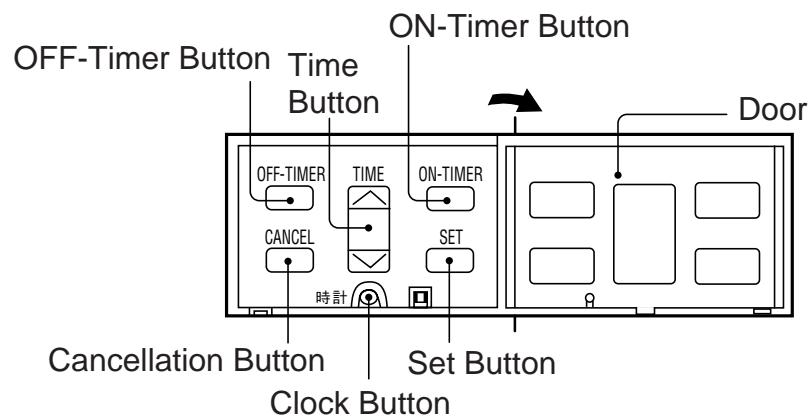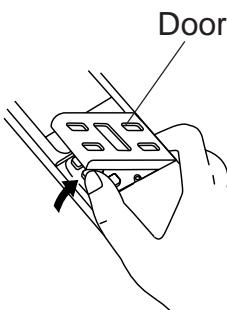

## Preparation Before Operation

### Before operating the unit


**1**

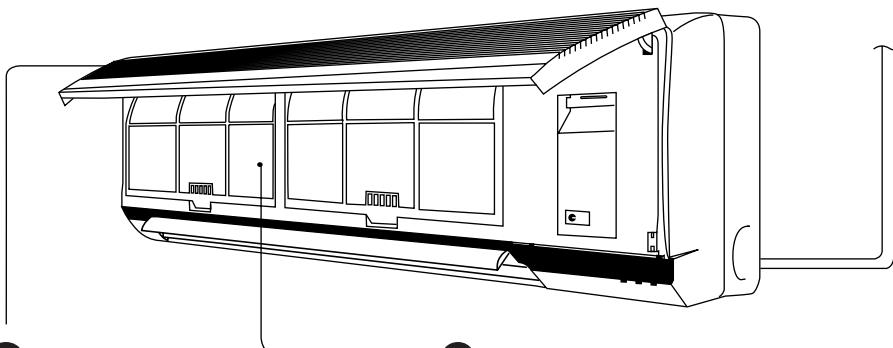

- Connect the power supply cord to an independent power supply.

**2**


■ Open the front panel.

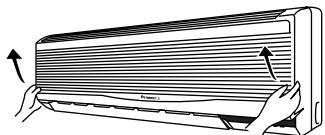

Hold the panel openers at both sides and pull up the front panel.

**3**

■ Remove air filter.

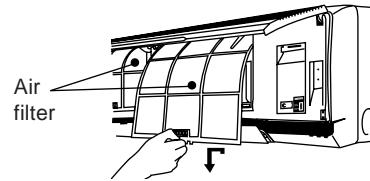

Hold the tab to raise up slightly and then pull down.

■ Insert air purifying filter.  
Insert the air filters.



Be careful not to hurt your hands by metal parts. Air purifying filter


**<Note>**

Use under the following conditions :

(Unit in °C)


DBT : Dry Bulb Temperature WBT : Wet Bulb Temperature	Cooling				Heating			
	Indoor		Outdoor		Indoor		Outdoor	
	DBT	WBT	DBT	WBT	DBT	WBT	DBT	WBT
	Maximum Temperature	32	23	43	26	30	-	24 18
Minimum Temperature	16	11	16	11	16	-	-5	-6

## How to insert batteries

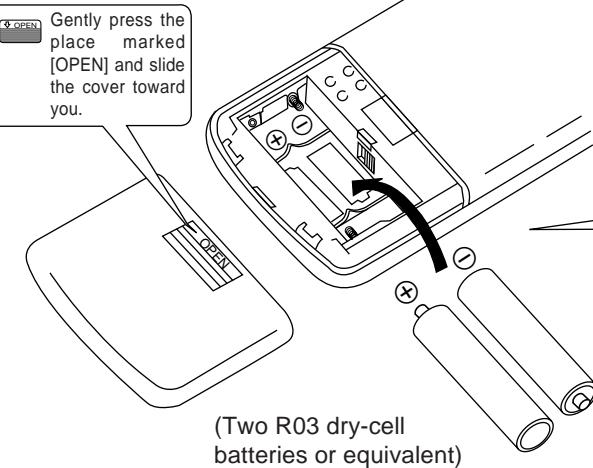


- Fix the cover to the back of the remote control ("PM 12:00" will flash in the operation display.)

⊕⊖ Be sure that the (+) and (−) directions are correct.



If the display does not appear when the batteries are inserted, remove the batteries and insert them once more.

## Operating the remote control

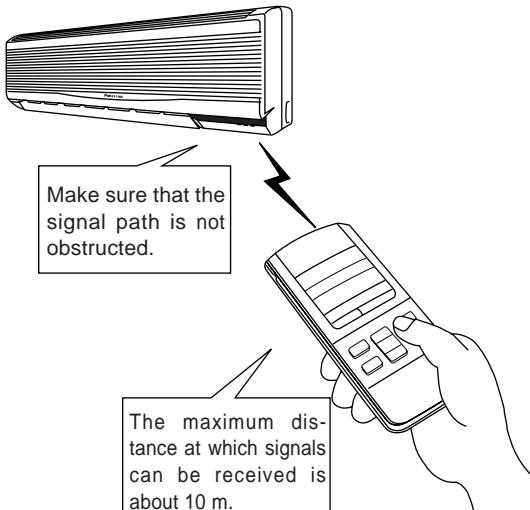

- Aim at the signal receptor on the room air conditioner when operating.
- Do not drop or throw the remote control.
- Do not place the remote control in a location that is exposed to direct sunlight or next to a heating unit or other heat source.
- Signal received sound:  
One short beep or one long beep.

### Pull out the power plug or turn off the power breaker when:

- The air conditioner is not going to be used for an extended period of time.

If the power switch is left at "I" (ON), approximately 3.25 watts of electric power are used even if the main unit is turned off by remote control.


- There is a danger of lightning.

The air conditioner is provided with a built-in protective device, but the control equipment may be adversely affected depending on the extent of lightning activity.

### Regarding the batteries.

- The batteries can be used for approximately one year.
- Do not use rechargeable (Ni-Cd) batteries, because such batteries differ from standard dry-cell batteries in shape, dimensions and performance.
- Be sure to replace the batteries with two new batteries of the same type.
- Do not dispose of empty batteries in household waste. Take them to special local collection sites.

## How to Operate




### Auto Restart Control.

- If there is a power failure, operation will be automatically restarted after 3 minutes when the power is resumed with previous operation mode and airflow direction.  
(When the operation is not stopped by remote control.)
- If you do not intend to continue the operation when the power is resumed, pull out the power plug at main unit or power supply.

When you switch on the power switch, the operation will be automatically restarted with previous operation mode and airflow direction.

- Note:**
1. If you do not require Auto Restart Control, please consult your dealer.
  2. Auto Restart Control is not available when Timer or Sleep Mode is set.

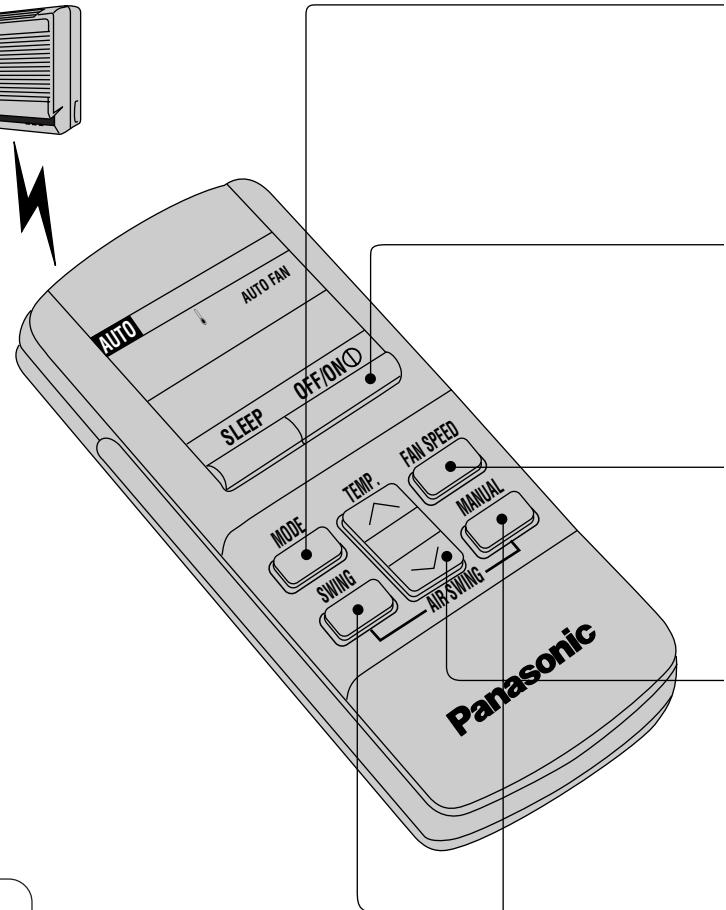

### Recommended temperature for health and comfort.

For Heating	:	20°C – 24°C
For Cooling	:	26°C – 28°C
For Soft Dry	:	1°C – 2°C lower than room temperature.


### <Operation Details>

#### AUTO – Automatic Operation.

- Once the Automatic Operation is selected, the indoor temperature sensor operates automatically to select the desired operation mode with Cooling, Soft Dry or Heating.
- The operation mode changes every hour, when necessary.

#### DRY – Soft Dry Operation.

- Soft Dry is a very gentle Cooling Operation consisting primarily of dehumidifying. It does not lower the room temperature very much.

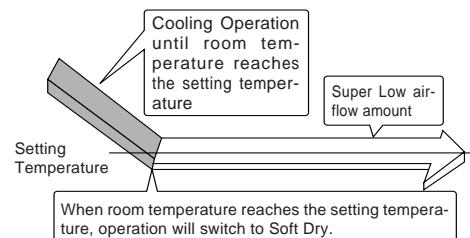

<b>1</b>		<b>Press to select operation mode.</b> ■ The display changes in the order  <b>AUTO → HEAT → COOL → DRY</b> each time the button is pressed.
<b>2</b>		<b>Press to start the operation.</b> ■ Operation indication lamp (RED) will light up. ■ Press once more, to stop the operation.
<b>3</b>		<b>Press to select airflow volume.</b> ■ The display changes in the order.  <b>AUTO FAN</b> →
<b>4</b>		<b>Press to select room temperature.</b> ■ Heating, Cooling, Soft Dry – Select temperature as desired. (16°C ~ 30°C) ■ Automatic. 2°C lower than standard       standard       2°C higher than standard
<b>5</b>		<b>Press  continuously.</b> ■ The vertical airflow direction louver will move up and down. Release the button when the louver is at the desired position. <b>Press .</b> ■ Cooling & Soft Dry – The vertical airflow direction louver will swing up and down automatically. Heating – When the discharge air temperature is low such as at the start of heating operation, the cold air blows at horizontal level. As the temperature rises, the hot air blows in a downwards direction. To stop the automatic airflow direction operation, press  button.

## HEAT – Heating Operation

### ■ Defrosting Operation

Depend on the outdoor temperature, the operation occasionally stops to melt the frost on the outdoor unit.


### ■ Heat is obtained from outdoor air to warm up the room. When the outdoor ambient air temperature falls, the heating capacity of the unit might be reduced.

We recommend that you use an additional heating device when the outdoor ambient air temperature is low.


## Automatic Airflow Volume

■ The speed of the indoor fan is adjusted automatically according to the operation. The indoor fan stops occasionally during cooling operation.

### Range of louver adjustment

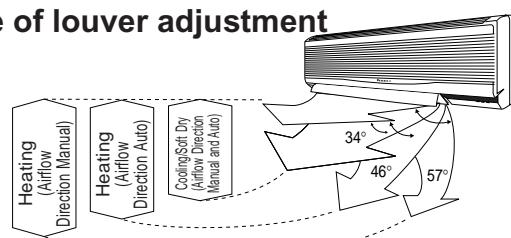


## Setting the Timer

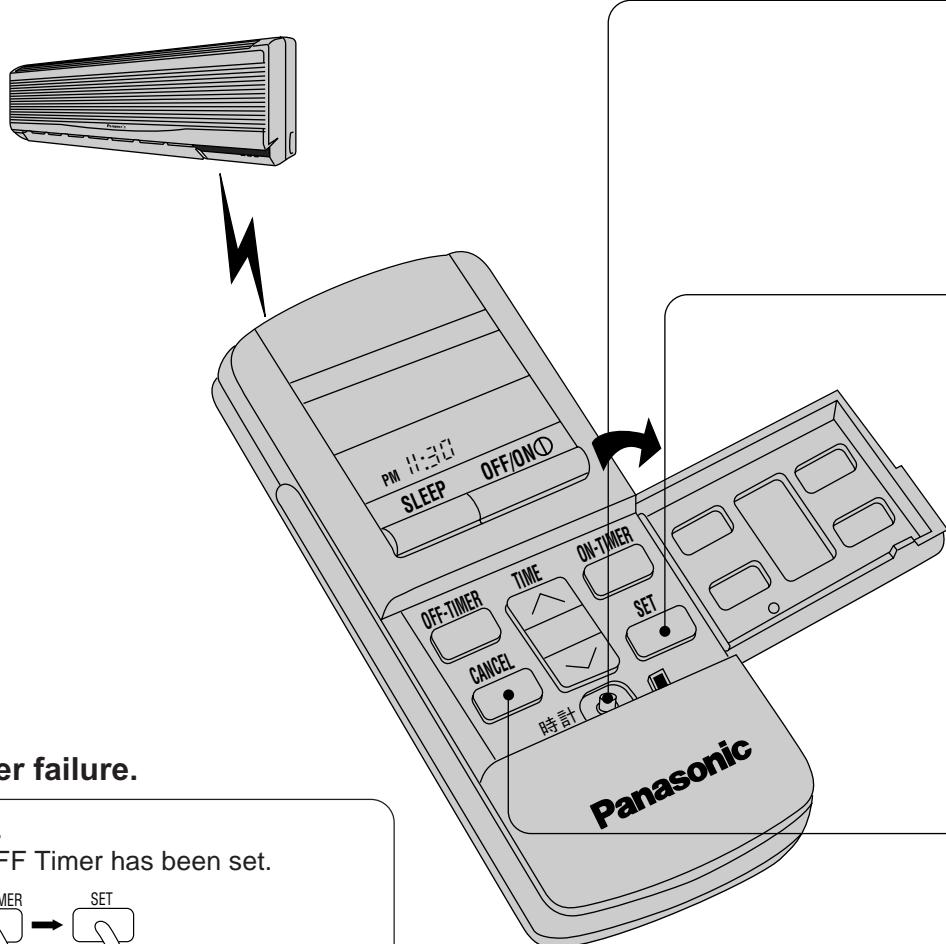

### If there is a power failure.

To reset the Timer.


(Example) If the OFF Timer has been set.




- Even if there is a power failure, the setting time is still stored in the memory because the remote control is a battery operated type.

### <Note>

#### Regarding remote control.

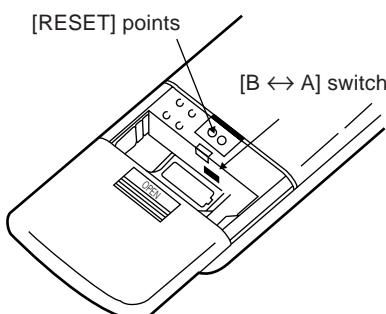

- If the current time is not set correctly, correct Timer setting will not be possible.
- When the Timer is set, the current time display will vanish.
- [RESET] points will clear the memory once they are shorted.
- [B ↔ A] switch is used when two air conditioners units have been installed in one room. Please consult your dealer.

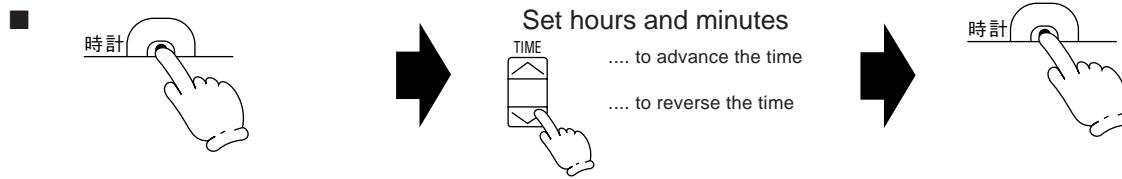
**To set the current time.****To set the Timer.**

## ■ OFF Timer



The "OFF-TIMER" will blink.

## Set hours and minutes

.... to increase 10 minutes each step.  
.... to decrease 10 minutes each step.


The Timer indication lamp at main unit will light up. LED colour: Orange.

## ■ ON Timer



The "ON-TIMER" will blink.

## Set hours and minutes

.... to increase 10 minutes each step.  
.... to decrease 10 minutes each step.

The Timer indication lamp at main unit will light up. LED colour: Orange.

**To cancel the Timer.**

## ■ OFF Timer




- The Timer indication lamp at main unit will go off.
- To cancel the ON Timer, follow the same procedure.

**To change the Timer setting time.**

## ■ (Example) To change the ON Timer setting time.



## Change hours and minutes setting

.... to increase 10 minutes each step.  
.... to decrease 10 minutes each step.**Timer**

- The ON Timer and OFF Timer can only be set once during a day.
- The operation will start before the actual setting time with ON Timer setting.

Cooling and Soft Dry : 15 minutes before  
Heating and Automatic: 30 minutes before

This is to allow time to attain your desired set temperature.

## ■ Setting the OFF Timer.

This is useful for saving electricity costs incurred by forgetting to turn off the air conditioner.


## ■ Setting the ON Timer.

If the air conditioner is set before you go out, the room temperature will be close to your desired temperature when you return.

## Convenient Operation

### Sleep Mode

This is to gain a comfortable room temperature while sleeping.

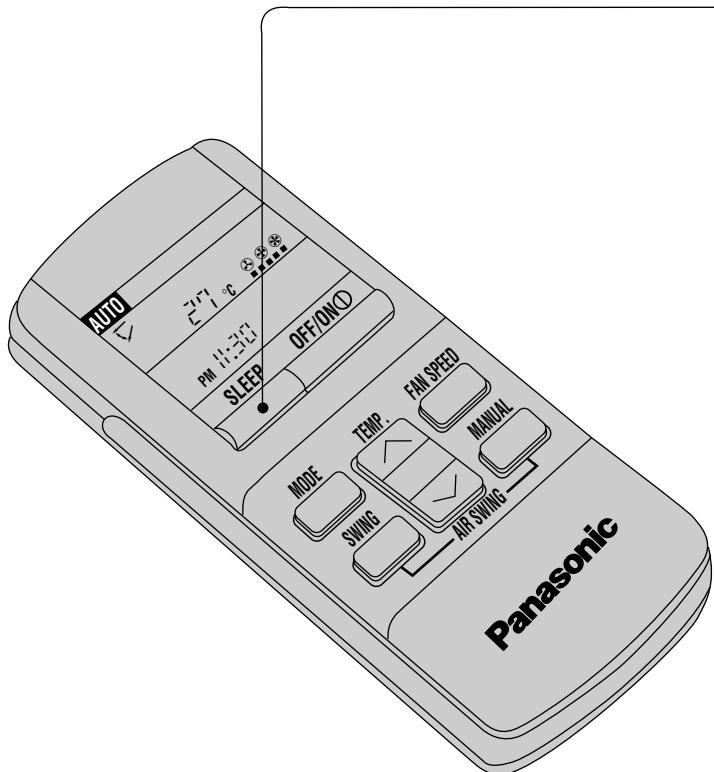

#### To set Sleep Mode.

- Press



(The sleep indication lamp on the main unit will light up.)

#### To cancel Sleep Mode.

- Press once more




(The sleep indication lamp on the main unit will switch off.)

#### Sleep Mode Operation.


- When the room temperature reaches the setting temperature or after 1 hour of operation, sleep shift operation starts and the airflow volume will automatically change to low.
- Sleep Mode Operation time is 8 hours.
- When using together with the Timer, the Timer has priority.

#### <Information>


- Cooling or Soft Dry Operation for Sleep Mode movement will start to avoid overcooling.

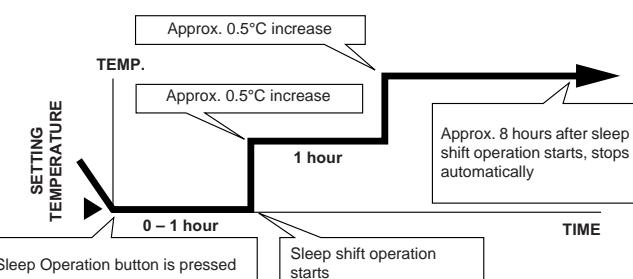

- Heating Operation for Sleep Mode movement will start to avoid overheating.

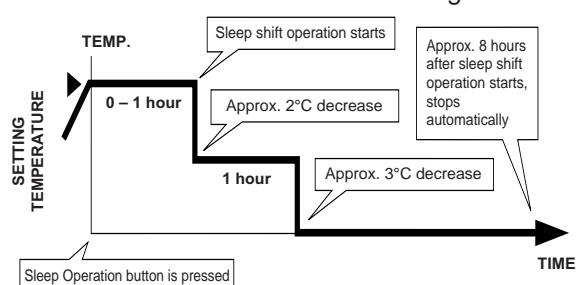

## When the remote control cannot be used

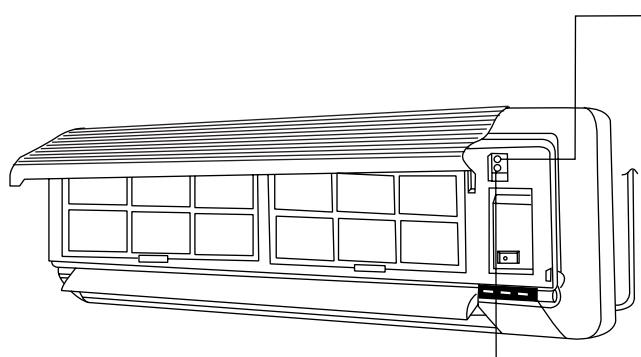

### Test Run Button.

(Use when installing and moving)

### Auto Operation Button.

- When the remote control cannot be used, press Auto Operation Button to run Automatic Operation.  
(Airflow direction setting will be automatic.)

### ■ Press Auto Operation Button.

(The operation indication lamp will blink for 20 seconds, and then light up)

- If the button is pressed once more, the air conditioner will stop.  
(The operation indication lamp will switch off.)




## OFF/ON remote control signal receiving sound


- The Remote Control Signal receiving sound can be omitted as desired.
- To switch OFF the signal receiving sound, press Auto Operation Button for 10 seconds or more. At the same time, Automatic Operation starts.  
(To switch ON, press Auto Operation Button once more for 10 seconds or more.)

## Operation Hints

- Adjust room temperature properly. Set the temperature 1°C higher (Cooling Operation) or 2°C lower (Heating Operation) than actually desired. Approximately 10% of electricity costs can be saved.

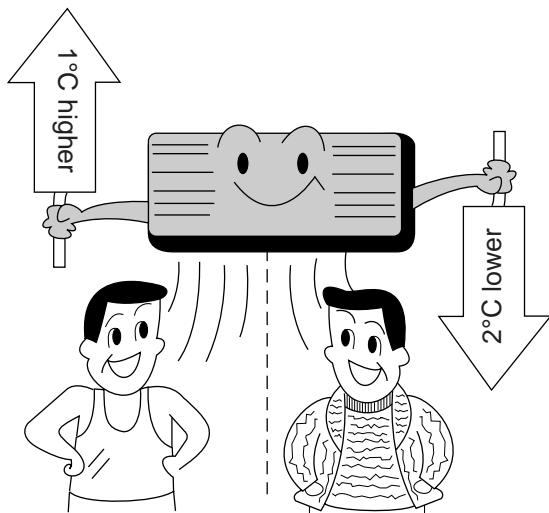


- Clean the air filter regularly. Blockage in the air filter reduces the airflow and lowers the cooling or heating. Clean at least once every 2 weeks. Otherwise, about 6% of electricity cost will be wasted.

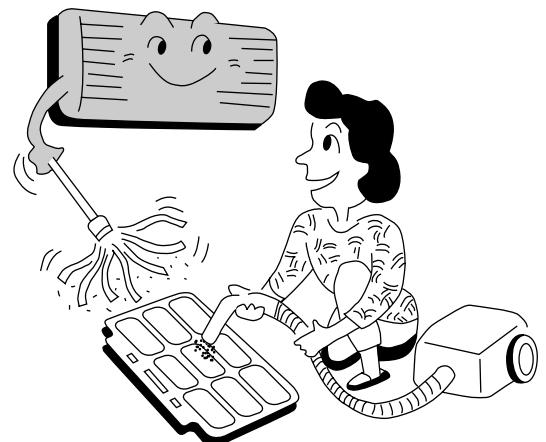


- Prevent wastage with the Timer. Use Timer when sleeping or going out to save electricity cost.




- Do not block the air outlet vents at outdoor unit. Otherwise, it will lower the cooling or heating performance.

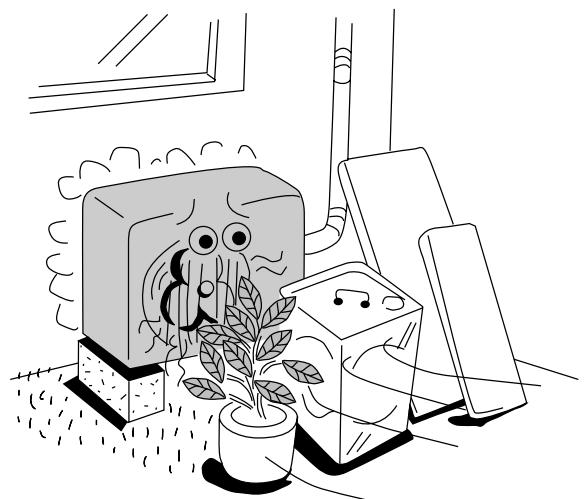


- Make sure that the doors and windows are shut. Otherwise, cooling and heating performance will be reduced and electricity cost is wasted.

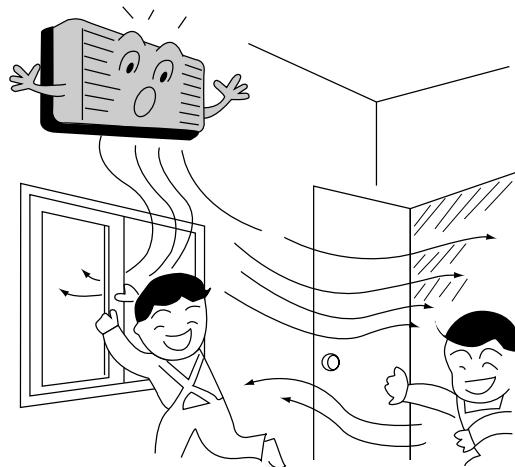


- Keep blinds or curtains closed. Do not let sunshine enter the room directly. About 5% of electricity cost can be saved.

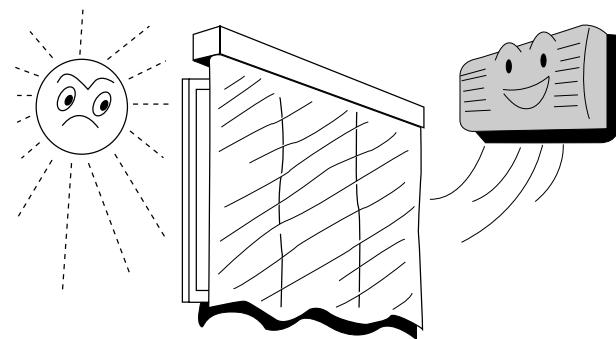

- Proper airflow direction adjustment. Set the airflow direction louvers horizontal for Cooling Operation and downwards for Heating Operation. Operation result will be better.

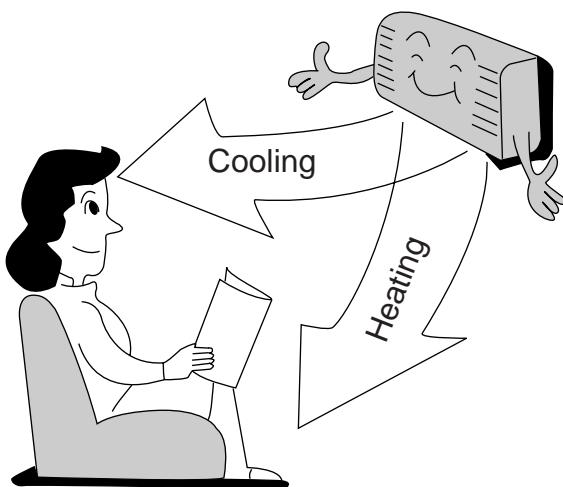

- Use insulating material for better performance. Use insulating material during construction or renovations. It will save electricity cost.

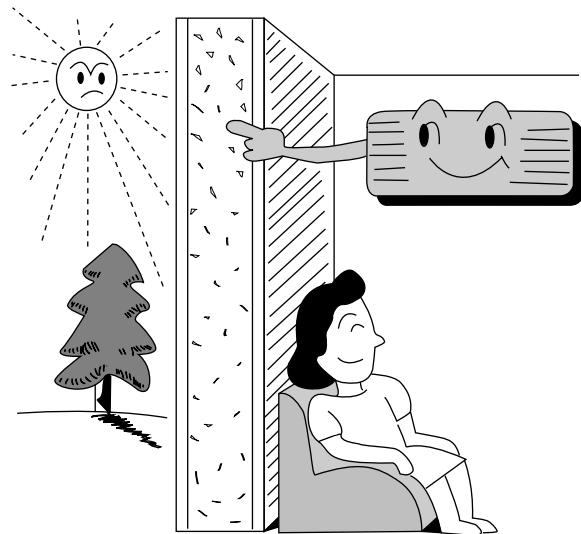

## Better Care and Maintenance

Regular care and maintenance will extend the life of the air conditioner and prevent wastage of electricity. Before performing any maintenance procedure, be sure to switch off the main power supply.

### Caution



Do not use water or volatile liquids.


- Do not make air conditioner wet, as there is the danger that it could cause electric shocks.  
Be sure not to apply water when cleaning or at any other time.
- Using water above 40°C could cause deformation and/or discolouration.
- Volatile liquids such as thinner or benzene may damage the air conditioner.

## Cleaning the air conditioner and air filters


Once every 2 weeks is recommended.

### ■ Clean the air conditioner.

Wipe gently with a soft, dry cloth.

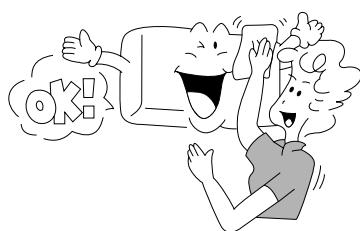

### ■ Clean the air filters.




- To remove the dust adhering to the filters, either use a vacuum cleaner, or wash them in water and dry in the shade.
- Re-insert the filters correctly at the left and right, with the side marked [FRONT] facing forward.
- Purchase replacement filters from your air conditioner dealer if the air filters become damaged.


Air Filter No. CWD4209540 (right)  
CWD4209550 (left)

## Replacement of air purifying filters


### 1 Remove the air filters.



### 2 Remove the air purifying filters.

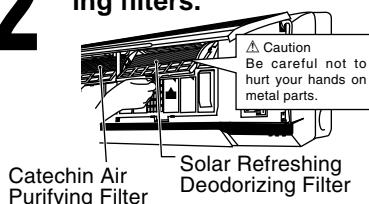

### 3 Remove the filters from the filter frame.



#### <Note>

##### ■ Solar Refreshing Deodorizing Filter

- Used to remove unpleasant odour and deodorize the air in the room.
- Reusable.
- Vacuum, place under direct sunlight for 6 hours and fit it back in place.  
(Recommended : every 6 months)

##### ■ Catechin Air Purifying Filter

- The filter is coated with catechin to prevent growth of bacteria and viruses.
- Reusable.
- Vacuum and fit it back in place  
(Recommended : every 6 months)

##### ■ Recommended to change these filters every 3 years.

Do not reuse damaged filters.

Consult the nearest authorized dealer to purchase a new filter.

Catechin Air Purifying Filter No.: CZ-SF71P

Solar Refreshing Deodorizing Filter No.: CZ-SFD71P


If you operate the air conditioner with dirty filters:-

- Air is not purified
- Cooling capacity decreases
- Foul odour is emitted

## When not using the air conditioner for a long period

### 1 Operate the air conditioner for 2 to 3 hours.

- Type of operation: Cooling.
- Temperature setting: 30°C.




In order to dry out the internal mechanisms

### 2 For air conditioners with a power plug, stop operation by remote control and pull out the power plug.

Note: If the unit is not off by remote control, the unit will operate when you plug in (because of Auto-restart Control is provided).



### 3 Remove the batteries from the remote control.




## Pre-season inspection (The earlier the better)

### ■ Is the discharge air cold (warm)?


Operation is normal if, 15 minutes after the start of operation, the temperature difference between the air intake vent and outlet vent is 8°C or above for cooling and 14°C or above for heating.



### ■ Are the air outlet vents and air intake vents obstructed?

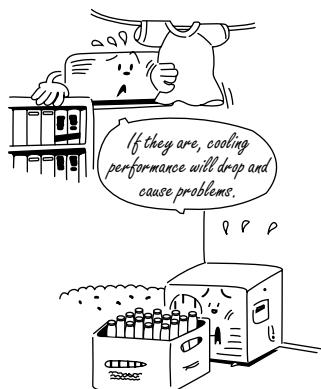

### ■ Is the drain hose cracked or crushed?

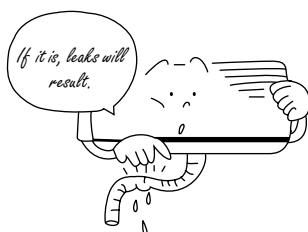

### ■ Are the remote control batteries in good condition?




## Troubleshooting

### Normal operation

#### Q Is it okay?

#### A This is the answer.

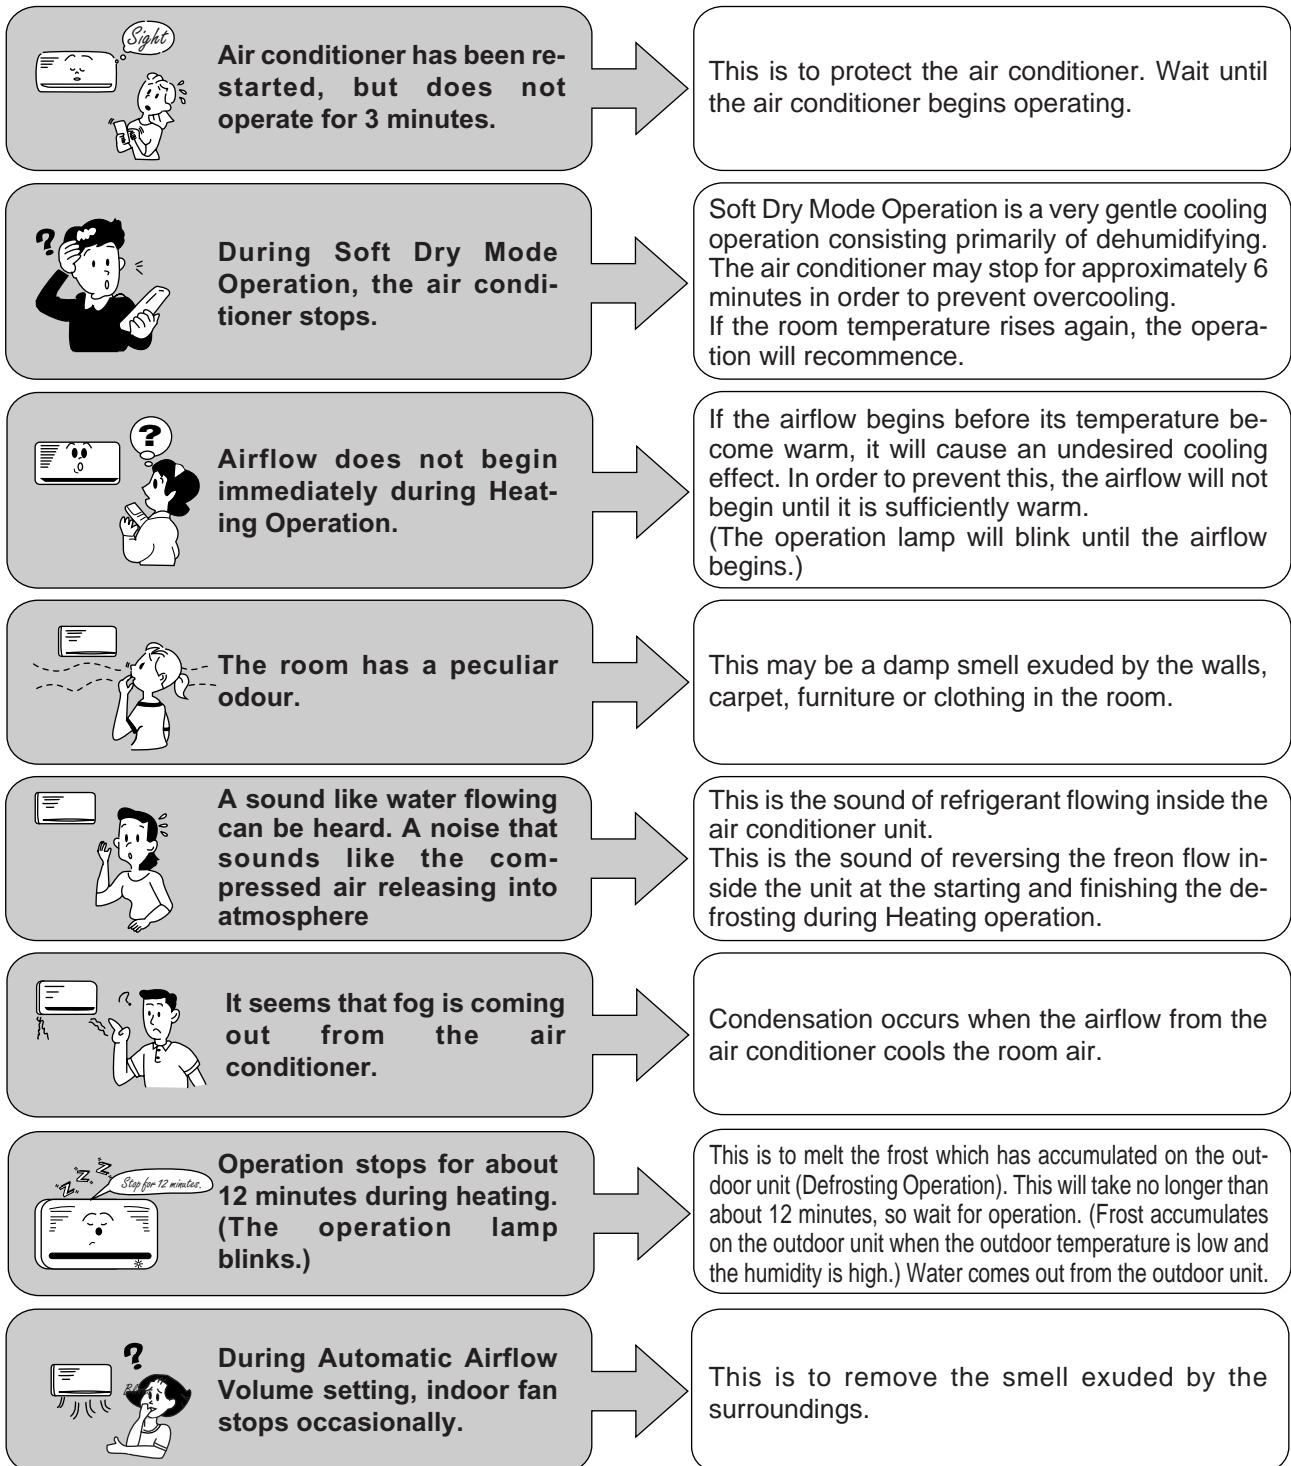

## Abnormal operation

**The air conditioner does not operate.**

- Has the circuit breaker been tripped?
- Has the power plug been removed from the wall outlet?
- Is the Timer being used correctly?
- Has the **REMOTE CONTROLLER B ↔ A** switch been set to "B"?

**The air conditioner does not cool effectively.**

- Has the temperature been set incorrectly?
- Are the filters dirty?
- Are the intake or outlet vents of the outdoor unit obstructed?
- Are all windows and doors closed?

**Air conditioner operation noise too loud.**

- Is the installation work slanted?
- Is the front grille closed properly?

## Call the dealer immediately

If the following conditions occur, immediately turn the power plug or turn off the power breaker.

■ Abnormal noise is heard during operation.

■ Switches or buttons do not operate properly.

■ Water or foreign material gets into the remote control by mistake.

■ The circuit breaker switches off frequently.

■ Water leaks from the indoor unit.

■ Power supply cord and plug become unusually warm.

## **WARNING**

- (1) REMOVE POWER PLUG OR DISCONNECT FROM THE MAINS BEFORE SERVICING THIS APPLIANCE.
- (2) THIS APPLIANCE MUST BE EARTHED.
- (3) THE APPLIANCE IS NOT INTENDED FOR USE BY YOUNG CHILDREN OR INFIRM PERSONS WITHOUT SUPERVISION
- (4) YOUNG CHILDREN SHOULD BE SUPERVISED TO ENSURE THAT THEY DO NOT PLAY WITH THE APPLIANCE.

## **IMPORTANT**

Replacement or installation of power plugs shall be performed only by authorised/qualified personnels.

### 1. WHEN THE POWER CORD IS CONNECTED TO THE MAINS THROUGH A MULTI POLAR SWITCH

THERE MUST BE A MULTI POLAR SWITCH (DISCONNECTING MEANS) WITH A MINIMUM 3 mm CONTACT GAP IN THE FIXED INSTALLATION CIRCUIT.

### 2. WHEN THE POWER PLUG IS CONNECTED TO THE RECEPTACLE

The wires in this main lead are coloured in accordance with the following code :

Green-and-yellow	: Earth
Blue	: Neutral
Brown	: Live

If the colours of the wires in the main lead of this appliance do not correspond with the coloured markings indentifying the terminals in your plug, proceed as follows :

The green-and-yellow wire must be connected to the terminal in the plug which is marked with letter E or by the earth symbol  or coloured green or green-and-yellow.

The blue wire must be connected to the terminal which is marked with the letter N or coloured black.

The brown wire must be connected to the terminal which is marked with the letter L or coloured red.

Fuse Specifications	Indoor	Outdoor
	T3.15(A), L250(V)	T3.15(A), L250(V)

## **NOTE**

IF THE SUPPLY CORD IS DAMAGED, IT MUST BE REPLACED WITH A SPECIAL CORD OR ASSEMBLY AVAILABLE FROM THE MANUFACTURER OR IT'S SERVICE AGENT.

# 10 Installation Instructions

Required tools for Installation Works			
1. Phillips screw driver	5. Spanner	9. Gas leak detector	13. Multimeter
2. Level gauge	6. Pipe cutter	10. Measuring tape	14. Torque wrench 18 N.m (1.8 kgf.m) 65 N.m (6.5 kgf.m)
3. Electric drill, hole core drill (ø70 mm)	7. Reamer	11. Thermometer	15. Vacuum pump
4. Hexagonal wrench (4 mm)	8. Knife	12. Megameter	16. Gauge manifold

## 10.1. Safety Precautions

- Read this following "SAFETY PRECAUTIONS" carefully before installation.
- Electrical work must be installed by all licensed electrician. Be sure to use the correct rating of the power plug and main circuit for the model to be installed.
- The caution items stated here must be followed because these important contents are related to safety. The meaning of each indication used is as below.

Incorrect installation due to ignoring of the instruction will cause harm or damage, and the seriousness is classified by the following indication.

 <b>WARNING</b>	This indication shows the possibility of causing death or serious injury.
 <b>CAUTION</b>	This indication shows the possibility of causing injury or damage to properties only.

The items to be followed are classified by the symbols:

	Symbol with white background denotes item that is PROHIBITED from doing.
---	--

- Carry out test running to confirm that no abnormality occurs after the installation. Then, explain to user the operation, care and maintenance as stated in instruction. Please remind the customer to keep the operating instructions for future reference.

 <b>WARNING</b>	
1. Engage dealer or specialist for installation. If installation done by the user is defective, it will cause water leakage, electrical shock or fire.	
2. Install according to this installation instruction strictly. If installation is defective, it will cause water leakage, electrical shock or fire.	
3. Use the attached accessories parts and specified parts for installation. Otherwise, it will cause the set to fall, water leakage, fire or electrical shock.	
4. Install at a strong and firm location which is able to withstand the set's weight. If the strength is not enough or installation is not properly done, the set will drop and cause injury.	
5. For electrical work, follow the local national wiring standard, regulation and this installation instruction. An independent circuit and single outlet must be used. If electrical circuit capacity is not enough or defect found in electrical work, it will cause electrical shock or fire.	
6. Use the specified cable (2.5 mm <sup>2</sup> ) and connect tightly for indoor/outdoor connection. Connect tightly and clamp the cable so that no external force will be acted on the terminal. If connection or fixing is not perfect, it will cause heat-up or fire at the connection.	
7. Wire routing must be properly arranged so that control board cover is fixed properly. If control board cover is not fixed perfectly, it will cause heat-up at connection point of terminal, fire or electrical shock.	
8. When carrying out piping connection, take care not to let air or other substances other than the specified refrigerant go into refrigeration cycle. Otherwise, it will cause lower capacity, abnormal high pressure in the refrigerant cycle, explosion and injury.	
9. Do not damage or use unspecified power supply cord. Otherwise, it will cause fire or electrical shock.	
10. Do not modify the length of the power supply cord or use of the extension cord, and do not share the single outlet with other electrical appliances. Otherwise, it will cause fire or electrical shock.	



## CAUTION

1. Grounding is necessary. It may cause electrical shock if grounding is not perfect.
2. Do not install the unit at place where leakage of flammable gas may occur. In case gas leaks and accumulates at surrounding of the unit, it may cause fire. 
3. Carry out drainage piping as mentioned in installation instructions. If drainage is not perfect, water may enter the room and damage the furniture.

## ATTENTION

1. Selection of the installation location.  
Select a installation location which is rigid and strong enough to support or hold the unit, and select a location for easy maintenance.
2. Power supply connection to the room air conditioner.  
Connect the power supply cord of the room air conditioner to the mains using one of the following method.  
Power supply point shall be the place where there is ease for access for the power disconnection in case of emergency. In some countries, permanent connection of this room air conditioner to the power supply is prohibited.
  1. Power supply connection to the receptacle using a power plug. Use an approved 20A power plug with earth pin for the connection to the receptacle.
  2. Power supply connection to a circuit breaker for the permanent connection. Use an approved circuit breaker as shown in the table below for the permanent connection. It must be a double pole switch with a minimum 3 mm contact gap.

	CS/CU-W28BKP5	CS/CU-A28BKP5
Circuit Breaker	30 A	20 A
3. Do not release refrigerant.  
Do not release refrigerant during piping work for installation, re-installation and during repairing a refrigeration parts. Take care of the liquid refrigerant, it may cause frostbite.
4. Installation work.  
It may need two people to carry out the installation work.
5. Do not install this appliance in a laundry room or other location where water may drip from the ceiling, etc.

## Attached accessories

No.	Accessories part	Qty.	No.	Accessories part	Qty.
1	Installation plate	1	7	Remote control	1
2	Installation plate fixing screw	6	8	Battery	2
3	Vinyl tape	3	9	Air purifying filter	2
4	Screw for water proof cover	1	10	Drain elbow	1
5	Water proof cover	1	11	Remote control holder	1
6	Band	2	12	Remote control holder fixing screw	2


## Piping length and the elevation

Model	Pipe size		Max. Piping Length A (m)	Max. Elevation B (m)	Rated		Additional Refrigerant (g/m)
	Gas	Liquid			Length	Elevation	
W28BKP5	5/8"	1/4"	30	25	7.5	5	40
A28BKP5	5/8"	1/4"	30	25	7.5	5	40

Example:

If the unit will be installed at a 12 m distance, the quantity of additional refrigerant should be 80 g... $(12-10 \text{ m}) \times 40 \text{ g/m} = 80\text{g}$

## Indoor/Outdoor unit installation diagram

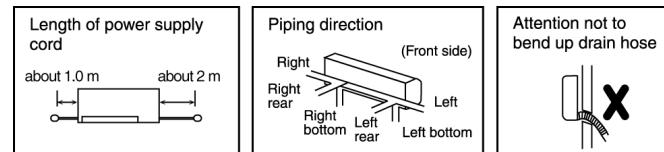

Applicable: Flaring piping kit CZ-52F


### SELECT THE BEST LOCATION

#### INDOOR UNIT

- There should not be any heat source or steam near the unit.
- There should not be any obstacles blocking the air circulation.
- A place where air circulation in the room is good.
- A place where air drainage can be easily done.
- A place where noise prevention is taken into consideration.
- Do not install the unit near the door way.
- Ensure the spaces indicated by arrows from the wall, ceiling, or other obstacles.
- Indoor unit of this room air conditioner shall be installed on the wall in a height of at least 2.5 m.

#### OUTDOOR UNIT

- If an awning is built over the unit to prevent direct sunlight or rain, be careful that heat radiation from the condenser is not obstructed.
- There should not be any animal or plant which could be affected by hot discharged air.
- Keep the spaces indicated by arrows from wall, ceiling, fence or other obstacles.
- Do not place any obstacles which may cause a short circuit of the discharged air.
- If piping length is over 10 m, additional refrigerant should be added as shown in the table.

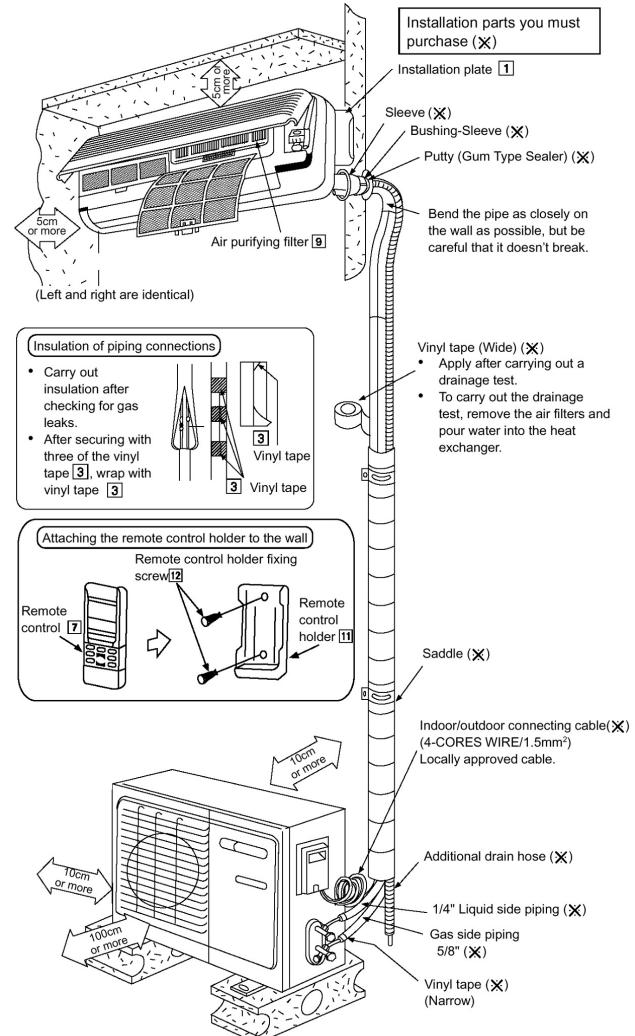


- This illustration is for explanation purposes only.  
The indoor unit will actually face a different way.

## 10.2. INDOOR UNIT

### 10.2.1. SELECT THE BEST LOCATION (Refer to "Select the best location" section)

### 10.2.2. HOW TO FIX INSTALLATION PLATE

The mounting wall is strong and solid enough to prevent it from the vibration.

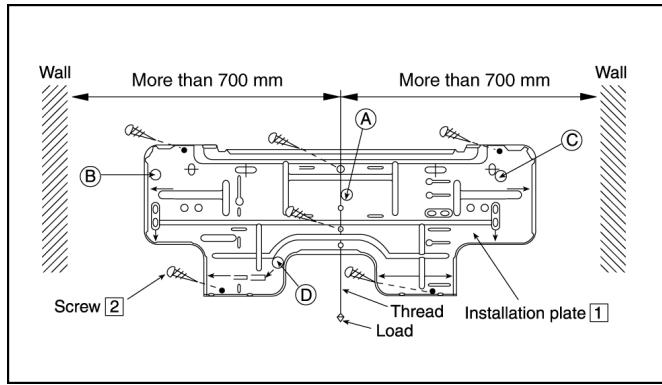

- Ⓐ : Unit centre should be at more than 700 mm at right and left of the wall.  
The height should be more than 250 mm from the ceiling.
- Ⓑ : From installation plate end to unit left side end is 55 mm.
- Ⓒ : From installation plate end to unit right side end is 55 mm.
- Ⓓ : Indoor outdoor connecting cable should be about 1100 mm from this line. (Only for left rear piping)


### 10.2.3. TO DRILL A HOLE IN THE WALL AND INSTALL A SLEEVE OF PIPING

1. Insert the piping sleeve to the hole.
2. Fix the bushing to the sleeve.
3. Cut the sleeve until it extrudes about 15 mm from the wall.

#### Caution

When the wall is hollow, please be sure to use the sleeve for tube ass'y to prevent dangers caused by mice biting the indoor/outdoor connecting cable.

4. Finish by sealing the sleeve with putty or caulking compound at the final stage.

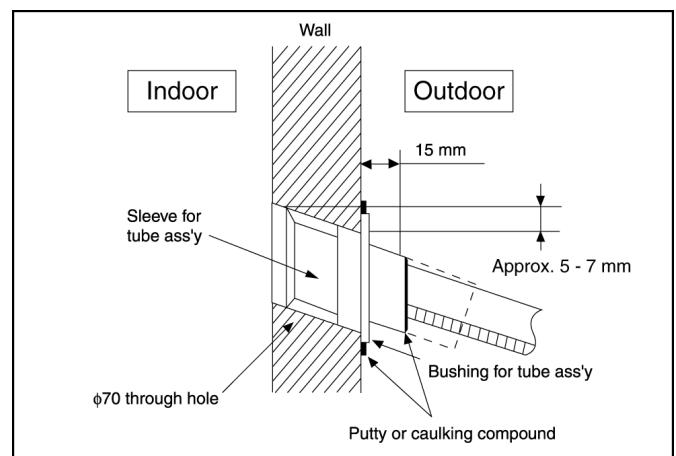

1. Mount the installation plate on the wall with 6 screws.  
(If mounting the unit on the concrete wall, consider using anchor bolts.)

- Always mount the installation plate horizontally by aligning the marking-off line with the thread and using a level gauge.

2. Drill the piping plate hole with ø70 mm hole-core drill.

- Line according to the arrows marked on the lower left and right side of the installation plate. The meeting point of the extended line is the centre of the hole.
- Drill the piping hole at either the right or the left and the hole should be slightly slant to the outdoor side.

### 10.2.4. INDOOR UNIT INSTALLATION

#### 1. For the right rear piping

- ```

    Pull out the Indoor piping
    ↓
    Install the Indoor Unit
    ↓
    Secure the Indoor Unit
    ↓
    Insert the indoor/outdoor connecting
    cable
  
```

#### 2. For the right and right bottom piping

- ```

    Pull out the Indoor piping
    ↓
    Install the Indoor Unit
    ↓
    Insert the indoor/outdoor connecting
    cable
    ↓
    Secure the Indoor Unit
  
```

#### 3. For the embedded piping

**Exchange the drain hose and the cap**



**Bend the embedded piping**



- Use a spring bender or equivalent to bend the piping so that the piping is not crushed.

**Install the Indoor Unit**



**Cut and flare teh embedded piping**



- When determing the dimension of the piping, slide the unit all the way to the left on the installation plate.
- Refer to the section "Cutting and flaring the piping".

**Pull the indoor/outdoor connecting cable into Indoor Unit**



- The inside and outside indoor/outdoor connecting cable can be connected without removing the front grille.

**Connect the piping**



- Please refer to "Connecting the piping" column in outdoor unit section. (Below steps are done after connecting the outdoor piping and gas-leakage confirmation.)


**Insulate and finish the piping**




- Please refer to "Piping and finishing" column of outdoor section and "Insulation of piping connections" column as mentioned in Indoor/Outdoor Unit Installation diagram.

**Secure the Indoor Unit**

**Pull out the piping and drain hose**

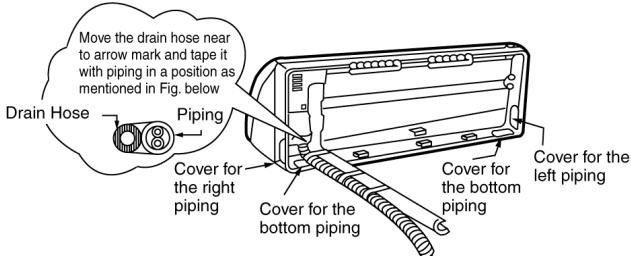


**Install the indoor unit**

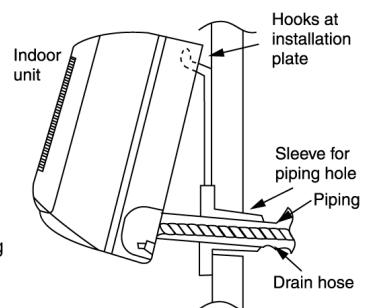

**Secure the indoor unit**


1. Tape the extra power supply cord in a bundle and keep it behind the chassis.
2. Press the lower left and right side of the unit against the installation plate until hooks engages with their slots (sound click).

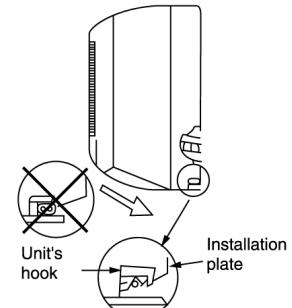

**How to keep the cover**



In case of the cover is cut, keep the cover at the rear of chassis as shown in the illustration for future reinstallation.

(Left, right and bottom covers for piping)





**Exchange the drain hose and the cap**

Refer view for left piping installation

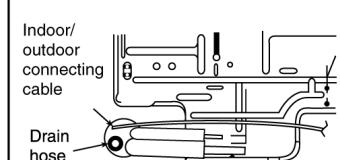


Adjust the piping slightly downwards

**Insert the indoor/outdoor connecting cable**

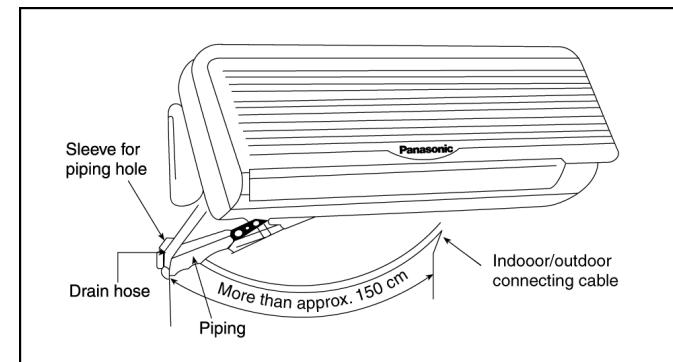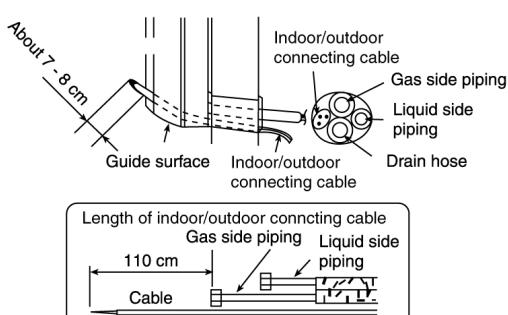


- In case of left piping how to insert the indoor/outdoor connecting cable and drain hose.

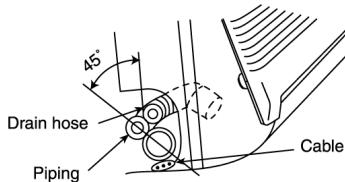

(For the right piping, follow the same procedure)


- In case of the embedded piping, how to pull the piping and drain hose out.

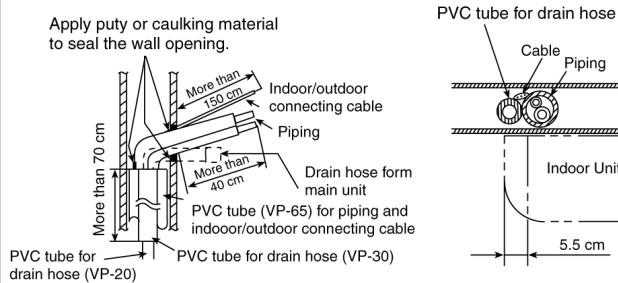


Be sure to insulate the PVC tube for drain hose

#### ATTACHMENT OF THE PIPING BAND

- Tighten the band so that the cable and the piping are secure. Be sure to cut any excess from the piping band (failure to cut away the excess piping band may produce abnormal noise during operation or condensation).

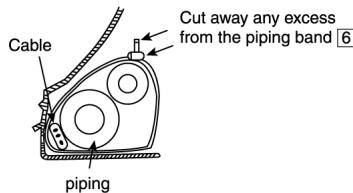

- The method of install water proof cover

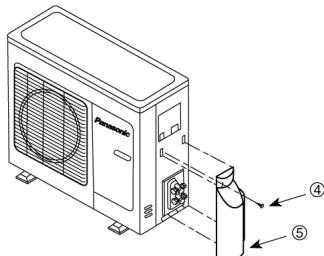


- At first please fix the water proof cover on the cabinet then tighten the screw.

#### 10.2.5. CONNECT THE CABLE TO THE INDOOR UNIT

- The inside and outside indoor/outdoor connecting cable can be connected without removing the front grille.
- Indoor/outdoor connecting cable between indoor unit and outdoor unit shall be approved polychloroprene sheathed 5 x 2.5 mm<sup>2</sup> flexible cord 245 IEC 57 ,type designation H05 RN-F or heavier cord.
  - Ensure the color of wires of outdoor unit and the terminal Nos. are the same to the indoor's respectively.
  - Earth lead wire shall be longer than the other lead wires as shown in the figure for the electrical safety in case of the slipping out of the cord from the anchorage.


Terminals on the indoor unit	1	2	3	4	
Color of wires					
Terminals on the outdoor unit	1	2	3	4	

- Secure the cable onto the control board with the holder (clamper).

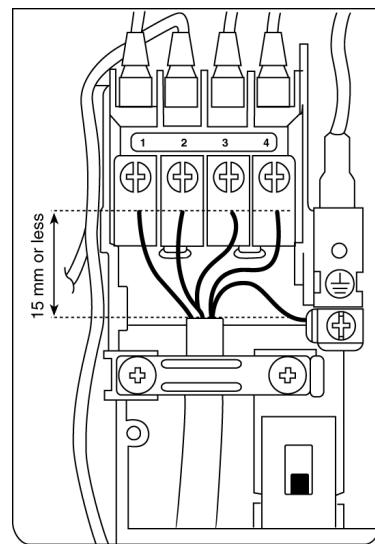

#### INSTALLATION OF AIR PURIFYING FILTERS

- Open the front panel.
- Remove the air filters.
- Hold the catechin filters by their tabs and install as shown in the illustration at below.

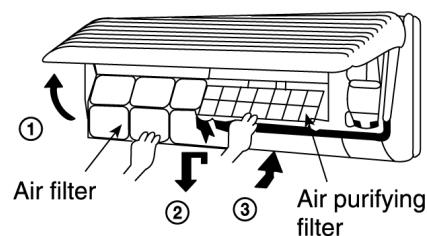

## HOW TO TAKE OUT FRONT GRILLE


Please follow below steps to take out front grille if necessary such as when servicing.

Remove the Grille from the chassis.


- Set the up-and-down air direction louver to open position (horizontally) by finger pressure.



- Open the three screw covers as shown in the illustration below.




- Remove the five mounting screws.
- Open the front panel and remove a mounting screw at the centre.  
(Refer Diagram below)
- To remove the Grille, pull the lower left and right side of the grille towards you (slightly tilted) and lift it straight upwards (Two tabs on the top inside edge of the grille are clear of their slots).

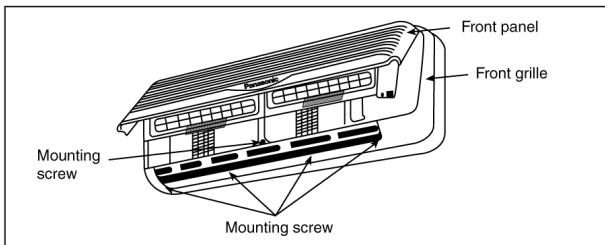

When reinstalling the front grille, first set the vertical airflow direction louver to the horizontal position and then carry out above steps 2 - 5 in the reverse order.

## REMOTE CONTROL NO. SWITCH

- When installing two air conditioners in one room, each air conditioner can be synchronized to the remote controller.
- In order to operate separately, open the rear cover of one of the remote controller and set the switch to "B".
- Also, set the remote control No. switch to "B" in the corresponding indoor unit.  
(The switch is located in the control box-sub. of the indoor unit.)

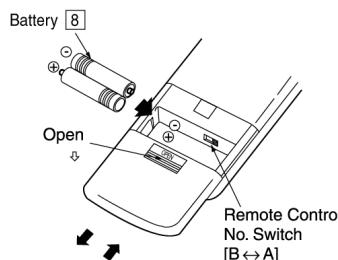


## 10.3. OUTDOOR UNIT

### 10.3.1. SELECT THE BEST LOCATION (Refer to "Select the best location" section)

### 10.3.2. INSTALL THE OUTDOOR UNIT

- After selecting the best location, start installation according to Indoor/Outdoor Unit Installation Diagram.
- Fix the unit on concrete or rigid frame firmly and horizontally by bolt nut. ( $\varnothing 10$  mm).
- When installing at roof, please consider strong wind and earthquake. Please fasten the installation stand firmly with bolt or nails.

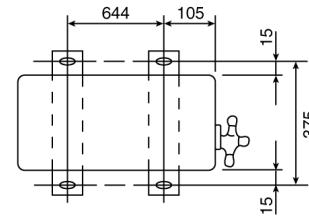

### 10.3.3. CONNECTING THE PIPING


#### Connect Piping to Indoor

Please make flare after inserting flare nut (locate at joint portion of tube assembly) onto the copper pipe.

(In case of using long piping)

Connect the piping


- Align the center of piping and sufficiently tighten the flare nut with fingers.
- Further tighten the flare nut with torque wrench in specified torque as stated in the table.



Pipe size	Torque
Liquid Side 1/4"	18 N.m
Gas Side 5/8"	65 N.m


#### Connect the Piping to Outdoor Unit

- Align the center of the piping and sufficiently tighten the flare nut with fingers.
- Finally, tighten the flare nut with torque wrench until the wrench clicks.
  - When tightening the flare nut with torque wrench, ensure the direction for tightening follows the arrow on the wrench.

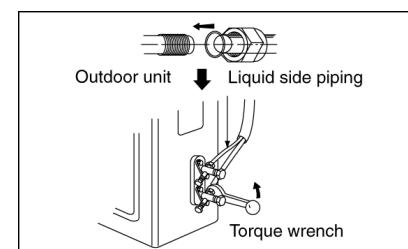


## CUTTING AND FLARING THE PIPING

1. Please cut using pipe cutter and then remove the burrs.
2. Remove the burrs by using reamer. If burrs is not removed, gas leakage may be caused.
- Turn the piping end down to avoid the metal powder entering the pipe.
3. Please make flare after inserting the flare nut onto the copper pipes.

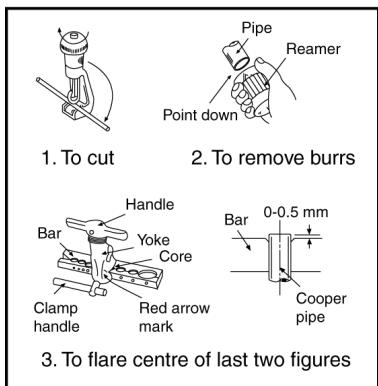

■ Improper flaring ■




When properly flared, the internal surface of the flare will evenly shine and be of even thickness. Since the flare part comes into contact with the connectors, carefully check the flare finish.

## 10.3.4. EVACUATION OF THE EQUIPMENT

WHEN INSTALLING AN AIR CONDITIONER, BE SURE TO EVACUATE THE AIR INSIDE THE INDOOR UNIT AND PIPES in the following procedure.

If air remains in the indoor unit and refrigeration pipes, it will affect the compressor, reduce to cooling capacity, and could lead to a malfunction.

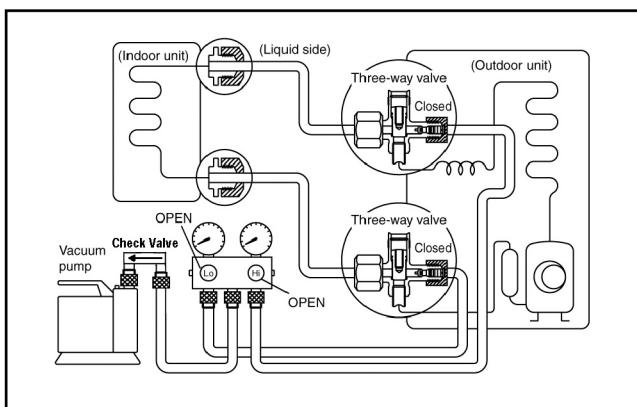

### SERVICE PORT CAP

Be sure, using a torque wrench to tighten the service port cap (after using the service port), so that it prevents the gas leakage from the refrigeration cycle.

### Procedure:

1. Connect a charging hose with a push pin to the Low and High sides of a charging set and the service port of the 3-way valve.
- Be sure to connect the end of the charging hose with the push pin to the service port.

2. Connect the center hose of the charging set to a vacuum pump.

3. Turn on the power switch of the vacuum pump and make sure that the needle in the gauge moves from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa). Then evacuate the air approximately ten minutes.

4. Close the valve of both the Low and High sides of the charging set and turn off the vacuum pump. Make sure that the needle in the gauge does not move after approximately five minutes.

Note: BE SURE TO TAKE THIS PROCEDURE IN ORDER TO AVOID REFRIGERANT GAS LEAKAGE.

5. Disconnect the charging hose from the vacuum pump and from the service port of the 3-way valve.
6. Tighten the service port caps of the 3-way valve at torque of 18 N.m with a torque wrench.
7. Remove the valve caps of both the 3-way valve. Position both of the valves to "OPEN" using a hexagonal wrench (4 mm).
8. Mount valve caps both of the 3-way valves.

- Be sure to check for gas leakage.

### CAUTION

- If gauge needle does not move from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa), in step 3 above take the following measure:
  - If the leak stops when the piping connections are tightened further, continue working from step 3.
  - If the leak does not stop when the connections are retightened, repair the location of leak.

## 10.3.5. CONNECT THE CABLE TO THE OUTDOOR UNIT

(FOR DETAIL REFER TIO WIRING DIAGRAM AT UNIT)

1. Remove the control board cover from the unit by loosening the screw.
2. Indoor/outdoor connecting cable between indoor unit and outdoor unit shall be approved polychloroprene sheathed 5 x 2.5 mm<sup>2</sup> flexible cord 245 IEC 57 ,type designation HO5 RN-F or heavier cord.

Terminals on the indoor unit	1	2	3	4	
Color of wires					
Terminals on the outdoor unit	1	2	3	4	


3. Secure the cable onto the control board with the holder (clamper).
4. Attach the control board cover to the original position with the screw.

### 10.3.6. PIPE INSULATION

1. Please carry out insulation at pipe connection portion as mentioned in Indoor/Outdoor Unit Installation Diagram. Please wrap the insulated piping end to prevent water from going inside the piping.
2. If drain hose or connecting piping is in the room (where dew may form), please increase the insulation by using POLY-E FOAM with thickness 6 mm or above.


#### CHECK THE DRAINAGE

1. Pour a glass of water into the drain tray-styrofoam.
2. Ensure if water flows out from drain hose of indoor unit.

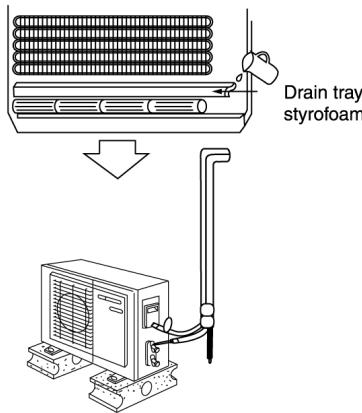


#### DISPOSAL OF OUTDOOR UNIT DRAIN WATER

- If a drain elbow is used, the unit should be placed on a stand which is taller than 3 cm.
- If the unit is used in an area where temperature falls below 0°C for 2 or 3 days in succession, it is recommended not to use a drain elbow, for the drain water freezes and the fan will not rotate.

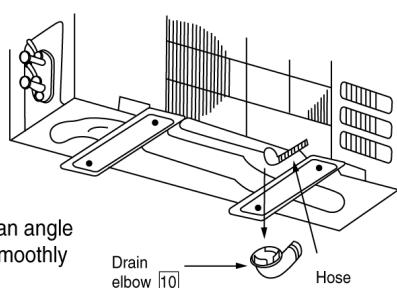

#### EVALUATION OF THE PERFORMANCE

1. Operate the unit at cooling operation mode for fifteen minutes or more.
2. Measure the temperature of the intake and discharge air.
3. Ensure the difference between the intake temperature and the discharge is more than 8°C.

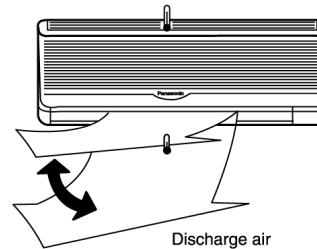

#### CHECK ITEMS

- Is there any gas leakage at flare nut connections?
- Has the heat insulation been carried out at flare nut connection?
- Is the indoor/outdoor connecting cable being fixed to terminal board firmly?
- Is the indoor/outdoor connecting cable being clamped firmly?
- Is the drainage OK?  
(Refer to "Check the drainage" section)
- Is the earth wire connection properly done?
- Is the indoor unit properly hooked to the installation plate?
- Is the power supply voltage complied with rated value?
- Is there any abnormal sound?
- Is the cooling operation normal?
- Is the thermostat operation normal?
- Is the remote control's LCD operation normal?
- Is the air purifying filter installed?

# 11 3-way Valve


	3-way Valve (Liquid Side)		3-way Valve (Gas Side)	
Works	Shaft Position	Service Port	Shaft Position	Service Port
Shipping	Close (With valve cap)	Closed (With cap)	Closed (With valve cap)	Closed (With cap)
Evacuation (Installation and Re-installation)	Closed (Clockwise)	Open (Connected manifold gauge w/charging cylinder)	Closed (Clockwise)	Open (Push-pin)
Operation	Open (With valve cap)	Closed (With cap)	Open (With valve cap)	Closed (With cap)
Pumping down (Transferring)	Closed (Clockwise)	Closed (With cap)	Open (Counter-Clockwise)	Open (Connected manifold gauge)
Evacuation (Servicing)	Open (Counter-Clockwise)	Open (Connected manifold gauge)	Open (Counter-Clockwise)	Open (Connected manifold gauge)
Gas charging (Servicing)	Open (Counter-Clockwise)	Open (Connected manifold gauge)	Open (Counter-Clockwise)	Open (Connected manifold gauge)
Pressure check (Servicing)	Open (Counter-Clockwise)	Open (Connected manifold gauge)	Open (Counter-Clockwise)	Open (Connected manifold gauge)
Gas releasing (Servicing)	Open (Counter-Clockwise)	Open (Connected manifold gauge)	Open (Counter-Clockwise)	Open (Connected manifold gauge)

## 11.1. Evacuation of Installation

When installing an air conditioner, be sure to evacuate the air inside the indoor unit and pipes in the following procedure.

Required tools: hexagonal wrench, adjustable wrench, torque wrenches, wrench to hold the joints, gas leak detector, and charging set.

The air in the indoor unit and in the piping must be purged. If air remains in the refrigeration pipings, it will affect the compressor, reduce the cooling capacity, and could lead to a malfunction.

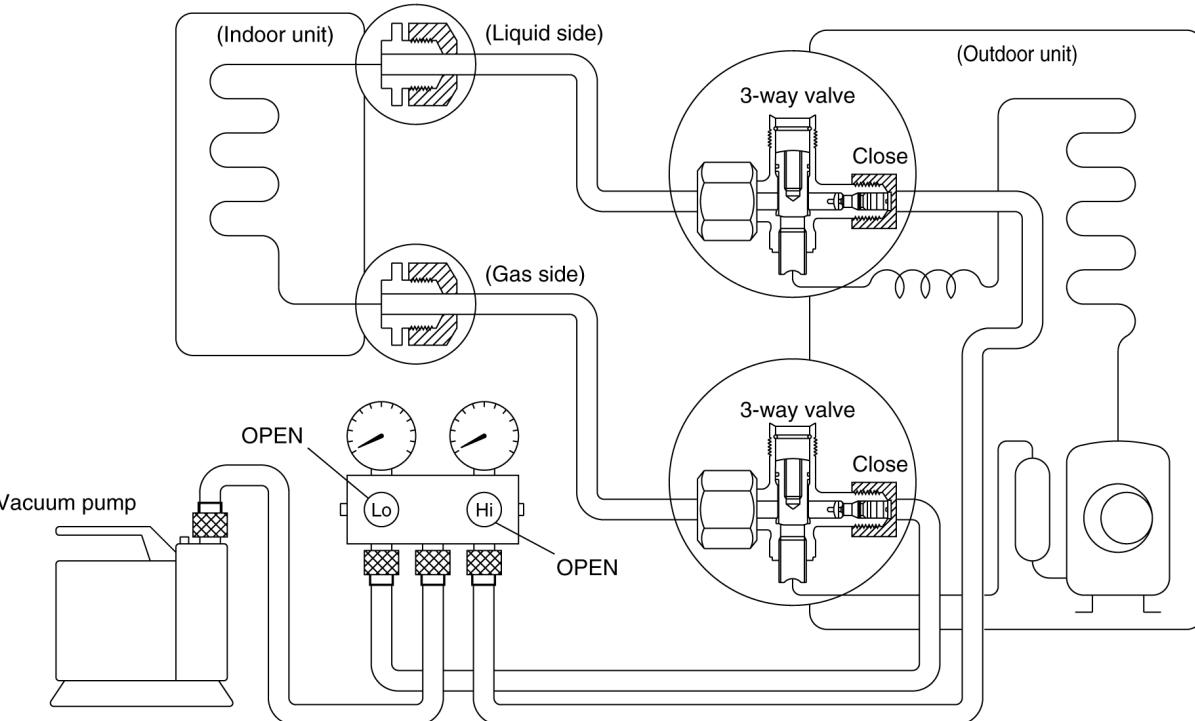

### Service port cap

Be sure, using a torque wrench to tighten the service port cap (after using the service port), so that it prevents the gas leakage from the refrigeration cycle

### Procedure:

1. Connect a charging hose with a push pin to the Low and High sides of a charging set and the service ports of a 3-way valve.
  - Be sure to connect the end of the charging hose with the push pin to the service port.
2. Connect the centre hose of the charging set to a vacuum pump.
3. Turn on the power switch of the vacuum pump and make sure that the needle in the gauge moves from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa). Then evacuate the air for approximately 10 minutes.
4. Close the valve of both the Low and High sides of the charging set and turn off the vacuum pump. Make sure that the needle in the gauge does not move after approximately 5 minutes.
- BE SURE TO TAKE THIS PROCEDURE IN ORDER TO AVOID REFRIGERANT GAS LEAKAGE.**
5. Disconnect the charging hose from the vacuum pump and from the service port of the 3-way valve.
6. Tighten the service port caps of both the 3-way valves at a torque of 18 N.m with a torque wrench.
7. Remove the valve caps of the 3-way valves. Position both of the valves to "open" using a hexagonal wrench (4 mm).
8. Mount the valve caps onto both of the 3-way valves.
  - Be sure to check for gas leakage.


### Caution

If gauge needle does not move from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa) in step (3) above, take the following measures:

If the leaks stop when the piping connections are tightened further, continue working from step (3).

If the leaks do not stop when the connections are retightened, repair the location of the leak.

## 11.2. Pumping down

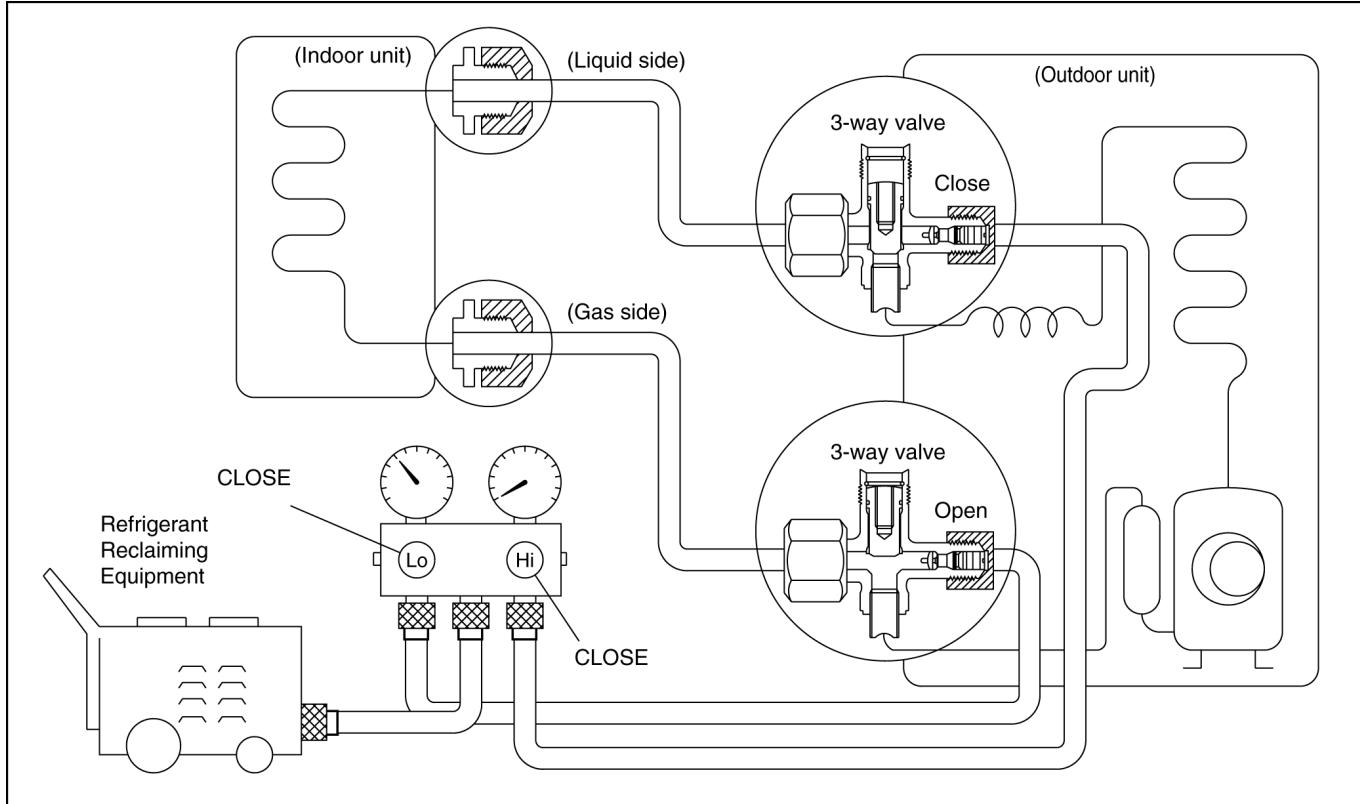


**Procedure:**

1. Confirm that both the 3-way valves are set to the open position.
  - Remove the valve stem caps and confirm that the valve stems are in the open position.
  - Be sure to use a hexagonal wrench to operate the valve stems.
2. Operate the unit for 10 to 15 minutes.
3. Stop operation and wait for 3 minutes, then connect the charge set to the service port of the 3-way valve.
  - Connect the charge hose with the push pin to the Gas side service port.
4. Air purging of the charge hose.
  - Open the low-pressure valve on the charge set slightly to purge air from the charge hose.
5. Set the Liquid side 3-way valve to the close position.
6. Operate the air conditioner at the cooling cycle and stop it when the gauge indicates 0 kg/cm<sup>2</sup>G (0 MPa).
  - If the unit cannot be operated at the cool condition (weather is rather cool), press the Pump Down Switch on the Indoor unit.
  - So that the unit can be operated.
7. Immediately set the gas side 3-way valve to the close position.
  - Do this quickly so that the gauge ends up indicating 1 to 3 kg/cm<sup>2</sup>G (0.1 MPa to 0.3 MPa).
8. Use refrigerant reclaiming equipment to collect refrigerant from indoor unit and pipes.
9. Disconnect the charge set, and mount both the 3-way valve's stem nuts and the service port caps.
  - Use a torque wrench to tighten the service port cap to a torque of 18 N.m.
  - Be sure to check for gas leakage.
10. Disconnect pipes from indoor unit and outdoor unit.

## 11.3. Evacuation of Re-installation

WHEN REINSTALLING AN AIR CONDITIONER, BE SURE TO EVACUATE THE AIR INSIDE THE INDOOR UNIT AND PIPES in the following procedure.

If air remain in the indoor unit and refrigeration pipes, it will affect the compressor, reduce to cooling capacity, and could lead to a malfunction.

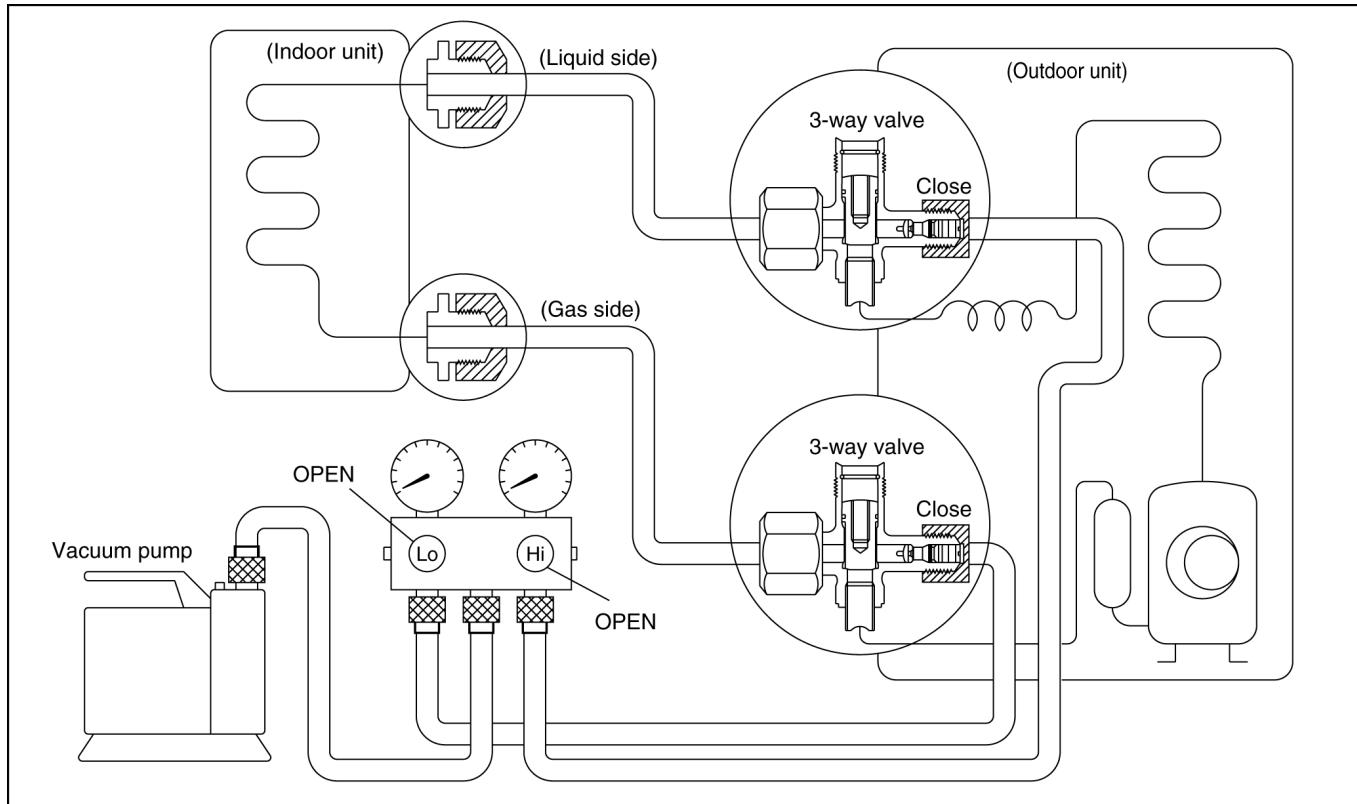

### Procedure:

1. Connect a charging hose with a push pin to the Low and High sides of a charging set and the service port of the 3-way valve.
  - Be sure to connect the end of the charging hose with the push pin to the service port.
2. Connect the centre hose of the charging set to a vacuum pump.
3. Turn on the power switch of the vacuum pump and make sure that the needle in the gauge moves from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa). Then evacuate the air for approximately 10 minutes.
4. Close the valve of both Low side and High side of the charging set and turn off the vacuum pump. Make sure that the needle in the gauge does not move after approximately 5 minutes.

**BE SURE TO TAKE THIS PROCEDURE IN ORDER TO AVOID REFRIGERANT GAS LEAKAGE.**

5. Disconnect the charging hose from the vacuum pump.
6. Charge the pipes and indoor unit with gas refrigerant from liquid (High) side 3-way valve service port and then discharge the refrigerant until gas (Low) side gauge needle indicates 3 kg/cm<sup>2</sup> (0.3 MPa).

- **BE SURE TO USE REFRIGERANT RECLAIMING EQUIPMENT WHILE DISCHARGING THE REFRIGERANT.**
- Purge the air from charge set's centre hose.
- Be sure to check for gas leakage.

### Caution

If gauge needle does not move from 0 cmHg (0 MPa) to -76 cmHg (-0.1 MPa) in step (3) above, take the following measures:


If the leaks stop when the piping connections are tightened further, continue working from step 3.

If the leaks do not stop when the connections are retightened, repair the location of the leak.

7. Tighten the service port caps of both the 3-way valves at a torque of 18 N.m with a torque wrench.
8. Remove the valve caps of both the 3-way valves. Position both of the valves to "open" using a hexagonal wrench (4 mm).
9. Mount the valve caps onto the 3-way valves.

## 11.4. Balance refrigerant of the 3-way valves

(Lack of refrigerant in the refrigeration cycle)

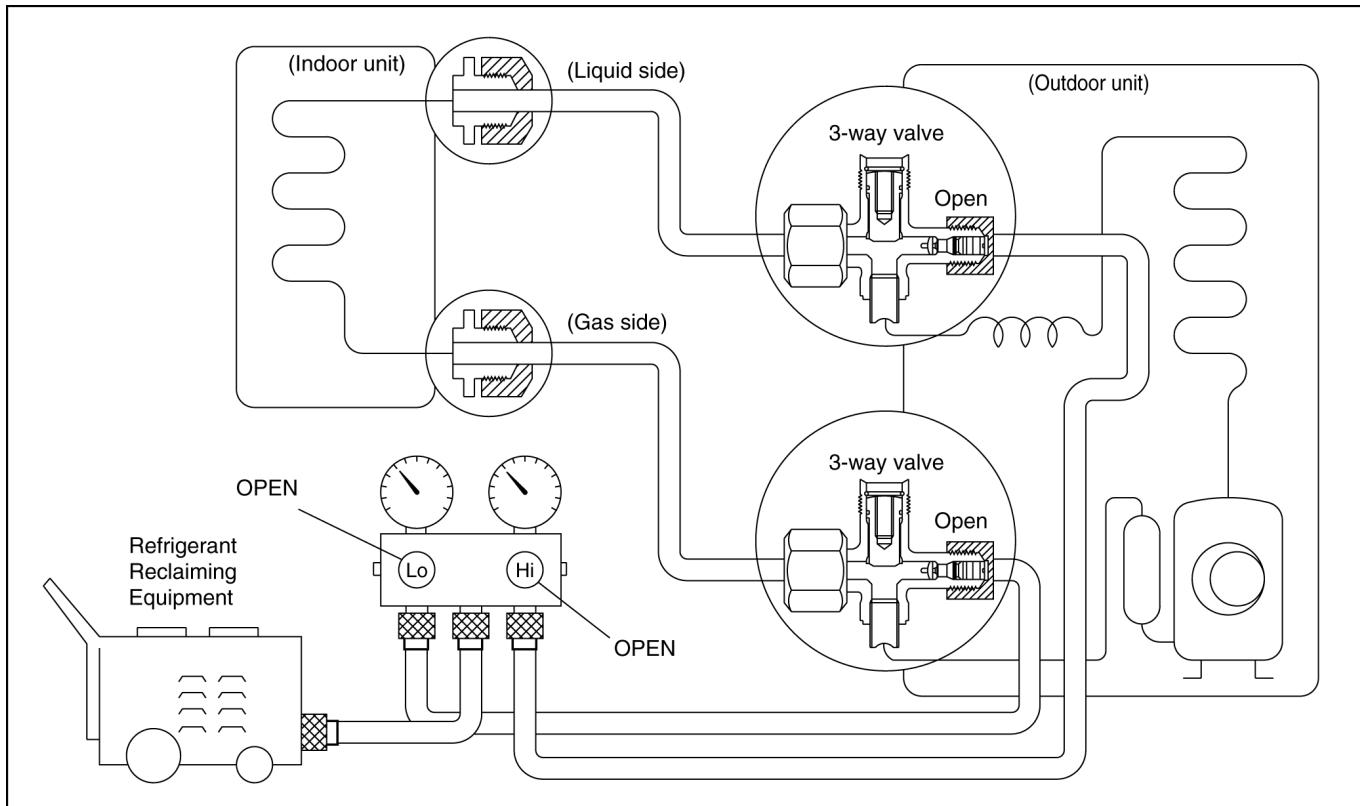


### Procedure:

1. Confirm that both the 3-way valves are set to the open position.
2. Connect the charge set to the 3-way valve's service port.
  - Leave the valve on the charge set closed.
  - Connect the charge hose with the push-pin to the service port.
  - Confirm whether the pressure indicates more than 0.1 MPa (1 kg/cm<sup>2</sup>G).
3. Connect the charge set's centre hose to refrigerant reclaiming equipment.
4. Open the valve (Low side) on the charge set and loosen the hose connected with the Refrigerant Reclaiming Equipment to purge the air from the hose.
5. Turn on refrigerant reclaiming equipment to collect the refrigerant until the needle indicates 0 (no refrigerant is remaining).

## 11.5. Evacuation

(No refrigerant in the refrigeration cycle)

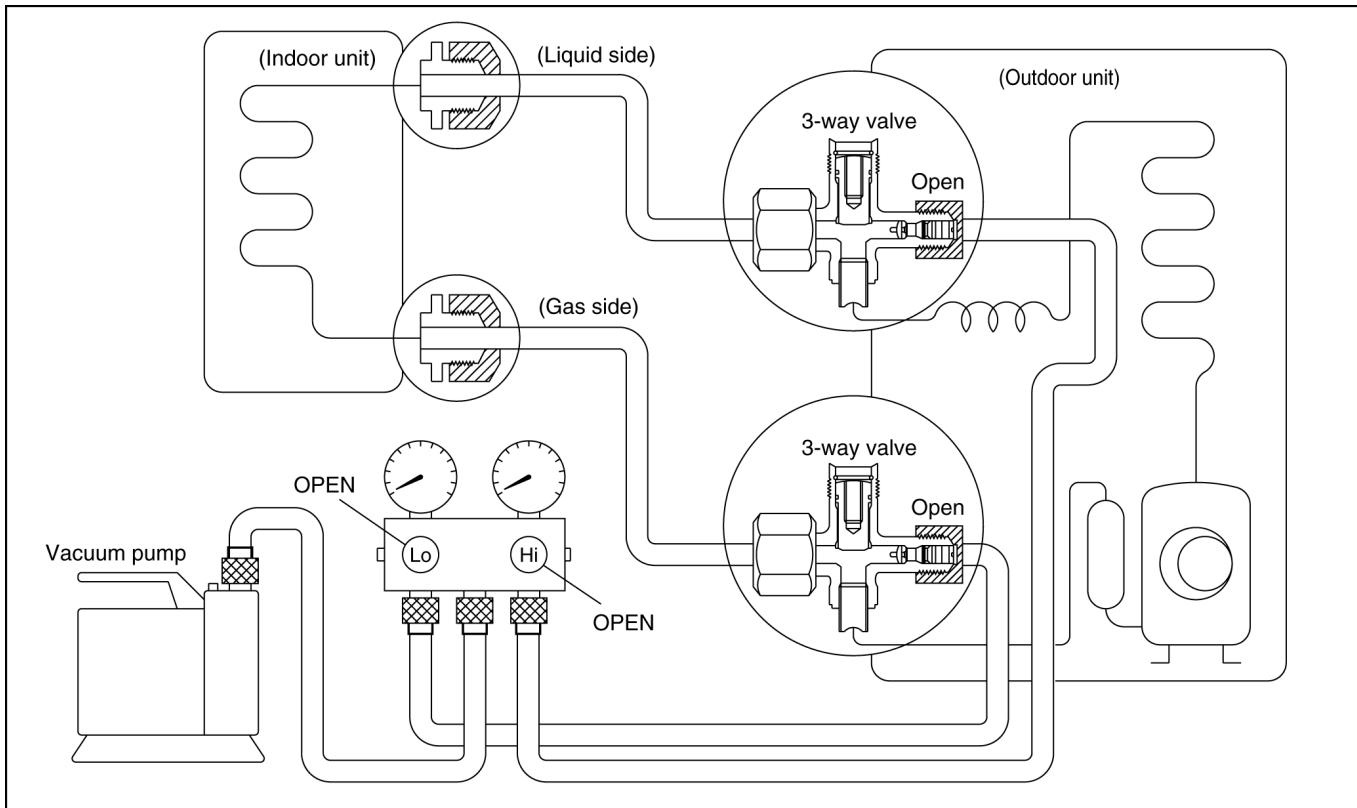


### Procedure:

1. Connect the vacuum pump to the charge set's centre hose.
2. Turn on the vacuum pump to evacuate the unit.
  - Confirm that the gauge needle has moved toward -76 cmHg (-0.1 MPa).
  - Apply the vacuum for approximately 1 hour (vacuum of 4 mmHg or less).
3. Close the valve (Low side and High side) on the charge set, turn off the vacuum pump, and confirm that the gauge needle does not move (approximately 5 minutes after the vacuum pump is turned off).
4. Disconnect the charge hose from the vacuum pump.

## 11.6. Gas charging

(After Evacuation)

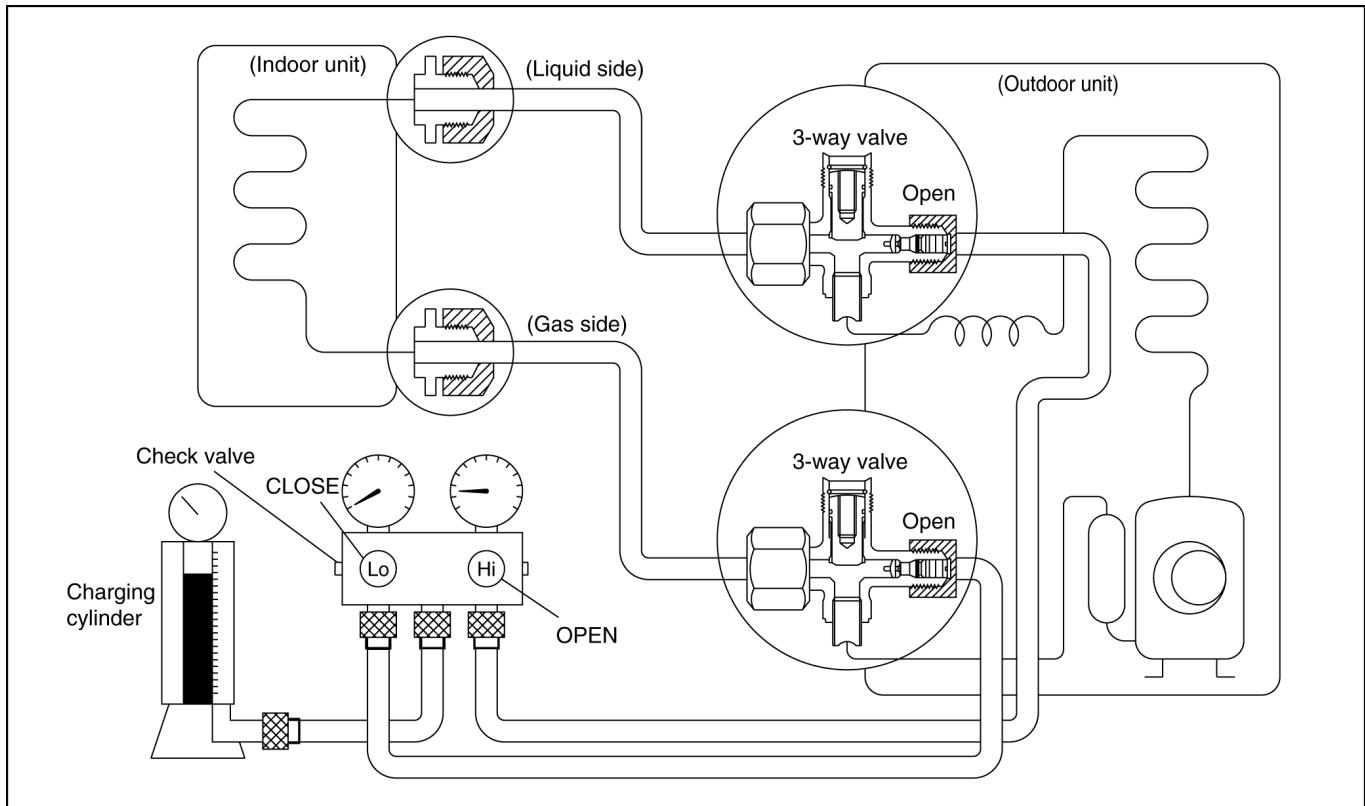

### Procedure:

#### 1. Connect the charge hose to the charging cylinder.

- Connect the charge hose which was disconnected from the vacuum pump to the valve at the bottom of the cylinder.

#### 2. Purge the air from the charge hose.

- Open the valve at the bottom of the cylinder and use a screwdriver to press the check valve on the charge set to purge the air (be careful of the liquid refrigerant).

#### 3. Open the High side on the charge set and charge the refrigerant to the unit.

- Be sure to open only the High side valve on the charge set to charge the system from the liquid-side (high-pressure) pipe. (If the system cannot be charged with the specified amount of refrigerant, operate the compressor until the specified amount can be charged, and then close the valve at the bottom of the charge cylinder.)

#### 4. Immediately disconnect the charge hose from both the 3-way valve service ports.

#### 5. Mount the valve stem nuts and the service port caps onto the 3-way valves.

- Use torque wrench to tighten the service port caps to a torque of 18 N.m.
- Be sure to check for gas leakage.

# 12 Servicing Information

## (A) Disassembly of the parts (Indoor Unit)

- Inspection points for the Indoor Electronic Controller

1. The Electronic Controller, a signal Receiver and an Indicator can be seen by removing the Front Grille and Control Board Cover, as shown in the .

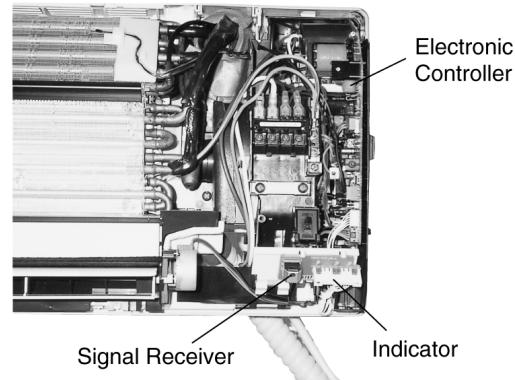


Fig. 1

- Indoor Fan Motor removal procedure:-

1. Remove the connector CN-C of Fan Motor and connector CN-STM of stepping motor from the electronic controller. Release the earth wire (YELLOW-GREEN) from the control board terminal and sensors from its holders. (Refer .)

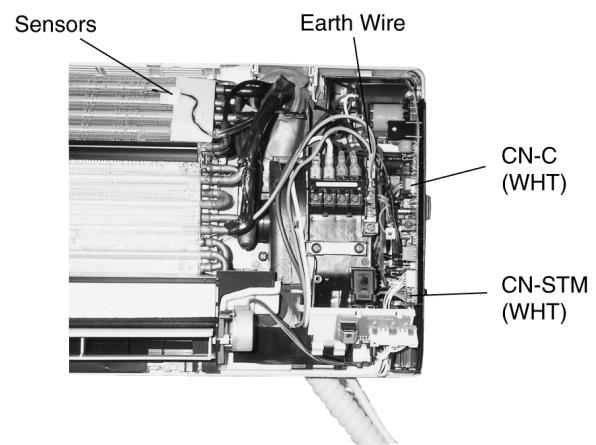


Fig. 2

2. Remove the Control Board.

As shown in remove the 5 screws. Pull the control board forward slightly.

**Caution:**

Remove of Discharge Grille before removing the control board is necessary to avoid damaging other parts.

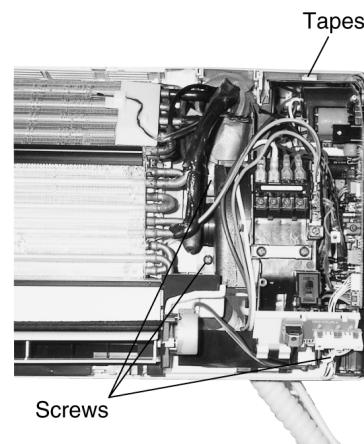


Fig. 3

**3. Remove the Discharge Grille.**

Remove the Discharge Grille and then pull the Discharge Grille in a down and forward direction.

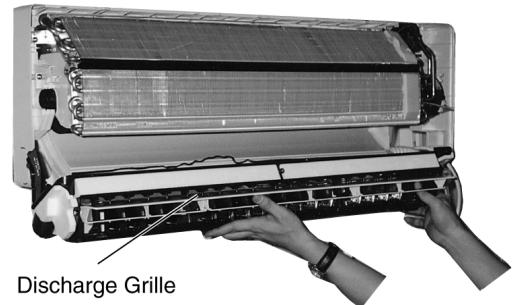


Fig. 4

**4. Remove the Indoor Fan Motor.**

Loosen the Fan Mounting Screw at the junction with Cross Flow Fan.

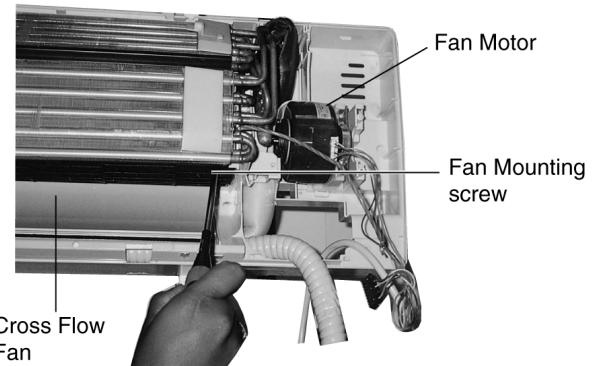


Fig. 5

Loosen the screw at the left side of the evaporator.

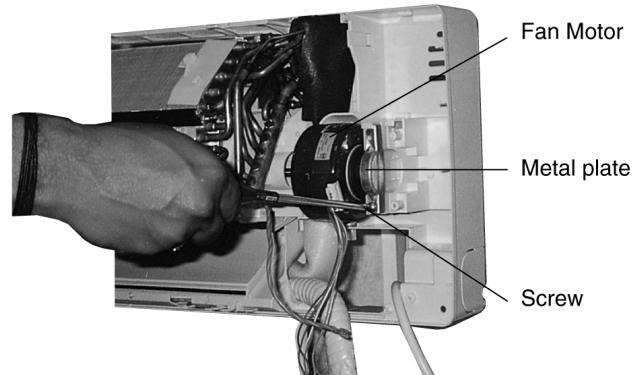


Fig. 6

Pull off the Bearing at the left of the Cross Flow Fan.

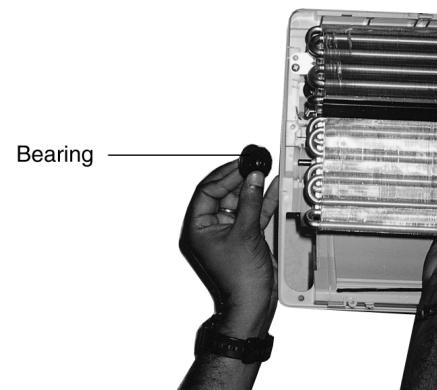


Fig. 7

• **Cross Flow Fan Removal Procedure.**

1.(Refer to No. 4 of Indoor Fan Motor the removal procedure)

Loosen the screw at the right side of the evaporator.



Fig. 8

2. Pull the left side of the evaporator forward slightly and remove the cross Flow Fan.

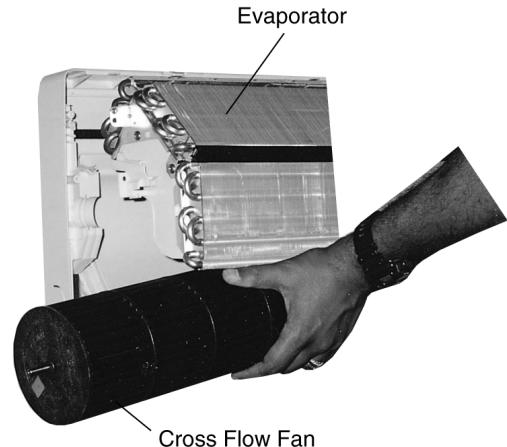


Fig. 9

**(B) Disassembly of the parts (Outdoor Unit)**

• **Inspection points for the Outdoor Electronic Controller**

1. The Electronic Controller, Can be seen by removing the cabinet Top plate and Front plate, as shown in the .

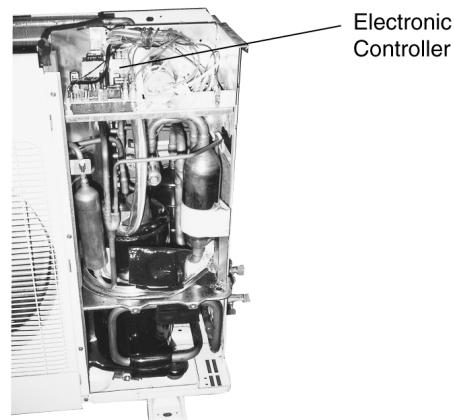



Fig. 10

### (C) Remote Control Transmission Setting

- Remote Control Reset

When the batteries are inserted for the first time, or the batteries are replaced, all the indications will blink and the remote control might not work.


If this happen, remove the back cover of the remote control and you will find a resetting terminal, and by shorting it with a minus screwdriver, it will return to normal.

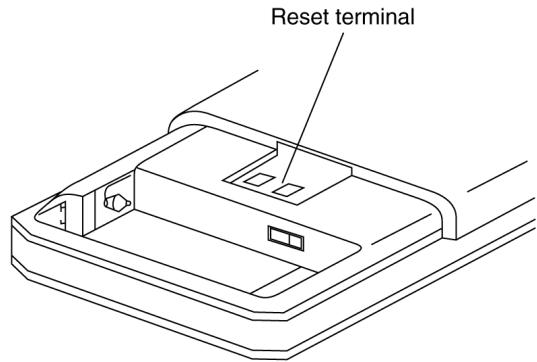

- Changing the wireless remote control transmission code

When two indoor units are installed in the same room, in order to prevent operating errors caused by using two remote controls, set up the remote control [B ↔ A] switch (SW1).

The unit is set to A when it is shipped.

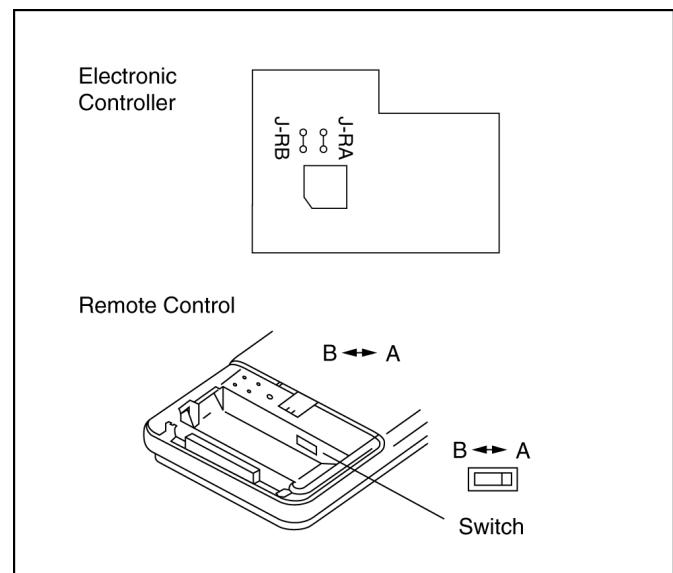

- By adding a jumper wire to the remote control side and CUTTING J-RA, J-RB to the indoor printed circuit board, it is possible to select from 4 types of transmission codes including one at time of delivery condition (1).

	Remote Control		Indoor printed circuit board		Note
	Switch SW B ↔ A	J - B	J - RA	J - RB	
1	A	—	SHORT	SHORT	At product delivery
2	B	—	SHORT	OPEN	
3	A	Jumper wire	OPEN	SHORT	
4	B	Jumper wire	OPEN	OPEN	

# 13 Troubleshooting Guide

## 13.1. Refrigeration cycle system


In order to diagnose malfunctions, make sure that there are no electrical problems before inspecting the refrigeration cycle. Such problems include insufficient insulation, problem with the power source, malfunction of a compressor and a fan.

The normal outlet air temperature and pressure of the refrigeration cycle depends on various conditions, the standard values for them are shown in the table to the right.

Normal Pressure and Outlet Air Temperature (Standard)

	Gas pressure MPa (kg/cm <sup>2</sup> G)	Outlet air temperature (°C)
Cooling Mode	0.4 ~ 0.6 (4 ~ 6)	12 ~ 16
Heating Mode	1.5 ~ 2.1 (15 ~ 21)	36 ~ 45

★ Condition: Indoor fan speed; High  
Outdoor temperature 35°C at the cooling mode  
and 7°C at the heating mode

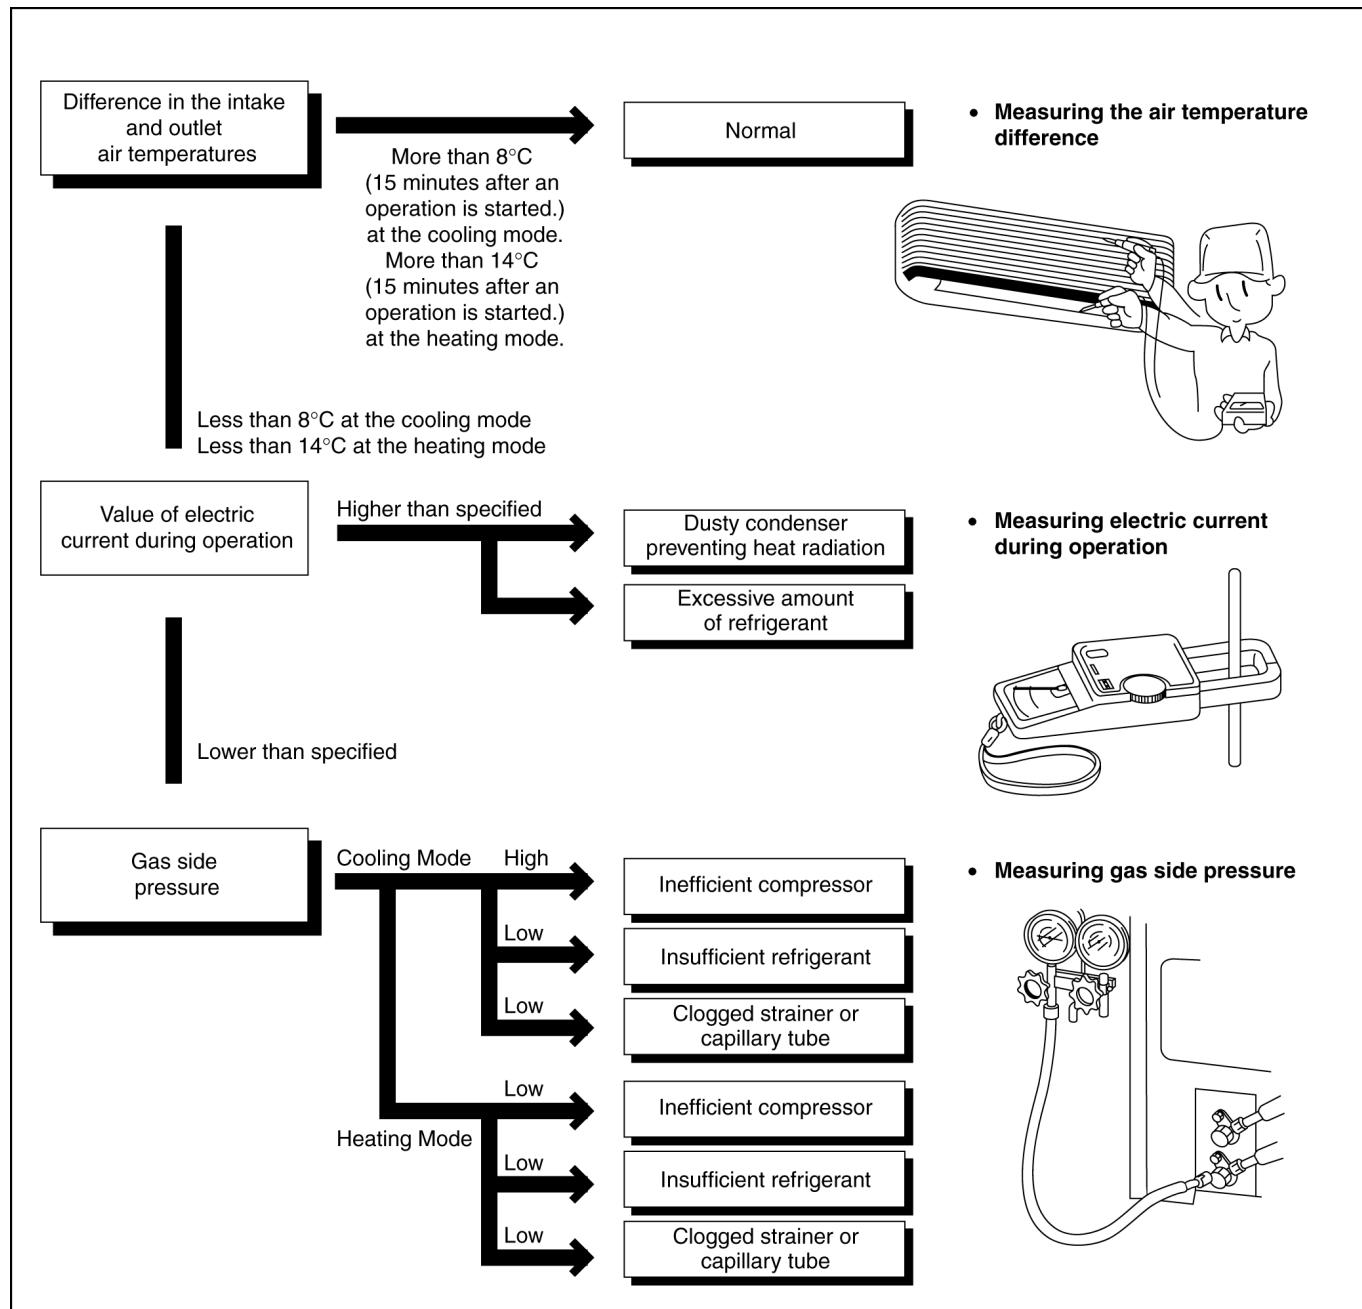

### 13.1.1. Relationship between the condition of the air conditioner and pressure and electric current

Condition of the air conditioner	Cooling Mode			Heating Mode		
	Low Pressure	High Pressure	Electric current during operation	Low Pressure	High Pressure	Electric current during operation
Insufficient refrigerant (gas leakage)	↙	↙	↙	↙	↙	↙
Clogged capillary tube or Strainer	↙	↙	↙	↙	↙	↙
Short circuit in the indoor unit	↙	↙	↙	↗	↗	↗
Heat radiation deficiency of the outdoor unit	↗	↗	↗	↙	↙	↙
Inefficient compression	↗	↖	↖	↗	↖	↖

- Carry out the measurements of pressure, electric current, and temperature fifteen minutes after an operation is started.

### 13.1.2. Diagnosis methods of a malfunction of a compressor and 4-way valve


Nature of fault	Symptom
Insufficient compressing of a compressor	<ul style="list-style-type: none"> <li>• Electric current during operation becomes approximately 20% lower than the normal value.</li> <li>• The discharge tube of the compressor becomes abnormally hot (normally 70 to 90°C).</li> <li>• The difference between high pressure and low pressure becomes almost zero.</li> </ul>
Locked compressor	<ul style="list-style-type: none"> <li>• Electric current reaches a high level abnormally, and the value exceeds the limit of an ammeter. In some cases, a breaker turns off.</li> <li>• The compressor is a humming sound.</li> </ul>
Inefficient switches of the 4-way valve	<ul style="list-style-type: none"> <li>• Electric current during operation becomes approximately 80% lower than the normal value.</li> <li>• The temperature difference between from the discharge tube to the 4-way valve and from suction tube to the 4-way valve becomes almost zero.</li> </ul>

# 14 Technical Data


## ■ Thermostat characteristics

### CS-A28BKP5


- Cooling

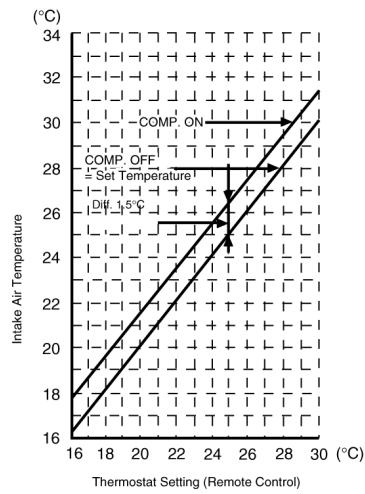

- Soft Dry

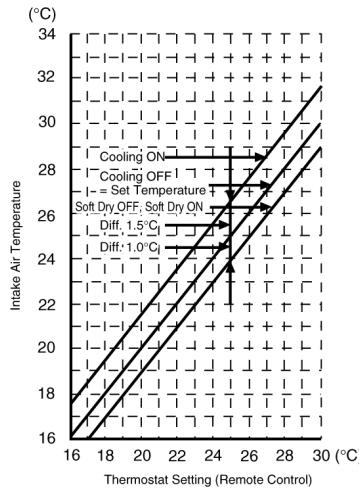


- Heating

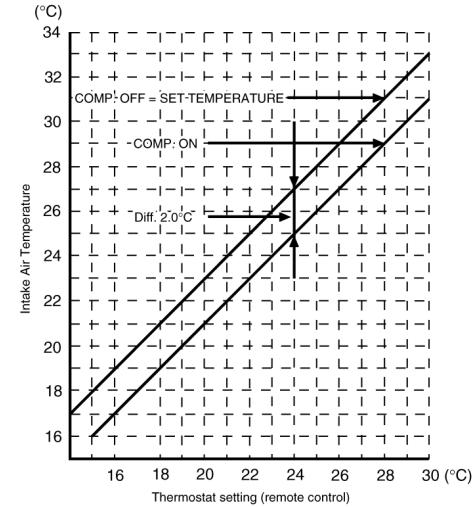


## ■ Operation characteristics

### CS-A28BKP5 / CU-A28BKP5


- Cooling Characteristic

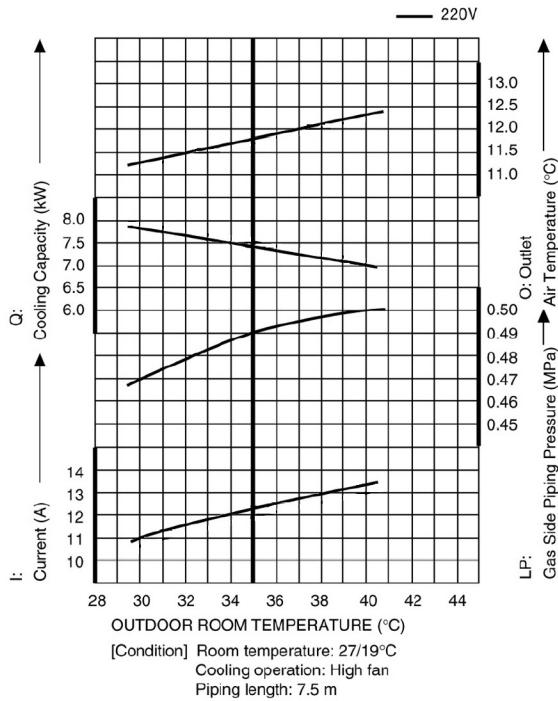


- Piping Length Characteristic (Cooling)

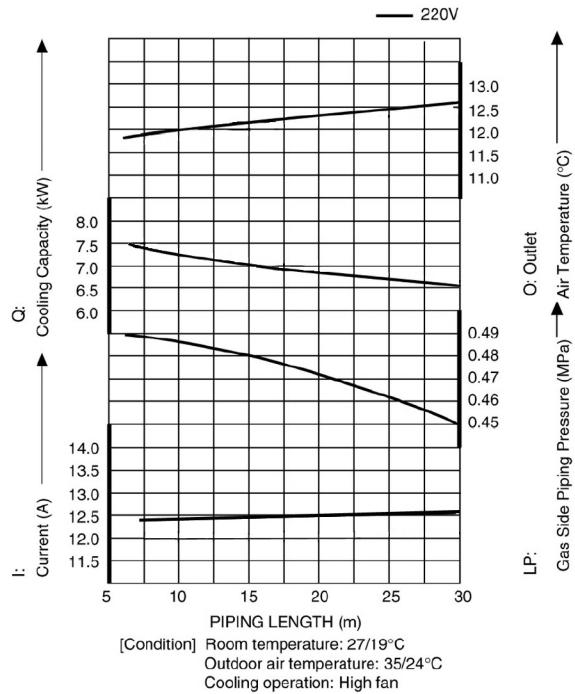

- Heating Characteristic

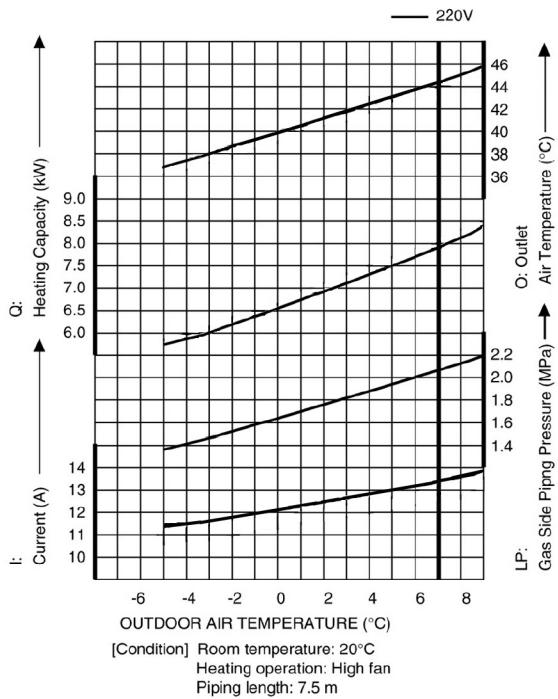


- Piping Length Characteristic (Heating)

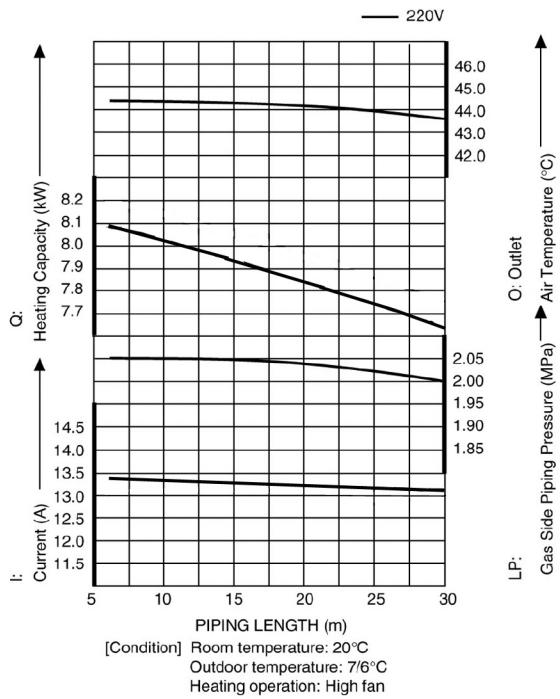


## ■ Operation characteristics

### CS-A28BKP5 / CU-A28BKP5


- Cooling Characteristic

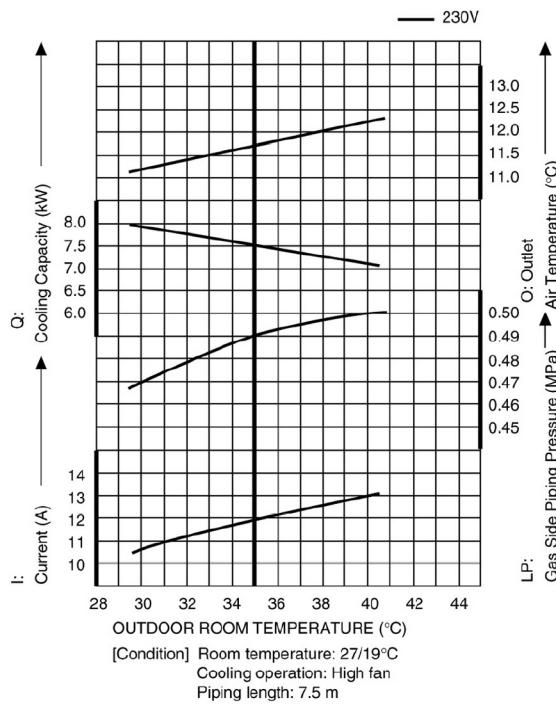


- Piping Length Characteristic (Cooling)

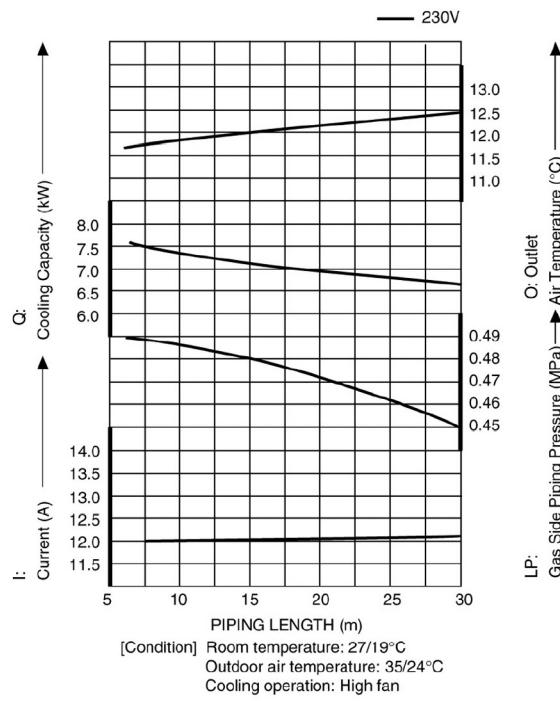

- Heating Characteristic

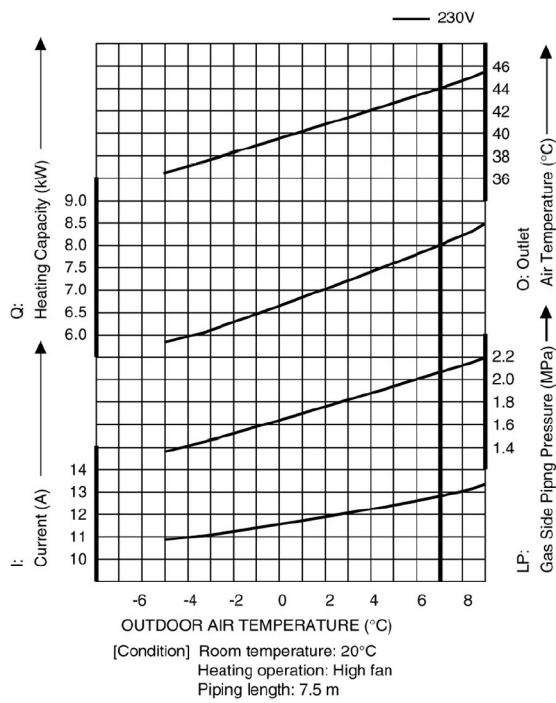


- Piping Length Characteristic (Heating)

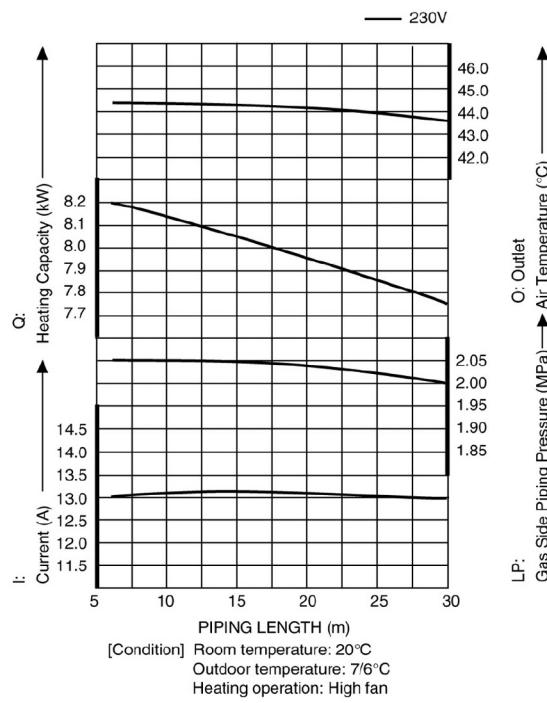

# 15 Exploded View

CS-A28BKP5

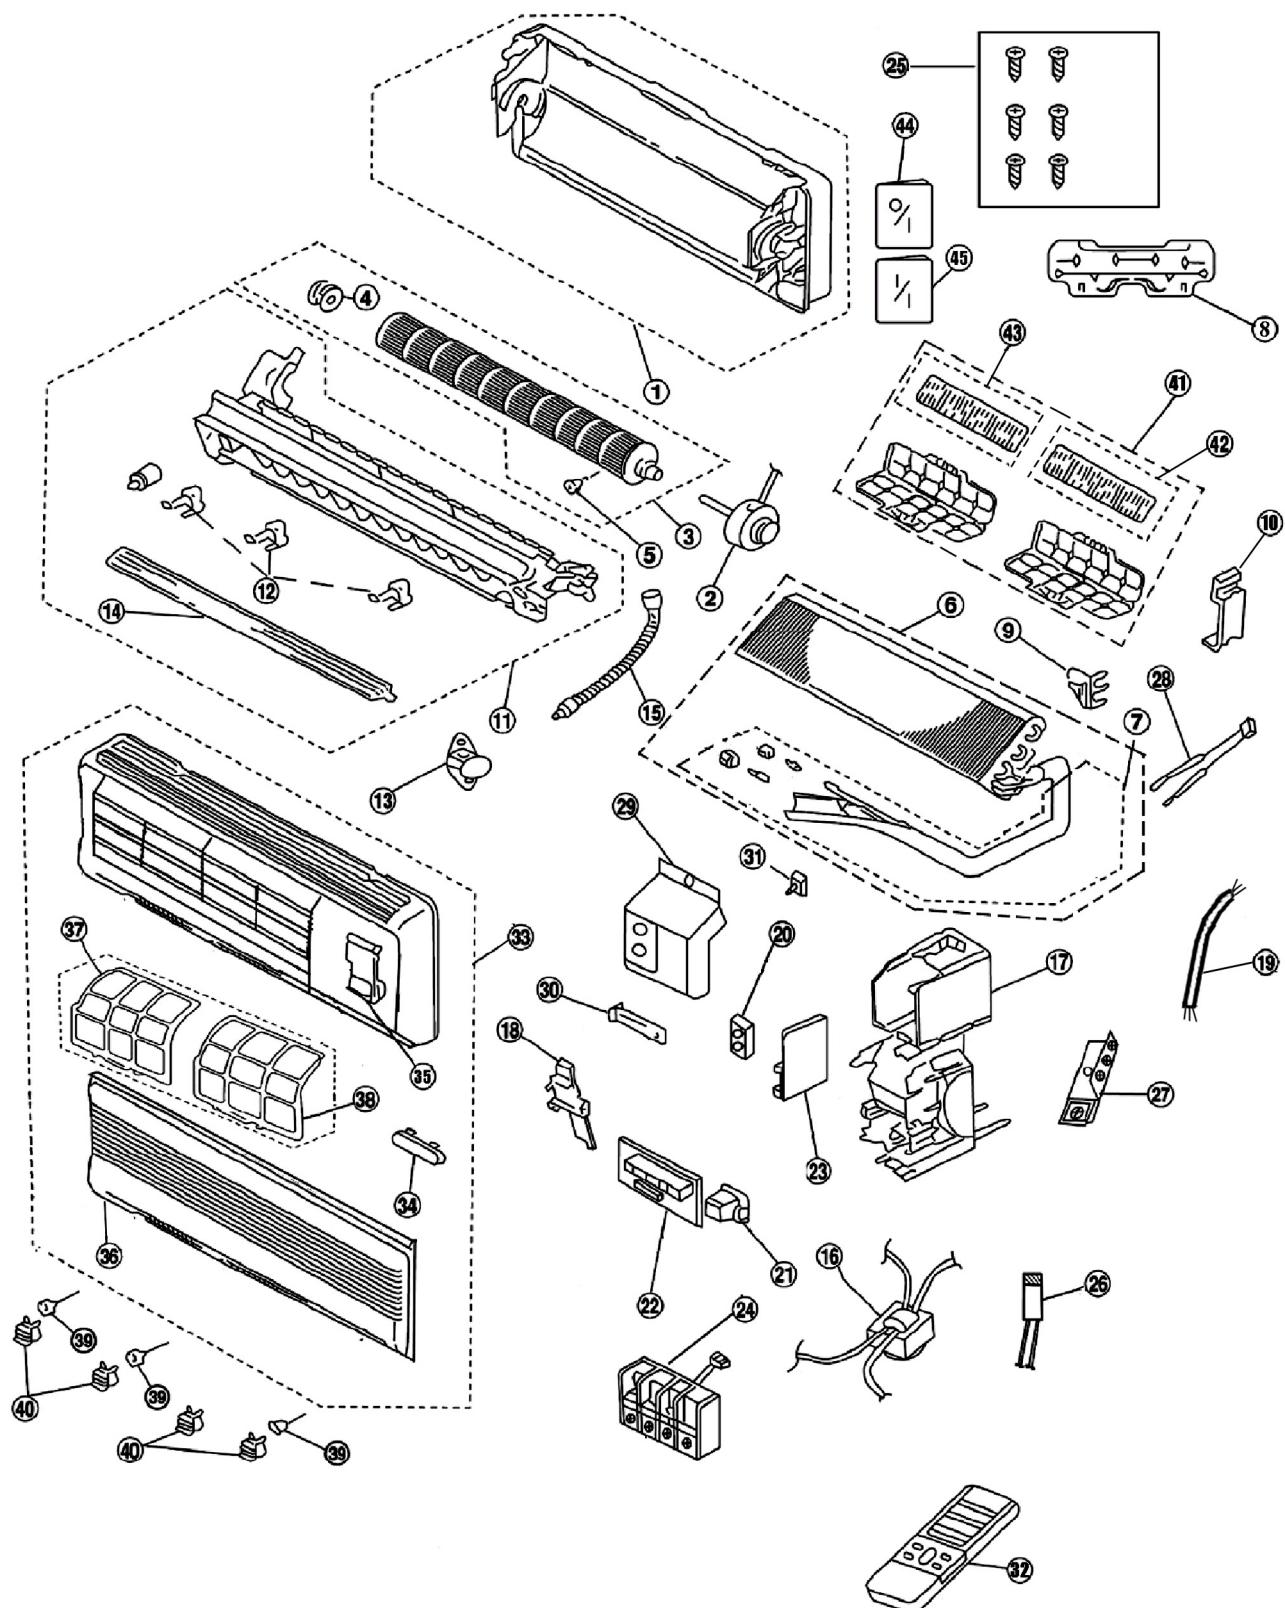

## **16 Replacement Parts List**


<Model: CS-A28BKP5>

(Note)

- “■” marked parts are recommended to be kept in stock.
  - “●” marked parts are supplied from TAMACO, Taiwan.
  - “▲” marked parts are supplied from MACC, Malaysia.

# 17 ExplodedView

CU-A28BKP5

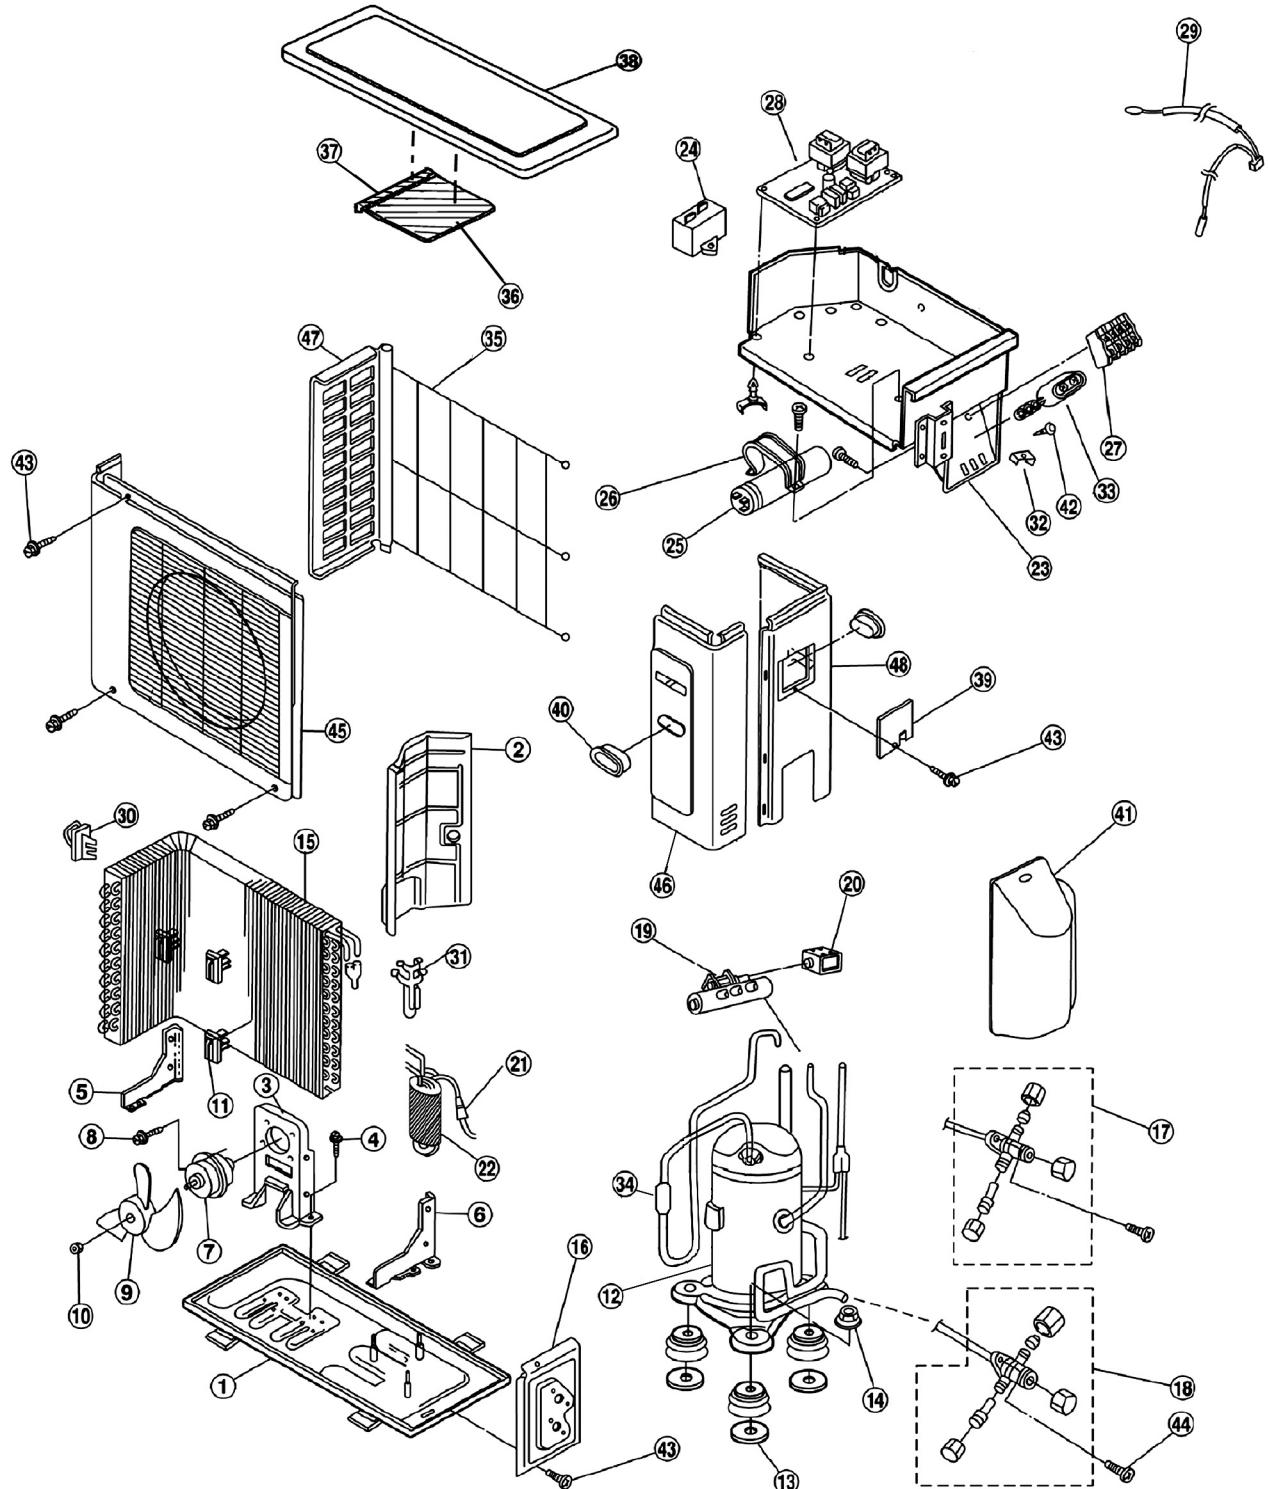

# 18 Replacement Parts List

&lt;Model: CU-A28BKP5&gt;

NO	DESCRIPTION & NAME	QTY	CU-A28BKP5	REMARKS
1	CHASSIS ASS'Y	1	CWC5244-200A	●
2	SOUND PROOF	1	CWC5236-060	●
3	FAN MOTOR BRACKET	1	CWC5241-830	●
4	SCREW - (FAN MOTOR BRACKET)	6	XTT4D10CXW	●
5	PARTICULAR PLATE - LEFT (HOLD - FAN MOTOR)	1	CWC4934-850	●
6	PARTICULAR PLATE - RIGHT (HOLD - FAN MOTOR)	1	CWC4934-860	●
7	FAN MOTOR	1	CWC4301-380	■●
8	SCREW - FAN MOTOR	3	XTT4D10CXW	●
9	PROPELLER FAN ASS'Y	1	CWC5700-500	■●
10	NUT - PROPELLER FAN	1	CWC4583-020	●
11	HOLDER - FOR F/MOTOR & LEAD WIRES	3	CWC4620-110	●
12	COMPRESSOR	1	CWC6815-280	■●
13	PACKING - COMP. MOUNT	3	CWC4604-010	●
14	NUT - COMP. MOUNT	3	CWC4521-130	●
15	CONDENSER	1	CWC6305-570	●
16	HOLDER - COUPLING ASS'Y	1	CWC5240-070A	●
17	3-WAYS VALVE (LIQUID)	1	CWC4034-150	■●
18	3-WAYS VALVE (GAS)	1	CWC4034-170	■●
19	4-WAYS VALVE ASS'Y	1	CWC4034-740	■●
20	V-COIL COMPLETE	1	CWC4019-400	■●
21	STRAINER	1	CWC4042-340	●
22	TUBE ASS'Y (CAPILLARY TUBE.CHECK VALVE)	1	CWC5932-090	●
23	CONTROL BOARD ASS'Y	1	CWC4712-690	●
24	CAPACITOR - FAN MOTOR	1	CWC4069-960	■●
25	CAPACITOR - COMPRESSOR	1	CWC4069-780	■●
26	HOLDER - CAPACITOR	1	CWC4828-750	●
27	TERMINAL BOARD ASS'Y	1	CWC4706-590	■●
28	ELECTRONIC CONTROLLER	1	CWC3919-670	■●
29	SENSOR COMPLETE	1	CWC3900-240	■●
30	HOLDER - SENSOR	1	CWC5040-130	●
31	HOLDER - SENSOR (FOR TUBE)	1	CWC5040-120	●
32	U METAL PIECE	1	CWC4825-120	●
33	HOLDER-PS,CORD	1	CWC4627-100	●
34	MUFFLER	1	CWC6040-320	●
35	WIRE NET (REAR)	1	CWC4537-530A	●
36	POLY-E FOAM	1	CWE3A325-360	●
37	POLY-E FOAM	1	CWN5A30-325	●
38	CABINET TOP PLATE ASS'Y	1	CWC5030-520A	●
39	CONTROL BOARD COVER	1	CWC4936-960A	●
40	HANDLE	2	CWC4520-120	●
41	RAIN COVER	1	CWC4631-880	●
42	SCREW	1	XYN4+C8D	●
43	SCREW	20	CWC4585-520	●
44	SCREW	4	CWC4580-930	●
45	CABINET ASS'Y	1	CWC5030-940A	●
46	CABINET FORNT PLATE ASS'Y	1	CWC5030-640	●
47	CABINET SIDE PLATE (LEFT)	1	CWC5030-720A	●
48	CABINET REAR PLATE COMPLETE	1	CWC5030-820	●

(Note)

- “■” marked parts are recommended to be kept in stock.
- “●” marked parts are supplied from TAMACO, Taiwan.
- “▲” marked parts are supplied from MACC, Malaysia.

## 19 Electronic Parts List

### Electronic Controller: C3919-420A (CS-A28BKP5)

SYMBOL	DESCRIPTION & NAME	PART NO.
IC1	INTEGRATED CIRCUIT	C4083-910
IC2	INTEGRATED CIRCUIT	C4083-450
IC3	INTEGRATED CIRCUIT	C4083-860
IC4	INTEGRATED CIRCUIT	C4083-730
IC5	INTEGRATED CIRCUIT	C4083-720
PC1	PHOTO COUPLER	C4094-040
Q1	TRANSISTOR	C4086-060T
Q2	TRANSISTOR	C4086-240T
Q3, Q5	TRANSISTOR	J4086-080T
D1 ~ D4	DIODE	E4060-020T
ZD1	ZENER DIODE	C4082-100T
ZNR1, ZNR2, ZNR3	ZNR	C4084-150
RY-HOT	RELAY ELECTRO MAGNETIC	C4104-180
RY-HI, ME, LO	RELAY ELECTRO MAGNETIC	C4104-170
RY-COMP	RELAY ELECTRO MAGNETIC	C4076-310
SSR1	SSR	C4092-070
SW1, SW2	PUSH SWITCH	C4001-200
FUSE	FUSE	XBA2C31TR0
X1	RESONATOR	F4090-010T
BZ	BUZZER (SOUND GENERATOR)	C4091-030
Q6~ Q8	TRANSISTOR	C4086-250T

Note

- All parts are supplied from TAMACO, Taiwan.

### Electronic Controller: CWC3919-670 (CU-A28BKP5)

SYMBOL	DESCRIPTION & NAME	PART NO.
IC1	INTEGRATED CIRCUIT	C4083-950A
IC2	INTEGRATED CIRCUIT	C4083-720
IC3	INTEGRATED CIRCUIT	C4083-730
IC4	INTEGRATED CIRCUIT	C4083-450
Q1	TRANSISTOR	C4086-060T
Q2	TRANSISTOR	C4086-240T
D1 ~ D12	DIODE	E4060-240T
ZD1	ZENER DIODE	C4082-100T
ZNR1 ~ ZNR3	ZNR	C4084-150
T1, T2	TRANSFORMER	C4017-780
CR1	SURGE ABSORBER	C4085-560
RY-HOT	RELAY	C4104-170
RY-DEICE	RELAY	C4107-170
RY-OFF	RELAY	C4107-170
RY-H/L	RELAY	C4107-170
FUSE	FUSE	XBA2C31TR0
X1	RESONATOR	A45ST4.0MGWT


Note

- All parts are supplied from TAMACO, Taiwan.


# 20 Electronic Circuit Diagram

- CS-A28BKP5 / CU-A28BKP5

## **SCHEMATIC DIAGRAM 1/3**

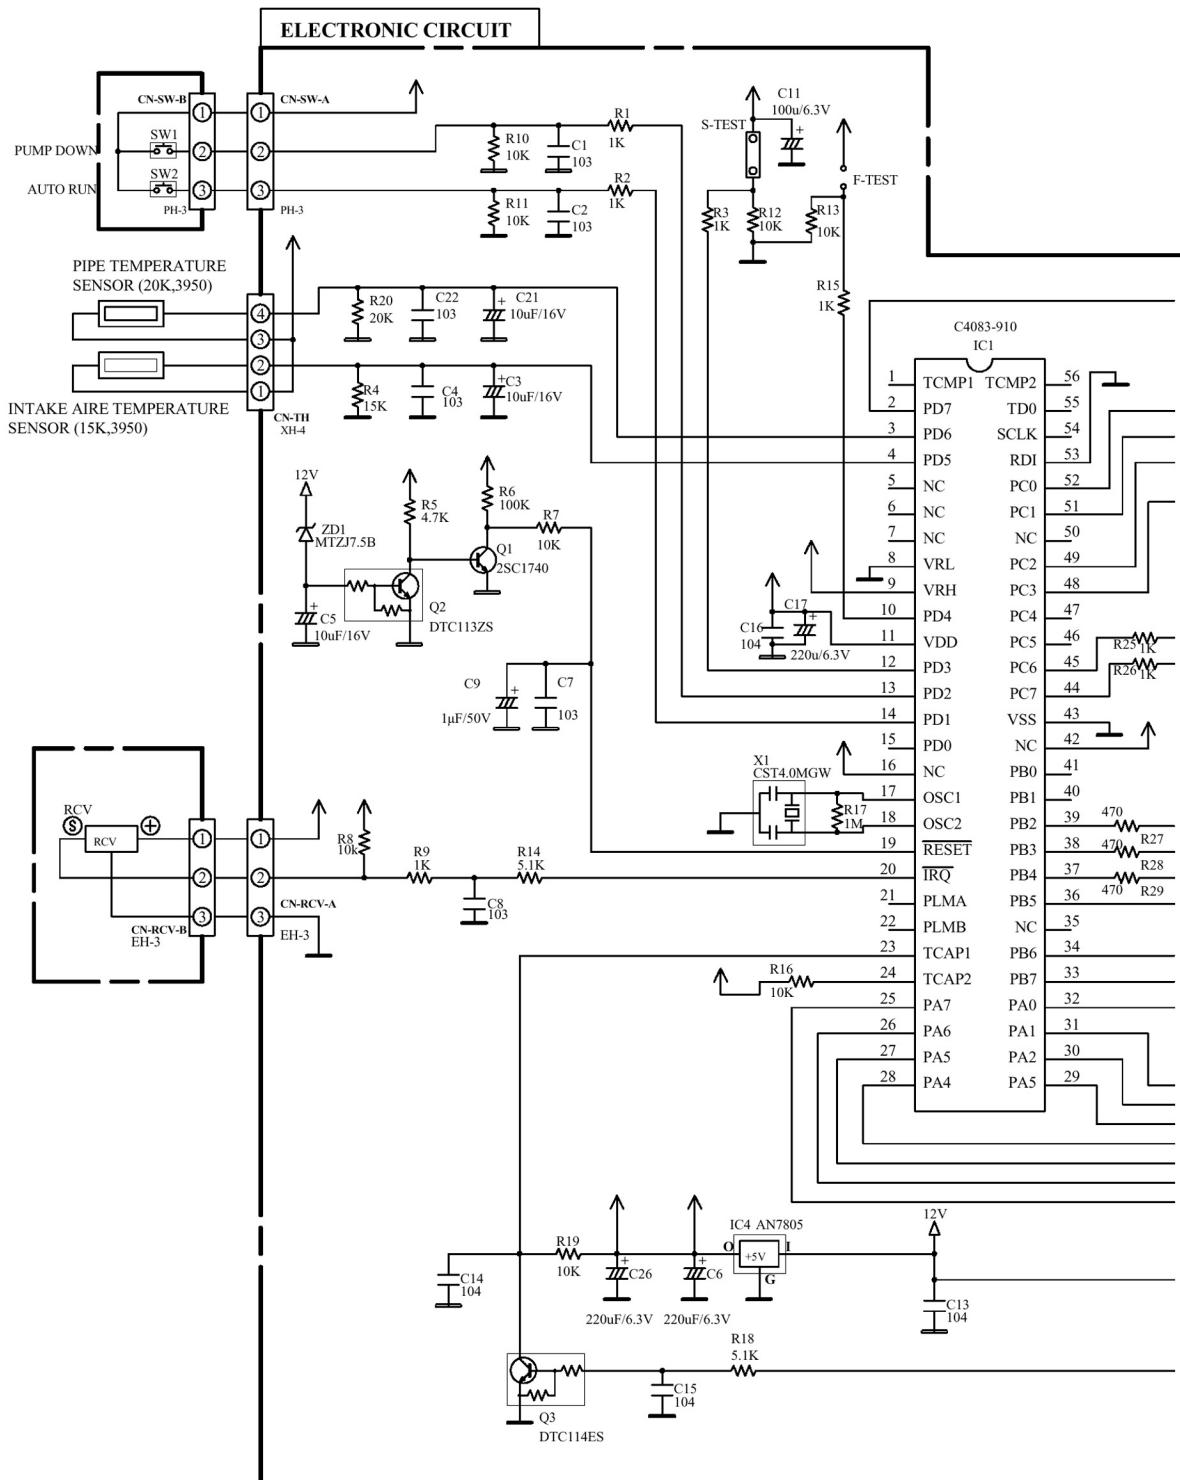

## SCHEMATIC DIAGRAM 2/3

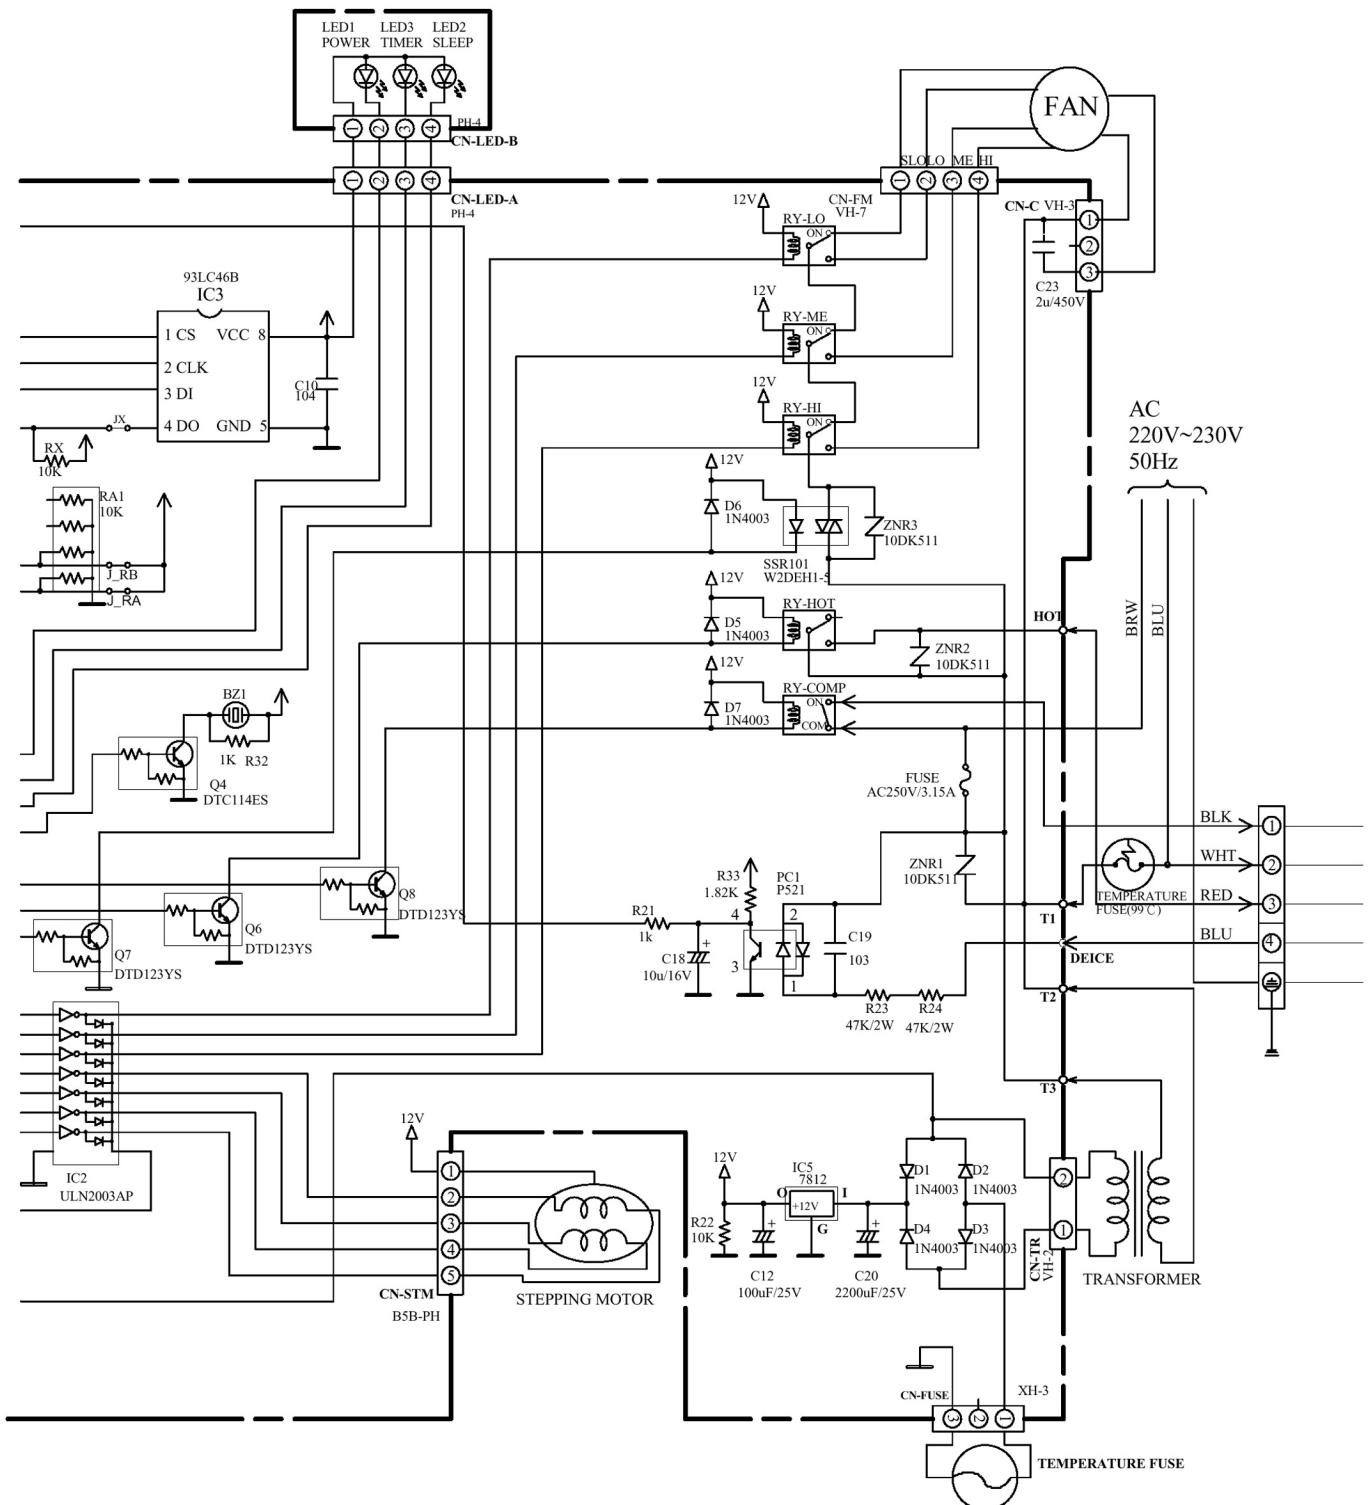

## SCHEMATIC DIAGRAM 3/3

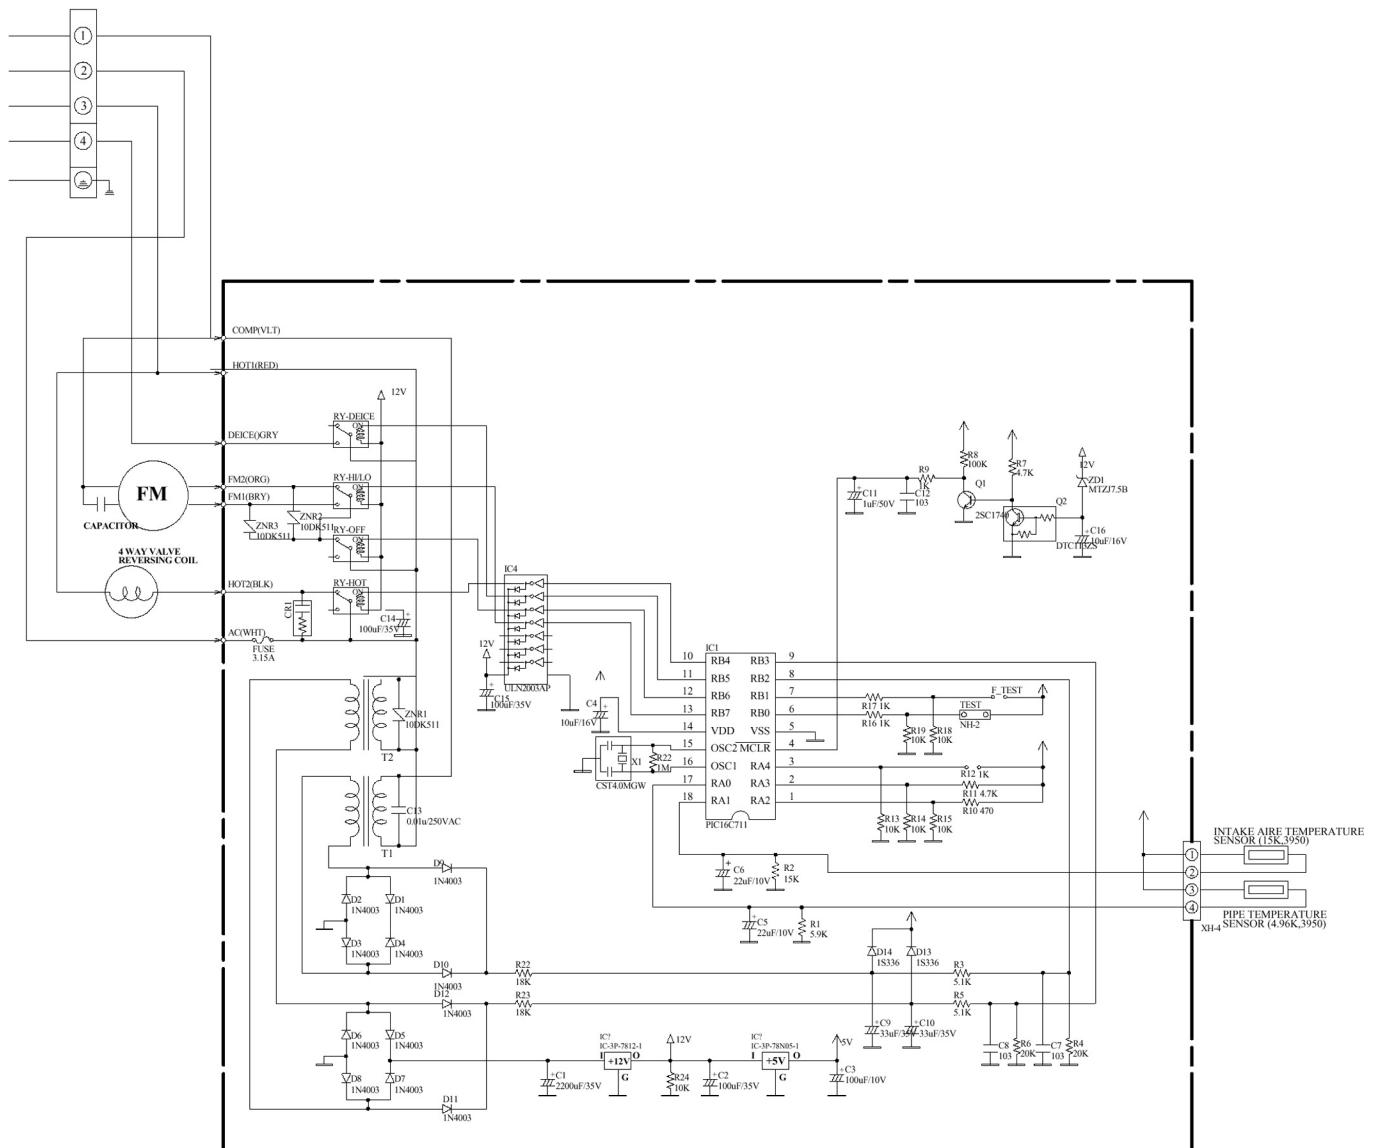


Fig. 1

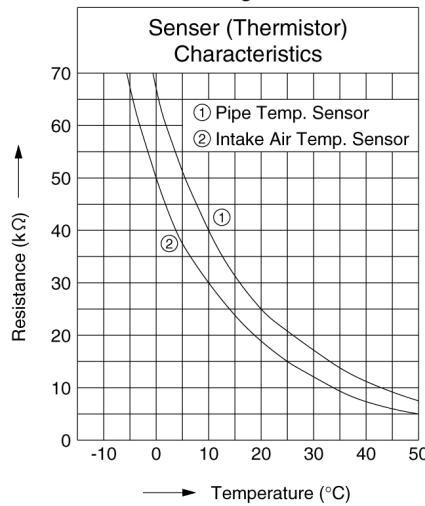


Fig. 2

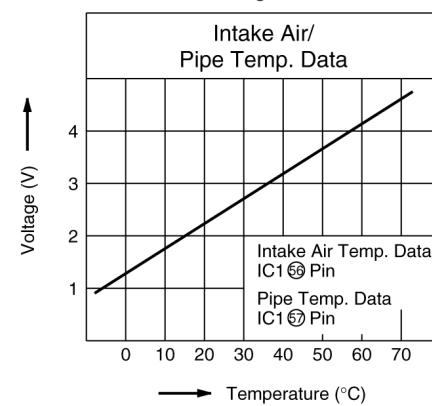


Fig. 3

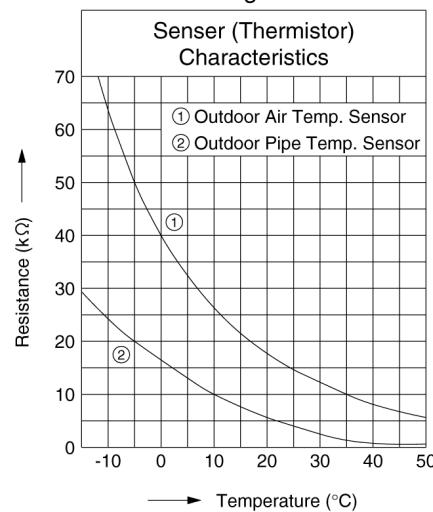


Fig. 4

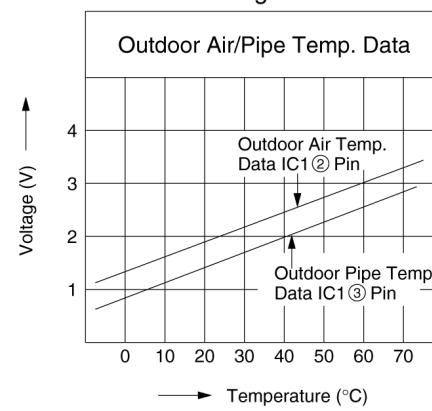


Fig. 5

OUTDOOR TEMP.	RISES		FALLS	
	OVER 29°C	Hi	OVER 31°C	Hi
COOLING	BELOW 29°C	Lo	BELOW 31°C	Lo
SOFT DRY	BELOW 15.5°C	Hi	BELOW 13.5°C	Hi
HEATING	OVER 15.5°C	Lo	OVER 13.5°C	Lo

## How to use electronic circuit diagram

Before using the circuit diagram, read the following carefully.

\* Voltage measurement

Voltage has been measured with a digital tester when the indoor fan is set at high fan speed under the following conditions without setting the timer.

Use them for servicing.

Voltage indication is in Red at all operations.

	Intake air temperature	Temperature setting	Discharge air temperature	Pipe temperature
Cooling	27°C	16°C	17°C	15°C
Heating	20°C	30°C	40°C	50°C

\* Indications for resistance

a. K....kΩ                    M....MΩ  
W...watt                    Not indicated....1/4W

b. Type  
Not indicated.....carbon resister  
Tolerance±5%  
 .....metal oxide resister  
Tolerance±1%

\* Indications for capacitor

- a. Unit  $\mu\ldots\mu\text{F}$   $\text{P}\ldots\text{pF}$
- b. Type Not indicated....ceramic capacitor  
(S).....S series aluminium electrolytic capacitor  
(Z).....Z series aluminium electrolytic capacitor  
(SU).....SU series aluminium electrolytic capacitor  
(P).....P series polyester system  
(SXE).....SXE series aluminium electrolytic capacitor  
(SRA).....SRA series aluminium electrolytic capacitor  
(KME).....KME series aluminium electrolytic capacitor


\* Diode without indication.....MA165

\* Circuit Diagram is subject to change without notice for further development.

## TIMER TABLE

Name		Time	Test mode (When test point Short-circuited)	Remarks
Sleep Mode Waiting		1 hr.	6 sec.	
Sleep Mode Operation		8 hrs.	48 sec.	
Real Timer		1 hr.	1 min.	
		10 min.	10 sec.	
		1 min.	1 sec.	
Time Delay Safety Control		3 min.	0 sec.	
Forced Operation		60 sec.	0 sec.	
Time Save Control		7 min.	42 sec.	
Anti-Freezing Control		4 min.	0 sec.	
Mode Judgement		20 sec.	0 sec.	
Soft Dry	Off	6 min.	36 sec.	
	On	10 min.	60 sec.	SOFT DRY: 10 min. operation
Deodorizing Control	Cooling	40 sec.	4 sec.	Comp. ON
		70 sec.	7 sec.	Comp. ON
		20 sec.	2 sec.	Comp. OFF
		180 sec.	18 sec.	Comp. OFF
	Soft Dry	40 sec.	4 sec.	Comp. ON
		360 sec.	36 sec.	Comp. OFF
After Deice Ended		30 sec.	3 sec.	Comp. OFF, F/Motor ON
4-Way valve		5 min.	30 sec.	

## 20.1. REMOTE CONTROL

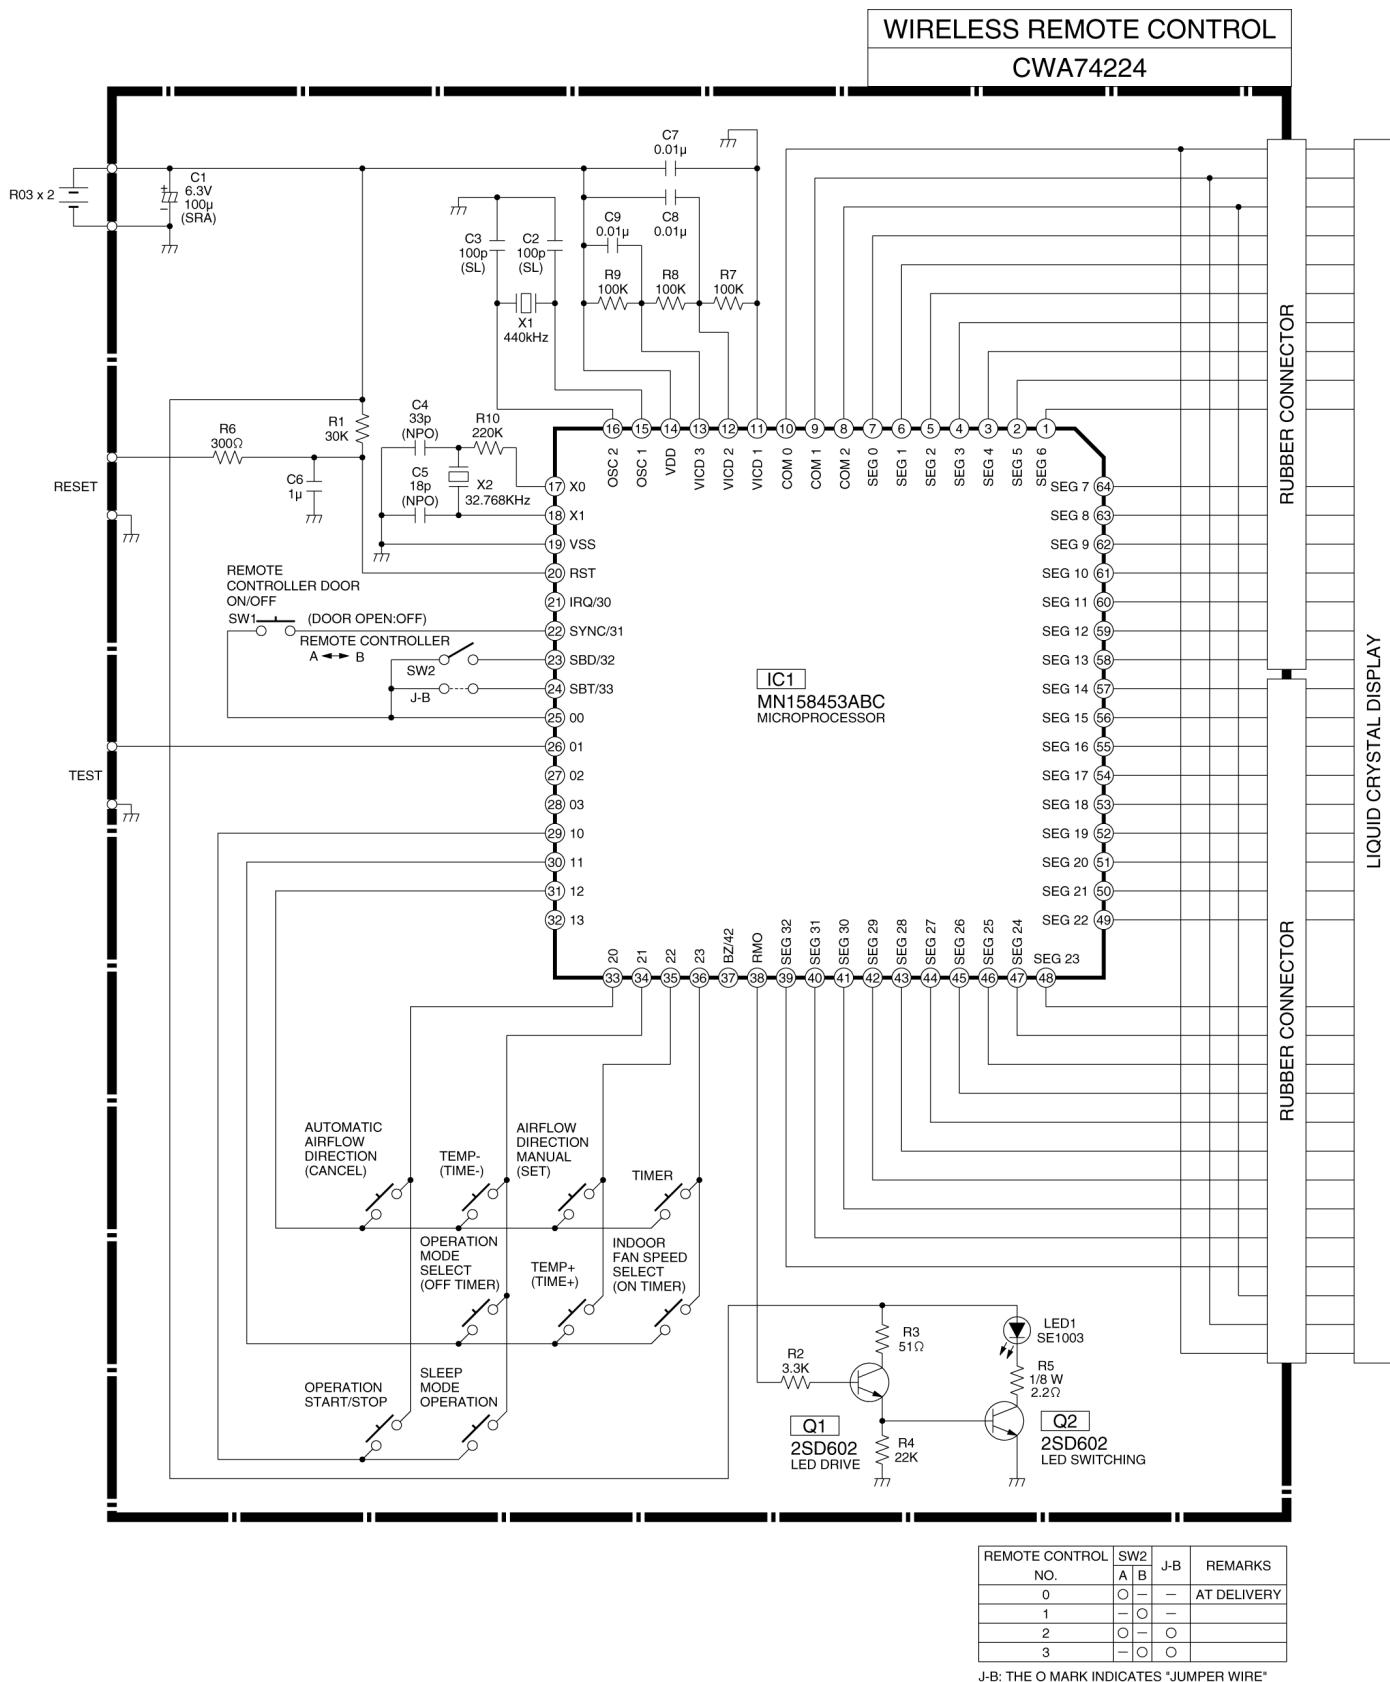

REMOTE CONTROL NO.	SW2		J-B	REMARKS
	A	B		
0	○	-	-	AT DELIVERY
1	-	○	-	
2	○	-	○	
3	-	○	○	

J-B: THE O MARK INDICATES "JUMPER WIRE"