

APPENDIX C
FUEL OIL STORAGE TANK VENTING OPTIONS
SECTION MC C101
GENERAL

C101.1 Scope. The figures in this appendix shall supplement the provisions for venting of tanks in Section 1305 and are intended for illustrative purposes. Where there is a conflict between the figures in this appendix and the provisions in Section 1305, the provisions of Section 1305 shall govern.


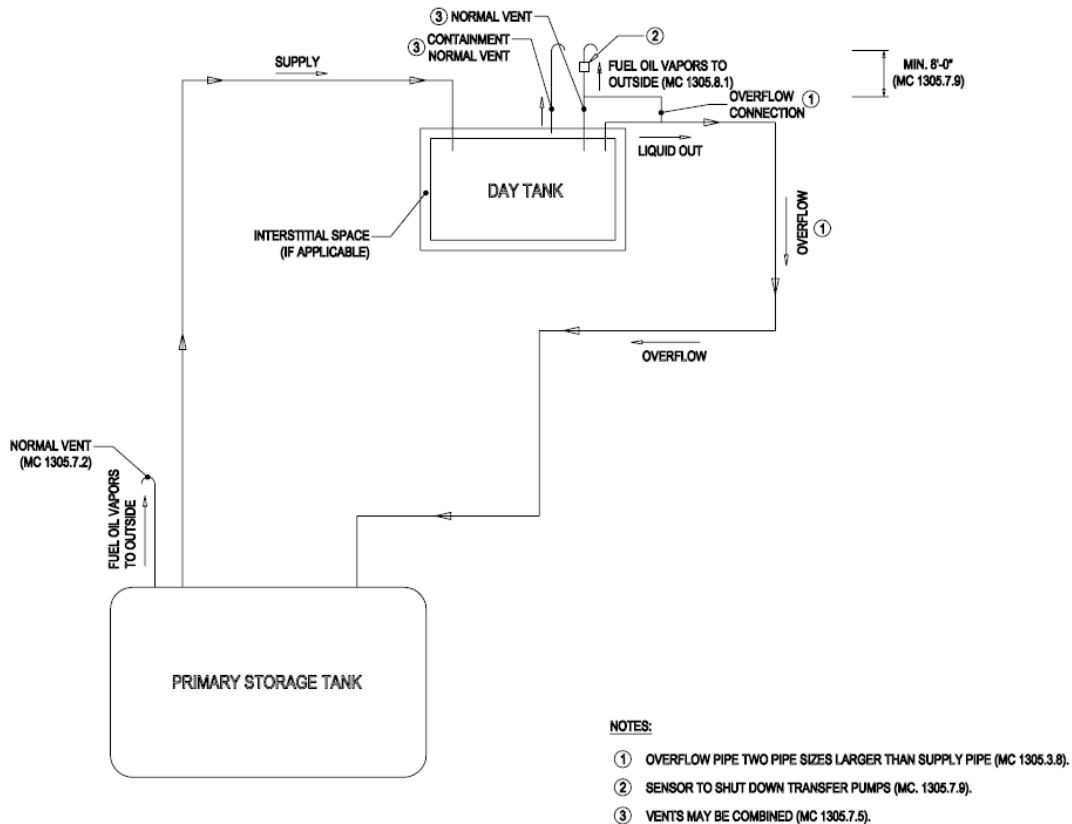


FIGURE C101.1(1)
PRIMARY TANK: UL 80, ASME BPVC, OR NYC ALTERNATE TANK
DAY TANK: UL 80, ASME BPVC, OR NYC ALTERNATE TANK

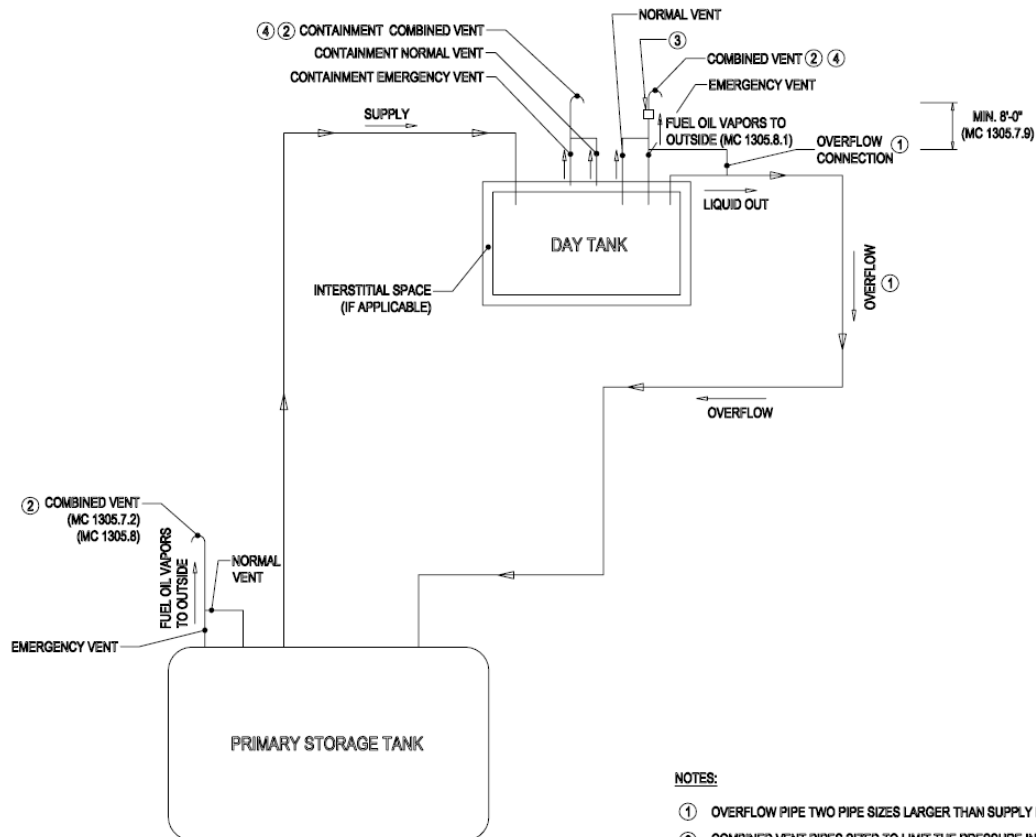

NOTES:

- ① OVERFLOW PIPE TWO PIPE SIZES LARGER THAN SUPPLY PIPE (MC 1305.3.8).
- ② COMBINED VENT PIPES SIZED TO LIMIT THE PRESSURE IN THE STORAGE TANK PER MC 1305.8.4. CALCULATIONS TO BE PROVIDED ON DRAWINGS.
- ③ SENSOR TO SHUT DOWN TRANSFER PUMPS (MC. 1305.7.9).
- ④ VENTS MAY BE COMBINED (MC 1305.7.5).

FIGURE C101.1(2)
PRIMARY TANK: UL 142 OR DUAL LABEL TANK
DAY TANK: UL 142 OR DUAL LABEL TANK

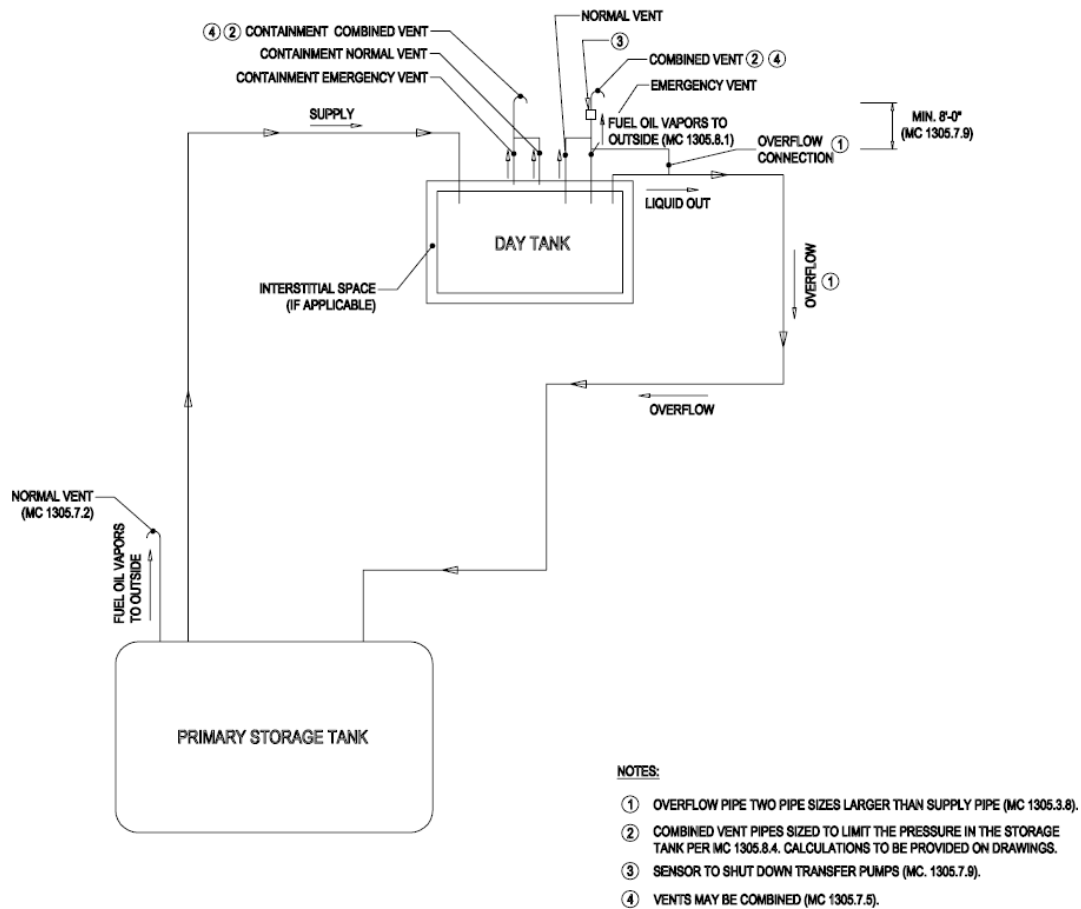


FIGURE C101.1(3)
PRIMARY TANK: UL 80, ASME BPVC, OR NYC ALTERNATE TANK
DAY TANK: UL 142 OR DUAL LABEL TANK