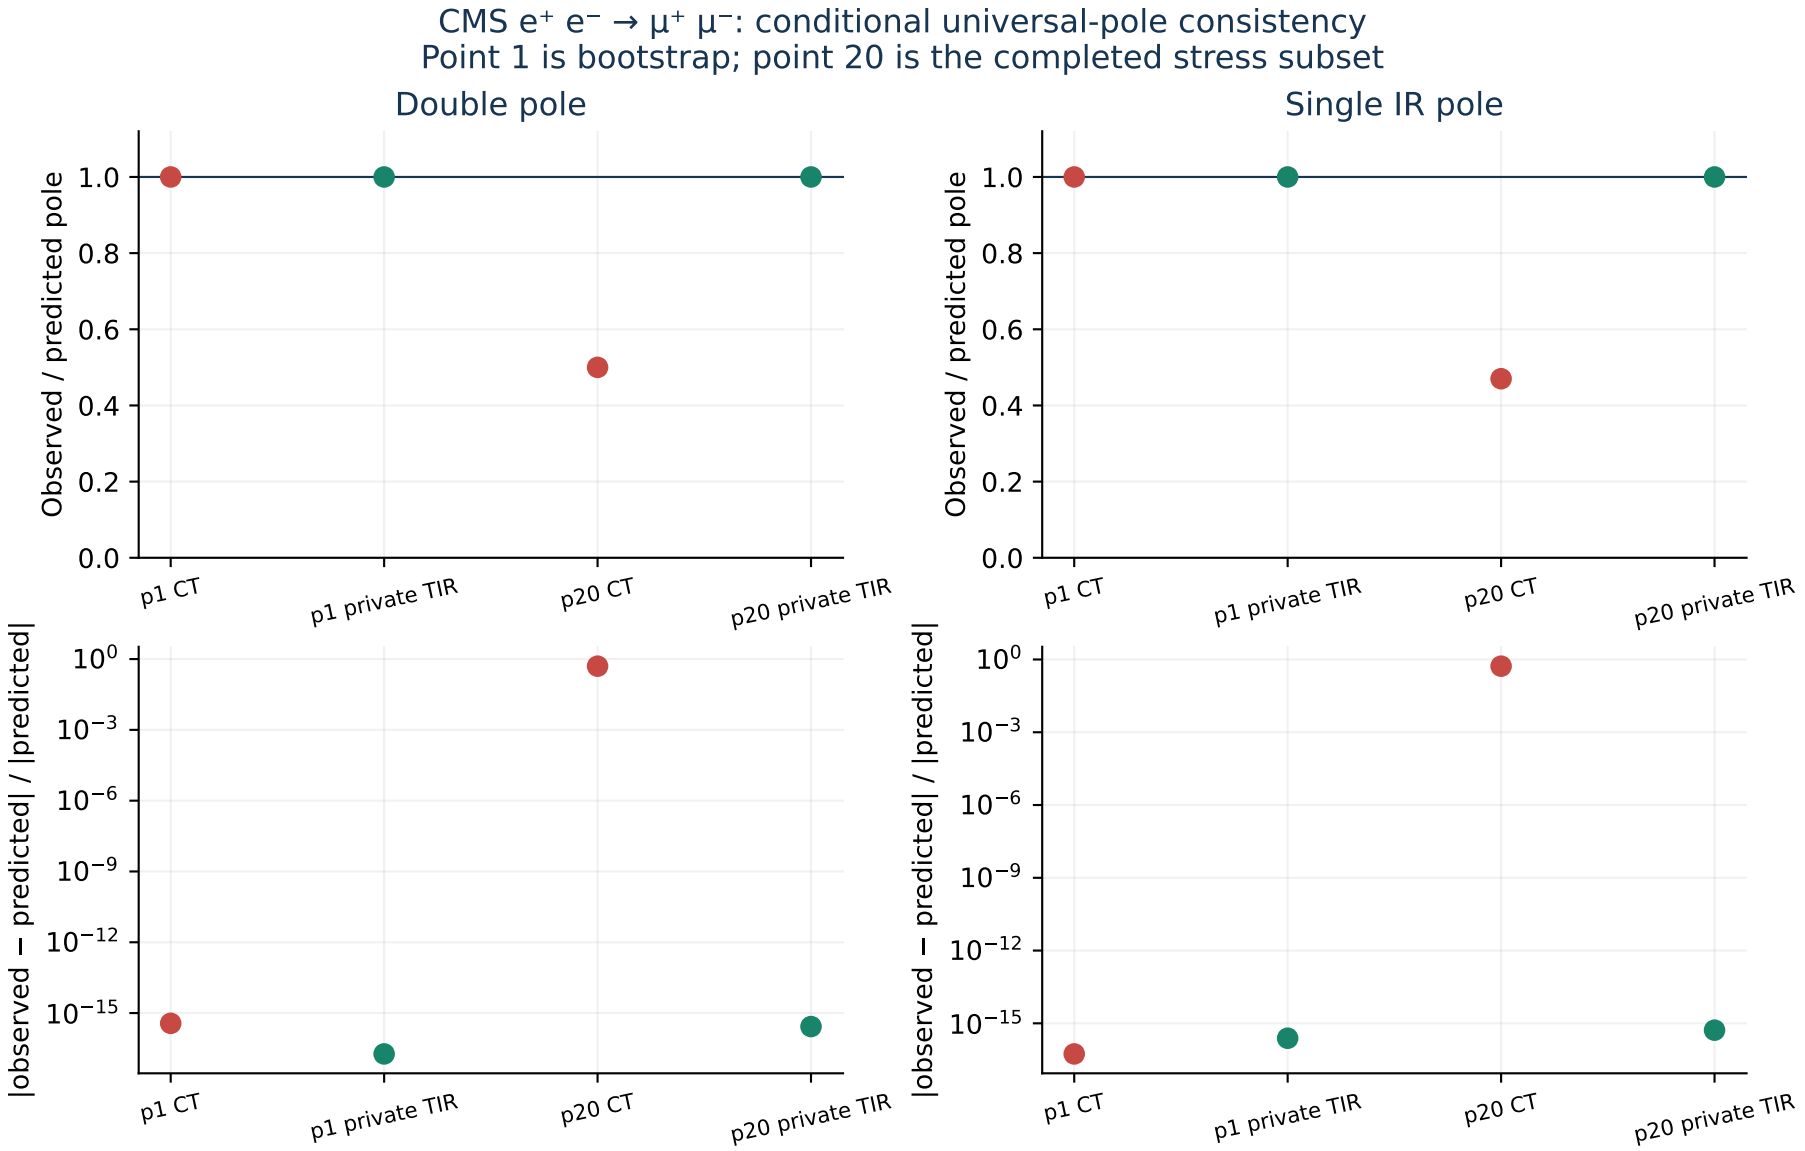
CMS e⁺ e⁻ → μ⁺ μ⁻: conditional universal-pole consistency
Point 1 is bootstrap; point 20 is the completed stress subset
Double pole
Single IR pole
Observed / predicted pole
|observed − predicted| / |predicted|
p1 CT
p1 private TIR
p20 CT
p20 private TIR
Eligible unchecked fixed-QP workers only; failed legacy Ninja/NinjaRS are excluded